

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P741237

Luminaire Tested: LD4D08D010-EU4DR350210IC9050-4LBSQW1B

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P741237  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D08D010-EU4DR350210IC9050-4LBSQW1B  
Description: 4 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 35° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 655.9 lumens  
Efficiency: N/A  
Efficacy: 73.7 lumens/watt  
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 8.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P741237  
CATALOG NUMBER: LD4D08D010-EU4DR350210IC9050-4LBSQW1B

### Luminous Intensity Polar Plot

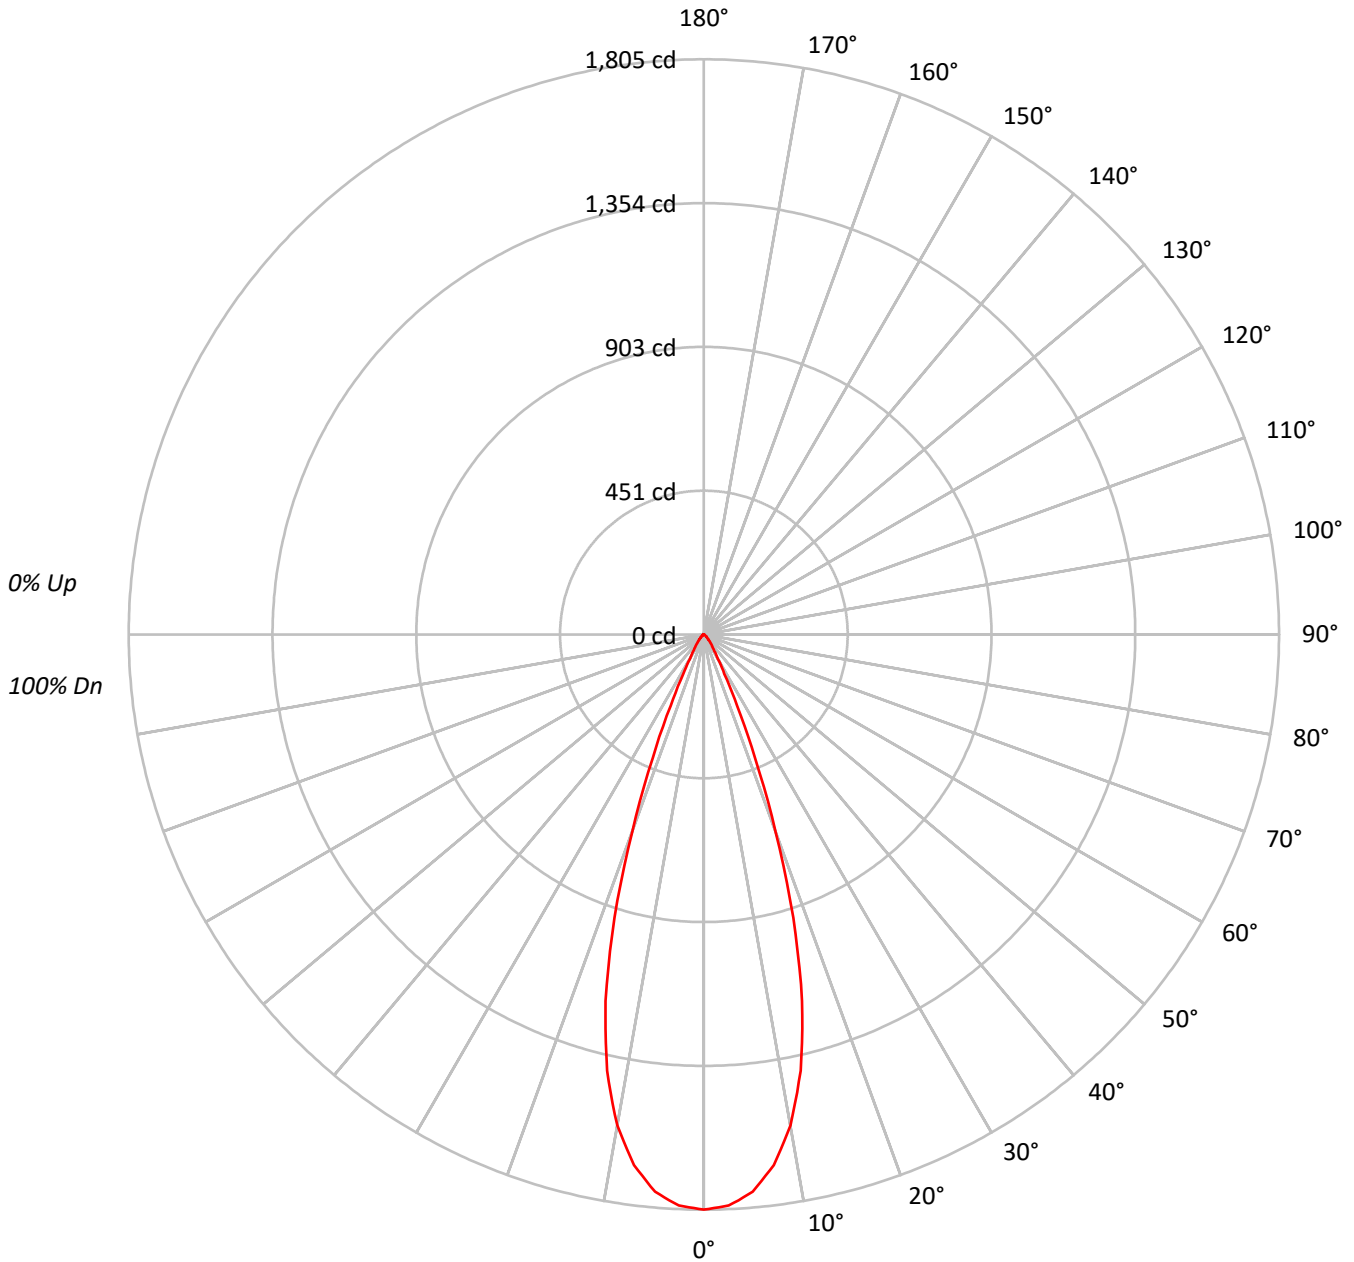



TEST NUMBER: P741237

CATALOG NUMBER: LD4D08D010-EU4DR350210IC9050-4LBSQW1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |     | 0   |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1   | 115 | 112 | 110 | 108 | 112 | 110 | 108 | 107 | 106 | 105 | 103 | 103 | 101 | 100 | 99  | 98  | 98  | 96  | 96  | 96  | 96  |
| 2   | 110 | 106 | 103 | 101 | 108 | 105 | 102 | 99  | 102 | 99  | 97  | 99  | 97  | 95  | 96  | 95  | 93  | 92  | 92  | 92  | 92  |
| 3   | 106 | 101 | 97  | 94  | 105 | 100 | 96  | 93  | 97  | 95  | 92  | 95  | 93  | 91  | 93  | 91  | 89  | 88  | 88  | 88  | 88  |
| 4   | 103 | 97  | 92  | 89  | 101 | 96  | 92  | 89  | 94  | 90  | 88  | 92  | 89  | 87  | 90  | 88  | 86  | 84  | 84  | 84  | 84  |
| 5   | 99  | 93  | 88  | 85  | 98  | 92  | 87  | 84  | 90  | 86  | 84  | 89  | 85  | 83  | 87  | 84  | 82  | 81  | 81  | 81  | 81  |
| 6   | 96  | 89  | 84  | 81  | 94  | 88  | 84  | 81  | 87  | 83  | 80  | 85  | 82  | 80  | 84  | 81  | 79  | 78  | 78  | 78  | 78  |
| 7   | 93  | 85  | 81  | 78  | 91  | 85  | 80  | 77  | 84  | 80  | 77  | 83  | 79  | 77  | 82  | 79  | 76  | 75  | 75  | 75  | 75  |
| 8   | 90  | 82  | 78  | 74  | 88  | 82  | 77  | 74  | 81  | 77  | 74  | 80  | 76  | 74  | 79  | 76  | 73  | 72  | 72  | 72  | 72  |
| 9   | 87  | 79  | 75  | 72  | 86  | 79  | 75  | 72  | 78  | 74  | 71  | 77  | 74  | 71  | 77  | 73  | 71  | 70  | 70  | 70  | 70  |
| 10  | 84  | 77  | 72  | 69  | 83  | 76  | 72  | 69  | 76  | 72  | 69  | 75  | 71  | 69  | 74  | 71  | 69  | 68  | 68  | 68  | 68  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 197194 |
| 5°  | 192562 |
| 10° | 173553 |
| 15° | 134697 |
| 20° | 76403  |
| 25° | 29717  |
| 30° | 11090  |
| 35° | 6069   |
| 40° | 3965   |
| 45° | 2410   |
| 50° | 1547   |
| 55° | 1086   |
| 60° | 809    |
| 65° | 440    |
| 70° | 32     |
| 75° | 0      |
| 80° | 0      |
| 85° | 0      |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2410 cd/sqm



TEST NUMBER: P741237

CATALOG NUMBER: LD4D08D010-EU4DR350210IC9050-4LBSQW1B

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 161.5  | 24.6      |
| 10°-20°   | 315.3  | 48.1      |
| 20°-30°   | 128.6  | 19.6      |
| 30°-40°   | 30.7   | 4.7       |
| 40°-50°   | 12.8   | 2.0       |
| 50°-60°   | 5.3    | 0.8       |
| 60°-70°   | 1.7    | 0.3       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 605.3  | 92.3      |
| 0°-40°    | 636.0  | 97.0      |
| 0°-60°    | 654.2  | 99.7      |
| 0°-90°    | 655.9  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 655.9  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 1805 |      |
| 5°  | 1756 | 161  |
| 15° | 1191 | 315  |
| 25° | 246  | 129  |
| 35° | 46   | 31   |
| 45° | 16   | 13   |
| 55° | 6    | 5    |
| 65° | 2    | 2    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P741237

CATALOG NUMBER: LD4D08D010-EU4DR350210IC9050-4LBSQW1B

**CANDELA DISTRIBUTION (FULL):**

|       | 0°     |
|-------|--------|
| 0°    | 1804.8 |
| 2.5°  | 1794.0 |
| 5°    | 1755.7 |
| 7.5°  | 1679.3 |
| 10°   | 1564.3 |
| 12.5° | 1402.2 |
| 15°   | 1190.8 |
| 17.5° | 932.3  |
| 20°   | 657.1  |
| 22.5° | 419.0  |
| 25°   | 246.5  |
| 27.5° | 139.3  |
| 30°   | 87.9   |
| 32.5° | 61.7   |
| 35°   | 45.5   |
| 37.5° | 35.2   |
| 40°   | 27.8   |
| 42.5° | 21.4   |
| 45°   | 15.6   |
| 47.5° | 11.7   |
| 50°   | 9.1    |
| 52.5° | 7.2    |
| 55°   | 5.7    |
| 57.5° | 4.6    |
| 60°   | 3.7    |
| 62.5° | 2.6    |
| 65°   | 1.7    |
| 67.5° | 0.6    |
| 70°   | 0.1    |
| 72.5° | 0.1    |
| 75°   | 0.0    |
| 77.5° | 0.0    |
| 80°   | 0.0    |
| 82.5° | 0.1    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)