

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P753701

Luminaire Tested: LD4D80BD010-EU4DR2570959027-4LBCSSQMMS

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P753701
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D80BD010-EU4DR2570959027-4LBCSSQMMMS
Description: 4 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6071.2 lumens
Efficiency: N/A
Efficacy: 76.9 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 78.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P753701

CATALOG NUMBER: LD4D80BD010-EU4DR2570959027-4LBCSSQMMS

Luminous Intensity Polar Plot

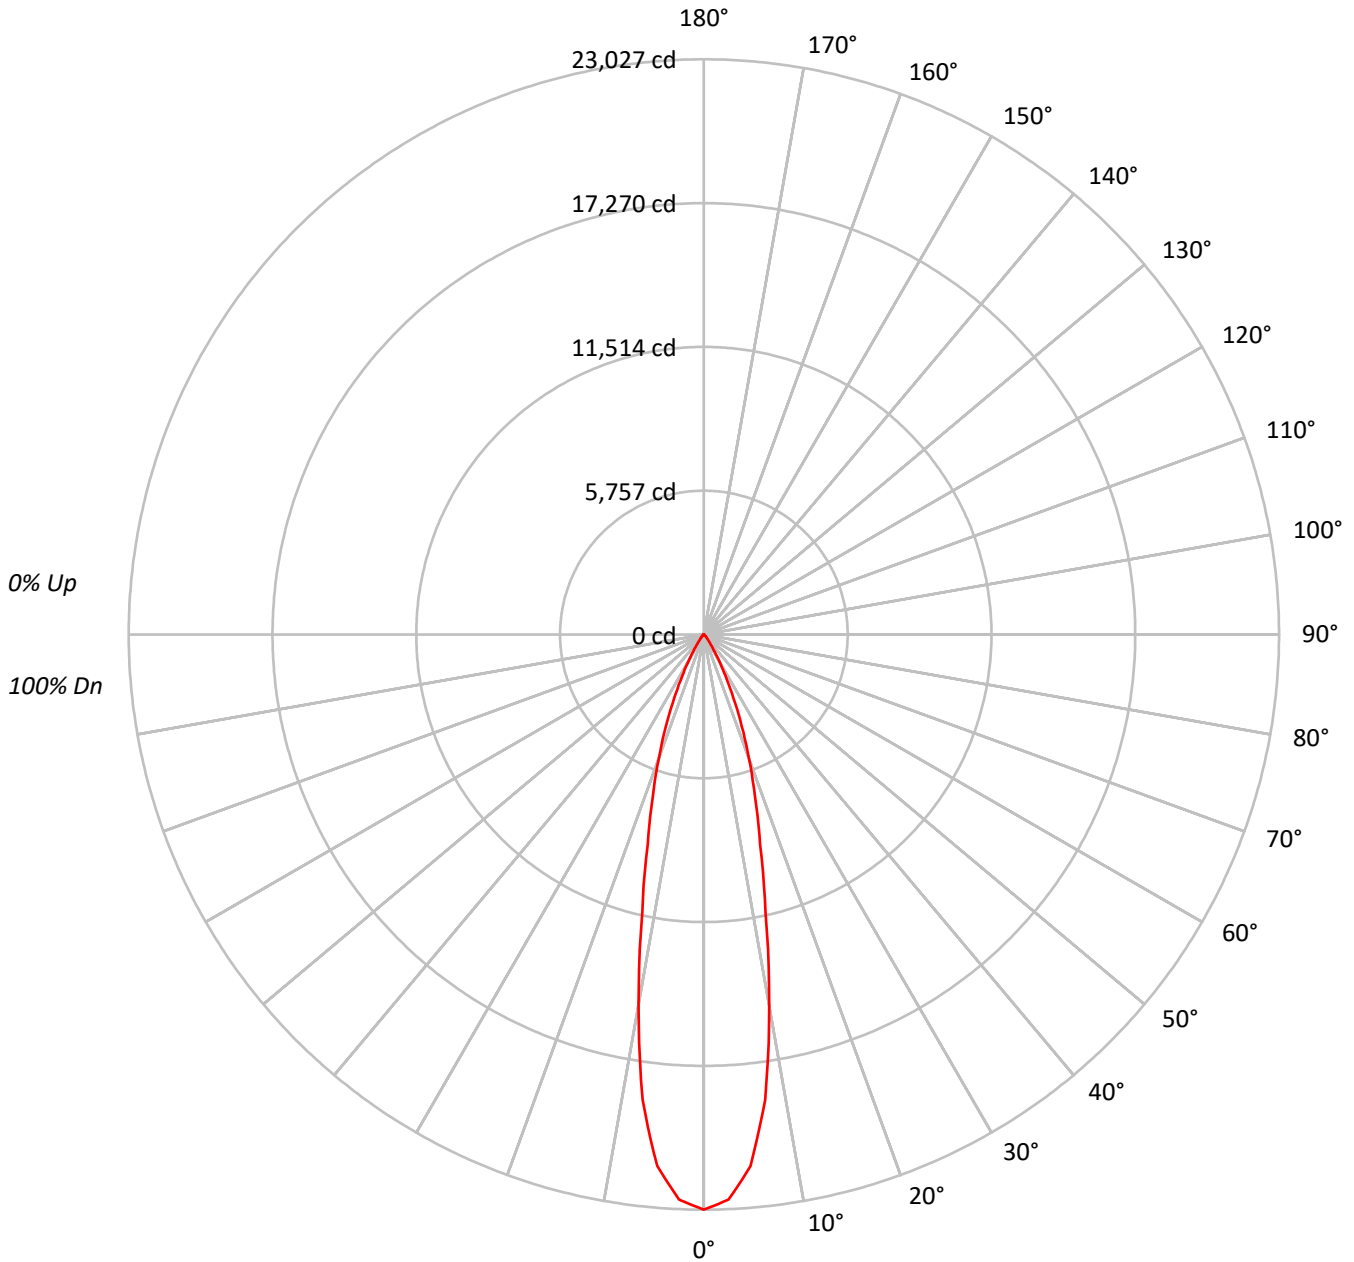



TEST NUMBER: P753701

CATALOG NUMBER: LD4D80BD010-EU4DR2570959027-4LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89			
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85			
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79			
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2515926
5°	2343273
10°	1671517
15°	984463
20°	612549
25°	336170
30°	153743
35°	58222
40°	26372
45°	15854
50°	6578
55°	4248
60°	2972
65°	1991
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15854 cd/sqm



TEST NUMBER: P753701

CATALOG NUMBER: LD4D80BD010-EU4DR2570959027-4LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1836.1	30.2
10°-20°	2486.9	41.0
20°-30°	1316.1	21.7
30°-40°	324.9	5.4
40°-50°	79.3	1.3
50°-60°	20.9	0.3
60°-70°	7.0	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5639.1	92.9
0°-40°	5964.0	98.2
0°-60°	6064.1	99.9
0°-90°	6071.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6071.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	23027	
5°	21365	###
15°	8703	2487
25°	2788	1316
35°	436	325
45°	103	79
55°	22	21
65°	8	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P753701

CATALOG NUMBER: LD4D80BD010-EU4DR2570959027-4LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	23026.8
2.5°	22648.4
5°	21365.0
7.5°	18786.5
10°	15066.0
12.5°	11389.0
15°	8703.2
17.5°	6782.9
20°	5268.2
22.5°	3950.9
25°	2788.5
27.5°	1869.9
30°	1218.6
32.5°	741.4
35°	436.5
37.5°	267.1
40°	184.9
42.5°	141.3
45°	102.6
47.5°	61.9
50°	38.7
52.5°	28.1
55°	22.3
57.5°	17.4
60°	13.6
62.5°	10.6
65°	7.7
67.5°	2.9
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)