

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P754248

Luminaire Tested: LD4D80BD010-EU4DR6070959027-4LBCSSQMW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P754248
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D80BD010-EU4DR6070959027-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7267.9 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 78.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P754248
CATALOG NUMBER: LD4D80BD010-EU4DR6070959027-4LBCSSQMW

Luminous Intensity Polar Plot

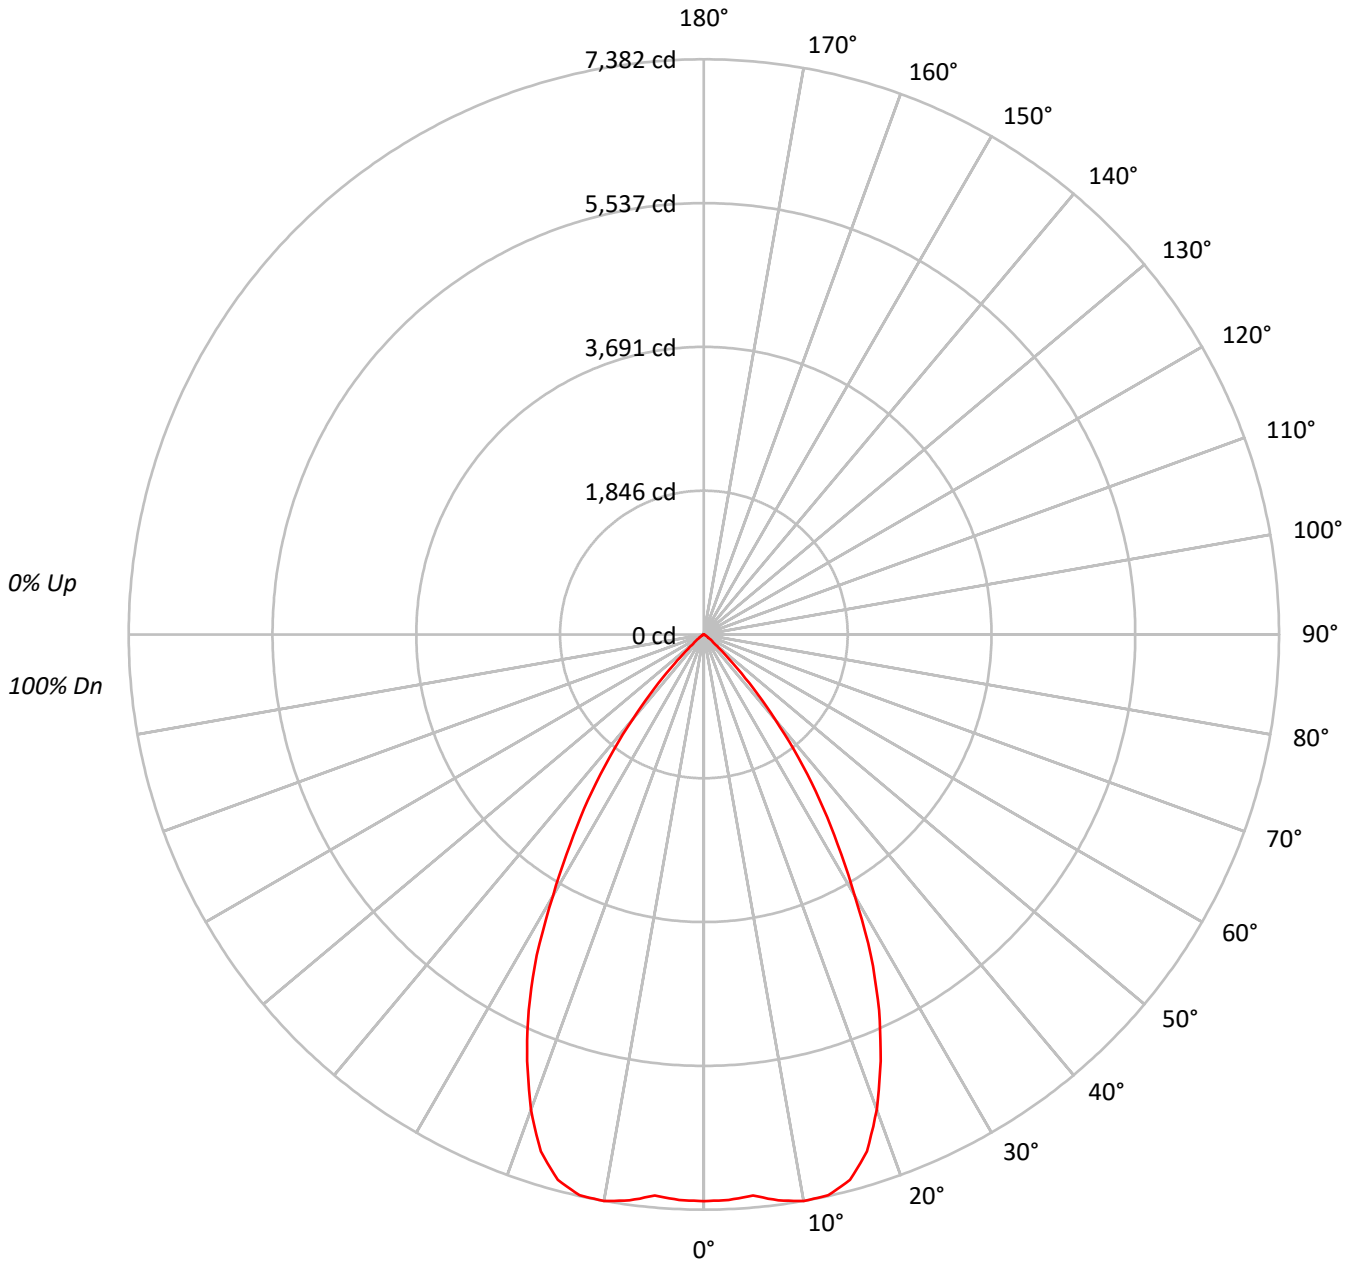



TEST NUMBER: P754248

CATALOG NUMBER: LD4D80BD010-EU4DR6070959027-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94																			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75																			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70																			
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65																			
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61																			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57																			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53																			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	794675
5°	792731
10°	819061
15°	819903
20°	754402
25°	641671
30°	488934
35°	345755
40°	203033
45°	81925
50°	27350
55°	13163
60°	5419
65°	801
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 81925 cd/sqm



TEST NUMBER: P754248

CATALOG NUMBER: LD4D80BD010-EU4DR6070959027-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	697.2	9.6
10°-20°	2008.1	27.6
20°-30°	2403.4	33.1
30°-40°	1607.5	22.1
40°-50°	476.6	6.6
50°-60°	68.5	0.9
60°-70°	6.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5108.7	70.3
0°-40°	6716.2	92.4
0°-60°	7261.3	99.9
0°-90°	7267.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7267.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7273	
5°	7228	697
15°	7248	2008
25°	5323	2403
35°	2592	1608
45°	530	477
55°	69	69
65°	3	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P754248

CATALOG NUMBER: LD4D80BD010-EU4DR6070959027-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	7273.2
2.5°	7263.9
5°	7227.8
7.5°	7325.8
10°	7382.5
12.5°	7372.2
15°	7248.4
17.5°	6956.5
20°	6488.2
22.5°	5926.0
25°	5322.6
27.5°	4642.8
30°	3875.4
32.5°	3190.5
35°	2592.2
37.5°	1992.9
40°	1423.5
42.5°	938.7
45°	530.2
47.5°	271.3
50°	160.9
52.5°	104.2
55°	69.1
57.5°	44.4
60°	24.8
62.5°	10.3
65°	3.1
67.5°	1.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)