

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P754064

Luminaire Tested: LD4D80BD010-EU4DR4570959050-4LBCSSQMB

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P754064
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D80BD010-EU4DR4570959050-4LBCSSQMB
Description: 4 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7963.0 lumens
Efficiency: N/A
Efficacy: 100.9 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 78.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P754064
CATALOG NUMBER: LD4D80BD010-EU4DR4570959050-4LBCSSQMB

Luminous Intensity Polar Plot

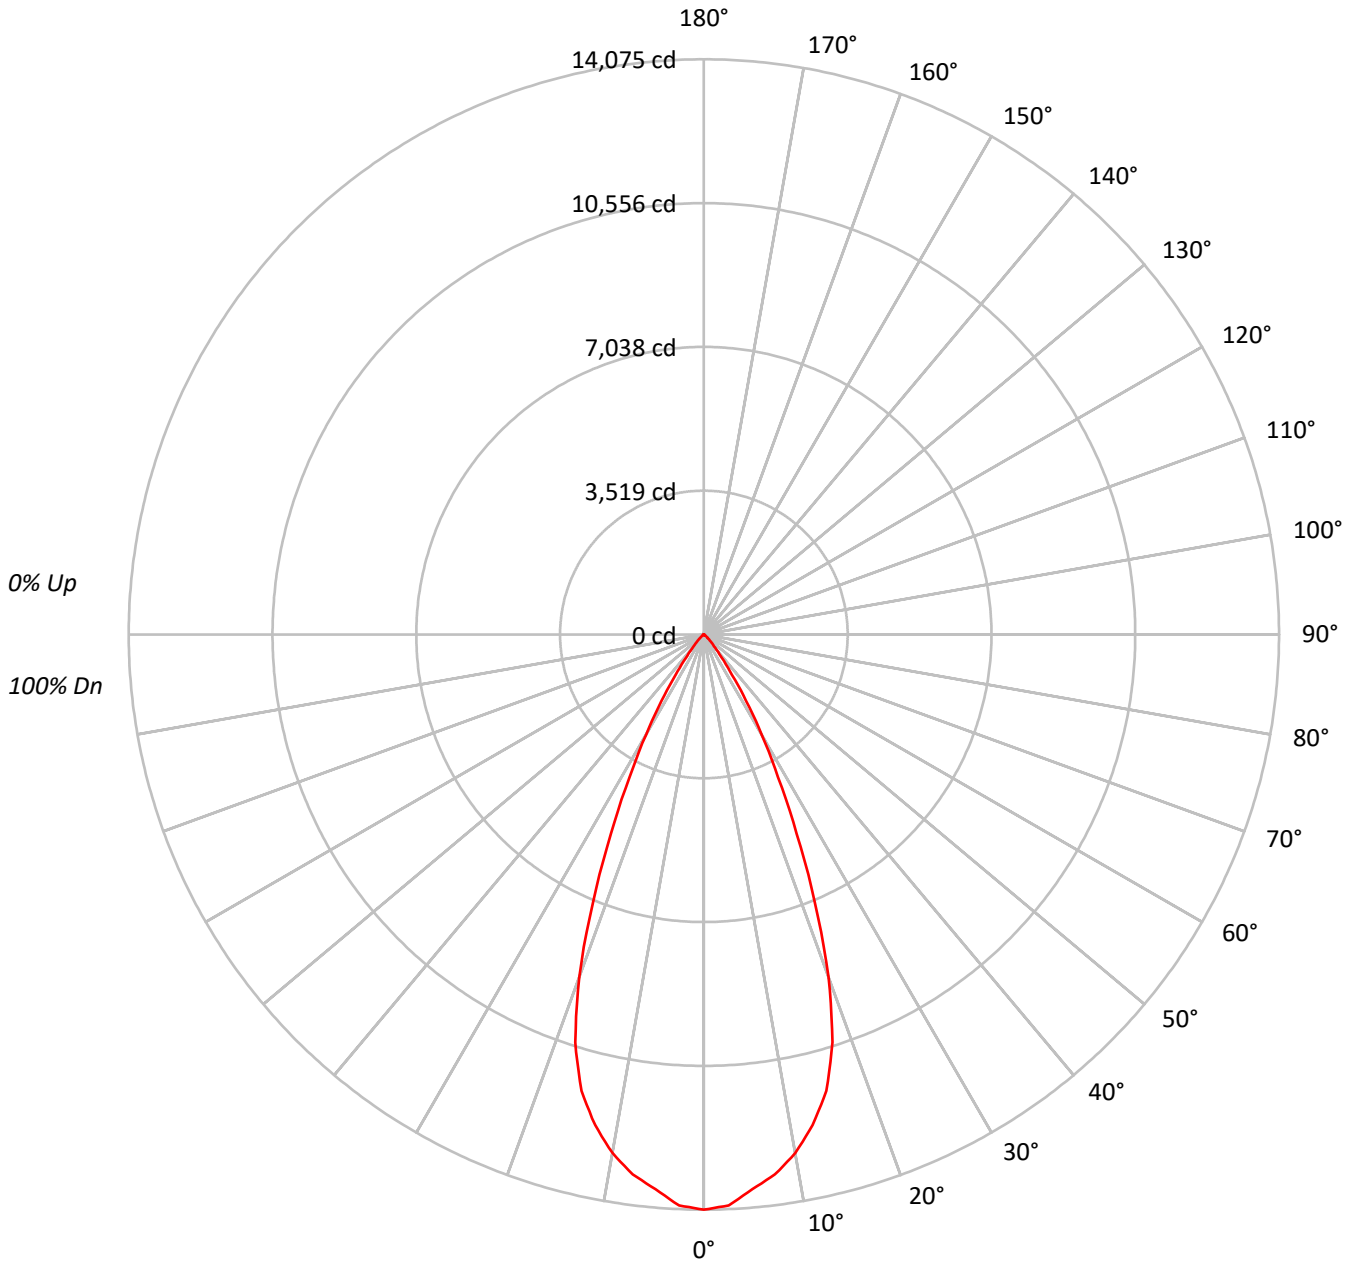



TEST NUMBER: P754064

CATALOG NUMBER: LD4D80BD010-EU4DR4570959050-4LBCSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100														
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95					95														
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90					90														
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85					85														
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81					81														
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77					77														
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73					73														
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69					69														
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66					66														
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63					63														
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60					60														

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1537823
5°	1494035
10°	1429387
15°	1308198
20°	1037852
25°	647940
30°	357131
35°	160353
40°	63156
45°	29760
50°	14108
55°	7372
60°	3627
65°	853
70°	351
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 29760 cd/sqm



TEST NUMBER: P754064

CATALOG NUMBER: LD4D80BD010-EU4DR4570959050-4LBCSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1279.9	16.1
10°-20°	3150.0	39.6
20°-30°	2494.5	31.3
30°-40°	830.7	10.4
40°-50°	164.9	2.1
50°-60°	37.4	0.5
60°-70°	5.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6924.5	87.0
0°-40°	7755.1	97.4
0°-60°	7957.4	99.9
0°-90°	7963.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7963.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14075	
5°	13622	###
15°	11565	3150
25°	5375	2495
35°	1202	831
45°	193	165
55°	39	37
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P754064

CATALOG NUMBER: LD4D80BD010-EU4DR4570959050-4LBCSSQMB

CANDELA DISTRIBUTION (FULL):

0°	
0°	14074.8
2.5°	13982.9
5°	13622.0
7.5°	13324.2
10°	12883.6
12.5°	12296.9
15°	11565.2
17.5°	10464.8
20°	8926.0
22.5°	7092.7
25°	5374.6
27.5°	3935.5
30°	2830.7
32.5°	1925.1
35°	1202.2
37.5°	712.9
40°	442.8
42.5°	291.1
45°	192.6
47.5°	124.0
50°	83.0
52.5°	55.4
55°	38.7
57.5°	25.5
60°	16.6
62.5°	8.9
65°	3.3
67.5°	1.1
70°	1.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)