

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P755195

Luminaire Tested: LD4D85BD010-EU4DR7070959030-4LBCSSQMB

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P755195  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D85BD010-EU4DR7070959030-4LBCSSQMB  
Description: 4 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 70° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 8043.7 lumens  
Efficiency: N/A  
Efficacy: 91.7 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 87.7  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P755195

CATALOG NUMBER: LD4D85BD010-EU4DR7070959030-4LBCSSQMB

### Luminous Intensity Polar Plot

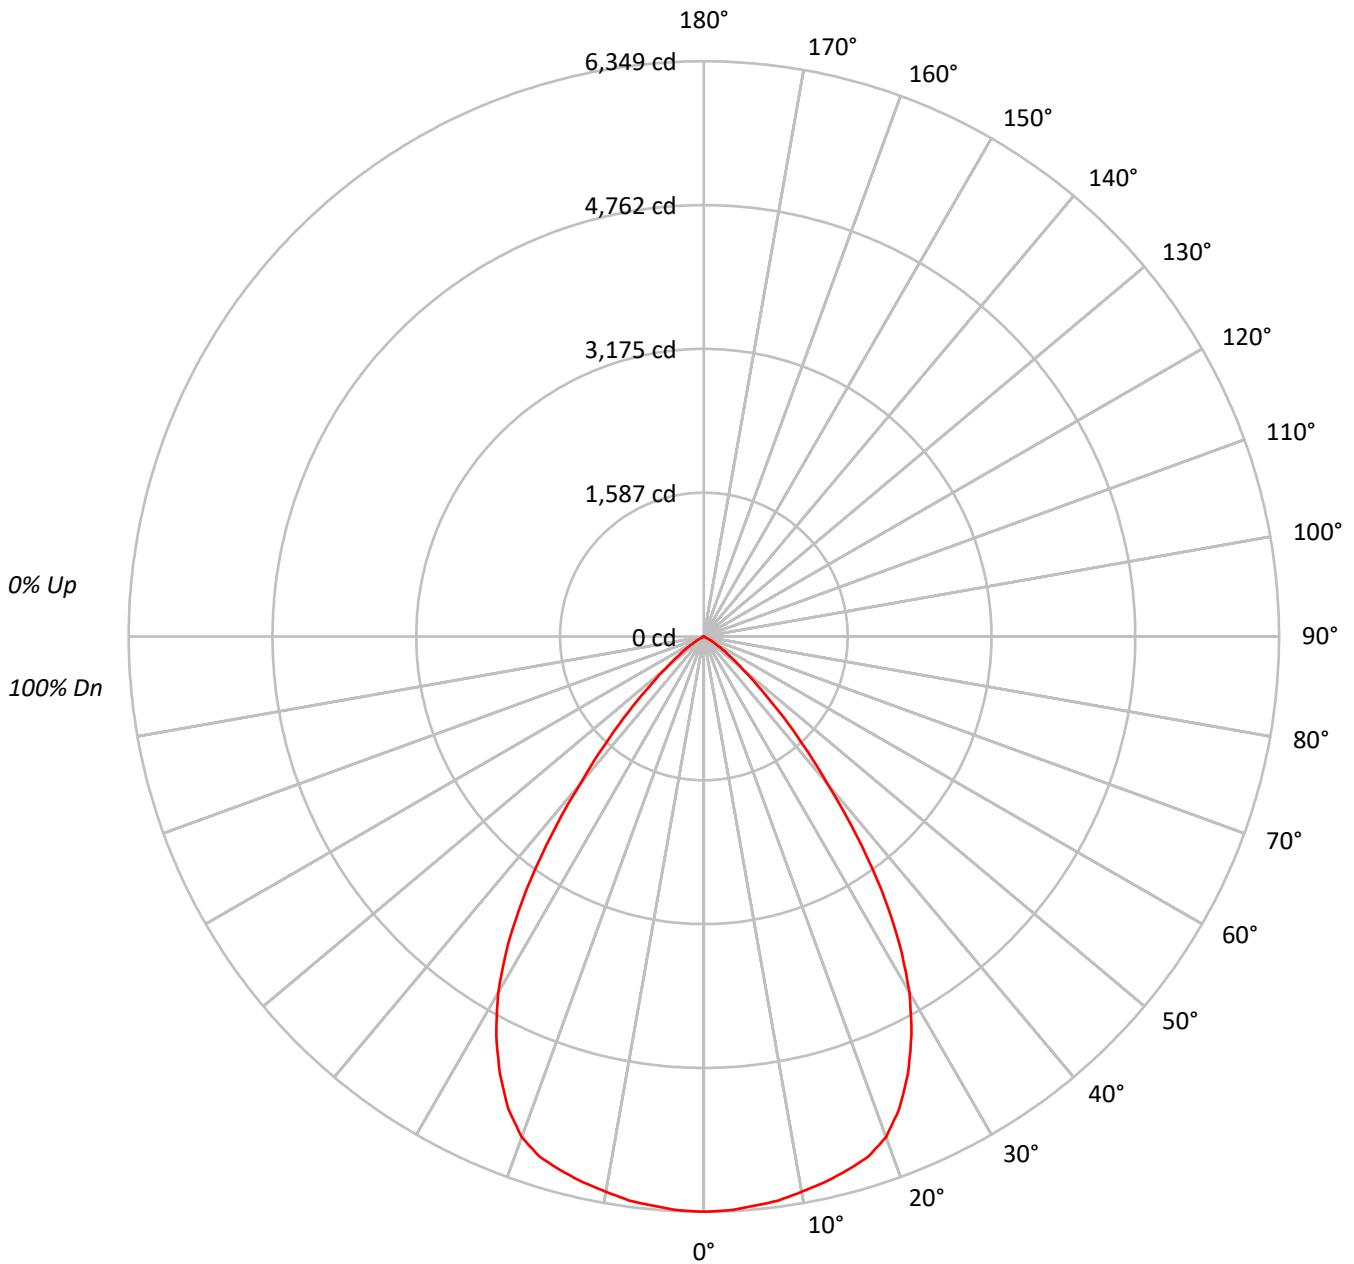



TEST NUMBER: P755195

CATALOG NUMBER: LD4D85BD010-EU4DR7070959030-4LBCSSQMB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	113	110	107	105	111	108	106	103	104	102	100		100	99	97		97	95	94	93
2	107	102	97	94	105	100	96	92	97	93	90		94	91	88		91	89	87	85
3	101	94	88	84	99	92	87	83	90	85	82		87	84	81		85	82	79	78
4	95	87	81	76	93	86	80	76	83	78	75		81	77	74		79	76	73	71
5	89	80	74	69	88	79	73	69	78	72	68		76	71	68		74	70	67	65
6	84	75	68	63	83	74	68	63	72	67	63		71	66	62		69	65	62	60
7	80	69	63	58	78	69	62	58	67	62	58		66	61	57		65	61	57	56
8	75	65	58	54	74	64	58	54	63	57	53		62	57	53		61	56	53	51
9	71	61	54	50	70	60	54	50	59	53	50		58	53	49		57	53	49	48
10	67	57	50	46	66	56	50	46	55	50	46		55	50	46		54	49	46	44

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	693675
5°	691948
10°	690441
15°	690251
20°	683510
25°	642069
30°	572404
35°	456382
40°	303031
45°	181172
50°	93931
55°	49375
60°	17460
65°	284
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 181172 cd/sqm



TEST NUMBER: P755195

CATALOG NUMBER: LD4D85BD010-EU4DR7070959030-4LBCSSQMB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	600.0	7.5
10°-20°	1720.7	21.4
20°-30°	2427.4	30.2
30°-40°	2095.5	26.1
40°-50°	938.4	11.7
50°-60°	245.7	3.1
60°-70°	16.0	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4748.1	59.0
0°-40°	6843.7	85.1
0°-60°	8027.7	99.8
0°-90°	8043.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8043.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	6349	
5°	6309	600
15°	6102	1721
25°	5326	2427
35°	3422	2096
45°	1172	938
55°	259	246
65°	1	16
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P755195

CATALOG NUMBER: LD4D85BD010-EU4DR7070959030-4LBCSSQMB

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	6348.8
2.5°	6342.0
5°	6308.9
7.5°	6281.5
10°	6223.2
12.5°	6170.7
15°	6102.2
17.5°	6023.4
20°	5878.5
22.5°	5639.8
25°	5325.9
27.5°	4961.7
30°	4537.0
32.5°	4017.5
35°	3421.6
37.5°	2764.0
40°	2124.6
42.5°	1614.3
45°	1172.5
47.5°	808.3
50°	552.6
52.5°	381.3
55°	259.2
57.5°	156.4
60°	79.9
62.5°	25.1
65°	1.1
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)