

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P756770

Luminaire Tested: LD4D95BD010-EU4DR7070959035-4LBCSSQMW

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P756770  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D95BD010-EU4DR7070959035-4LBCSSQMW  
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 70° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 8919.8 lumens  
Efficiency: N/A  
Efficacy: 89.9 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 99.2  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P756770  
CATALOG NUMBER: LD4D95BD010-EU4DR7070959035-4LBCSSQMW

### Luminous Intensity Polar Plot

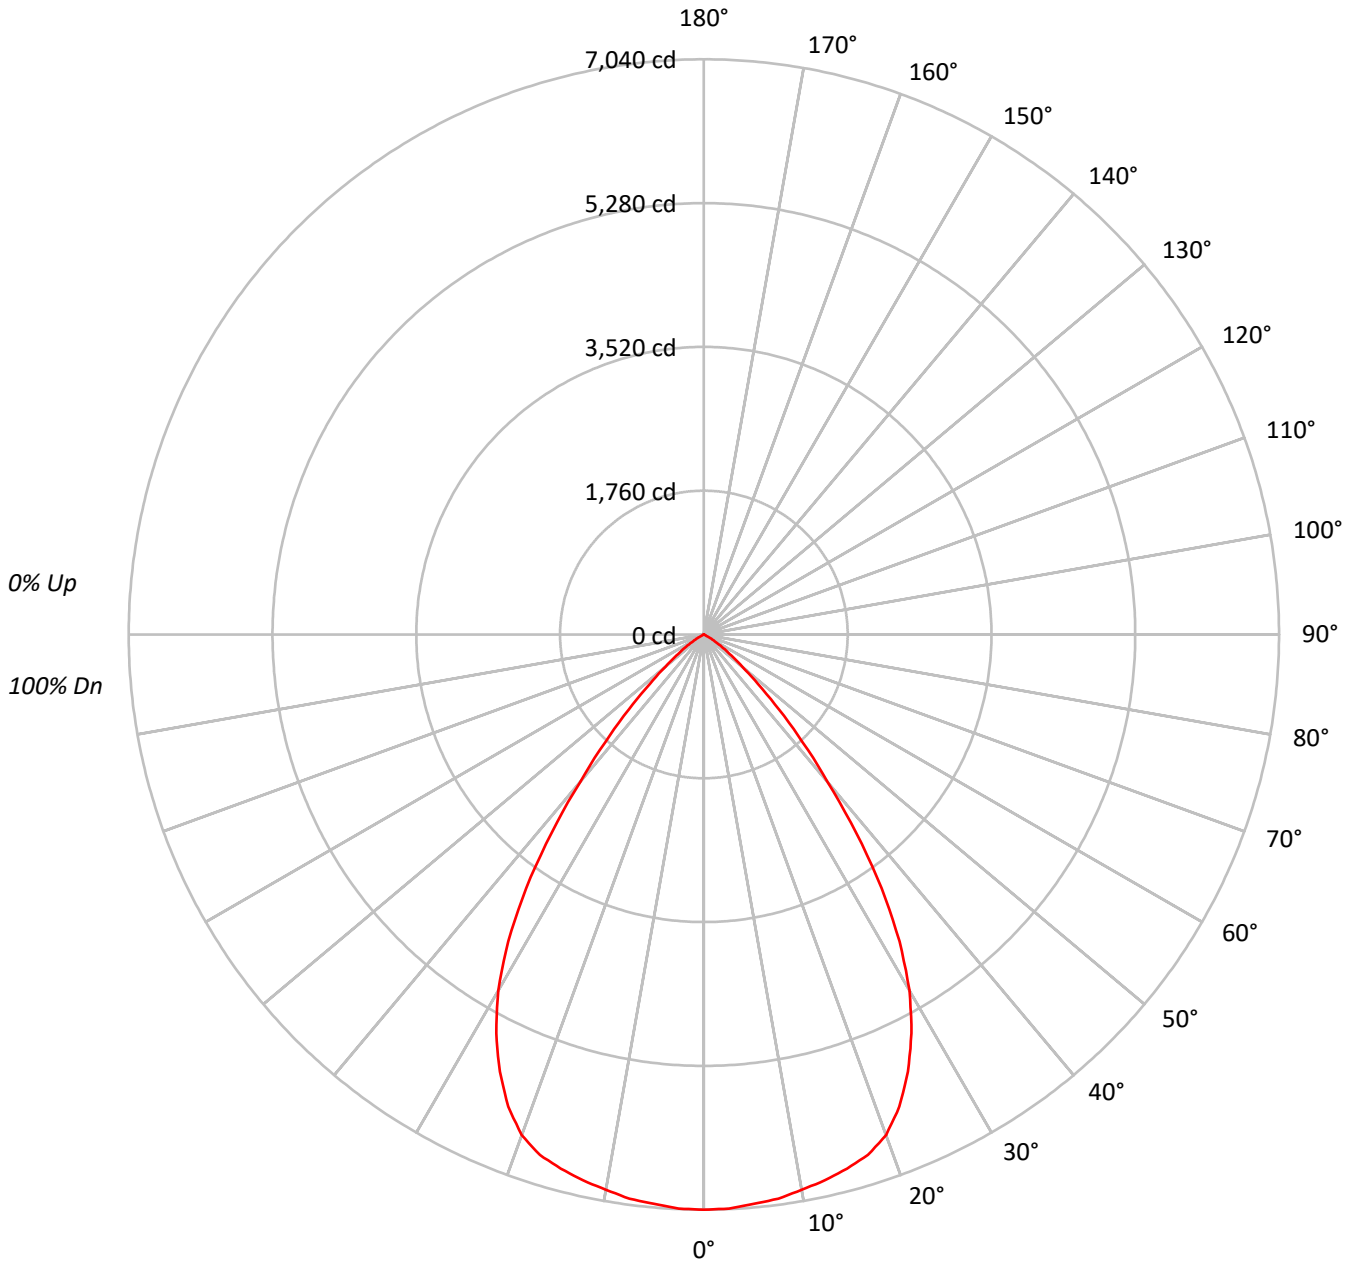



TEST NUMBER: P756770

CATALOG NUMBER: LD4D95BD010-EU4DR7070959035-4LBCSSQMW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93			93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78			78
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71			71
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65			65
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60			60
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56			56
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51			51
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48			48
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44			44

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	769228
5°	767308
10°	765640
15°	765427
20°	757948
25°	711991
30°	634741
35°	506081
40°	336036
45°	200904
50°	104146
55°	54747
60°	19361
65°	336
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 200904 cd/sqm



TEST NUMBER: P756770

CATALOG NUMBER: LD4D95BD010-EU4DR7070959035-4LBCSSQMW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	665.3	7.5
10°-20°	1908.1	21.4
20°-30°	2691.8	30.2
30°-40°	2323.7	26.1
40°-50°	1040.6	11.7
50°-60°	272.4	3.1
60°-70°	17.8	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5265.3	59.0
0°-40°	7589.0	85.1
0°-60°	8902.0	99.8
0°-90°	8919.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8919.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	7040	
5°	6996	665
15°	6767	1908
25°	5906	2692
35°	3794	2324
45°	1300	1041
55°	287	272
65°	1	18
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P756770

CATALOG NUMBER: LD4D95BD010-EU4DR7070959035-4LBCSSQMW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	7040.3
2.5°	7032.7
5°	6996.0
7.5°	6965.6
10°	6901.0
12.5°	6842.8
15°	6766.8
17.5°	6679.5
20°	6518.7
22.5°	6254.1
25°	5905.9
27.5°	5502.1
30°	5031.1
32.5°	4455.1
35°	3794.2
37.5°	3065.0
40°	2356.0
42.5°	1790.1
45°	1300.2
47.5°	896.3
50°	612.7
52.5°	422.8
55°	287.4
57.5°	173.4
60°	88.6
62.5°	27.9
65°	1.3
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)