

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P756795

Luminaire Tested: LD4D95BD010-EU4DR7070959050-4LBCSSQMMS

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P756795
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D95BD010-EU4DR7070959050-4LBCSSQMMMS
Description: 4 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9311.4 lumens
Efficiency: N/A
Efficacy: 93.9 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P756795
CATALOG NUMBER: LD4D95BD010-EU4DR7070959050-4LBCSSQMMS

Luminous Intensity Polar Plot

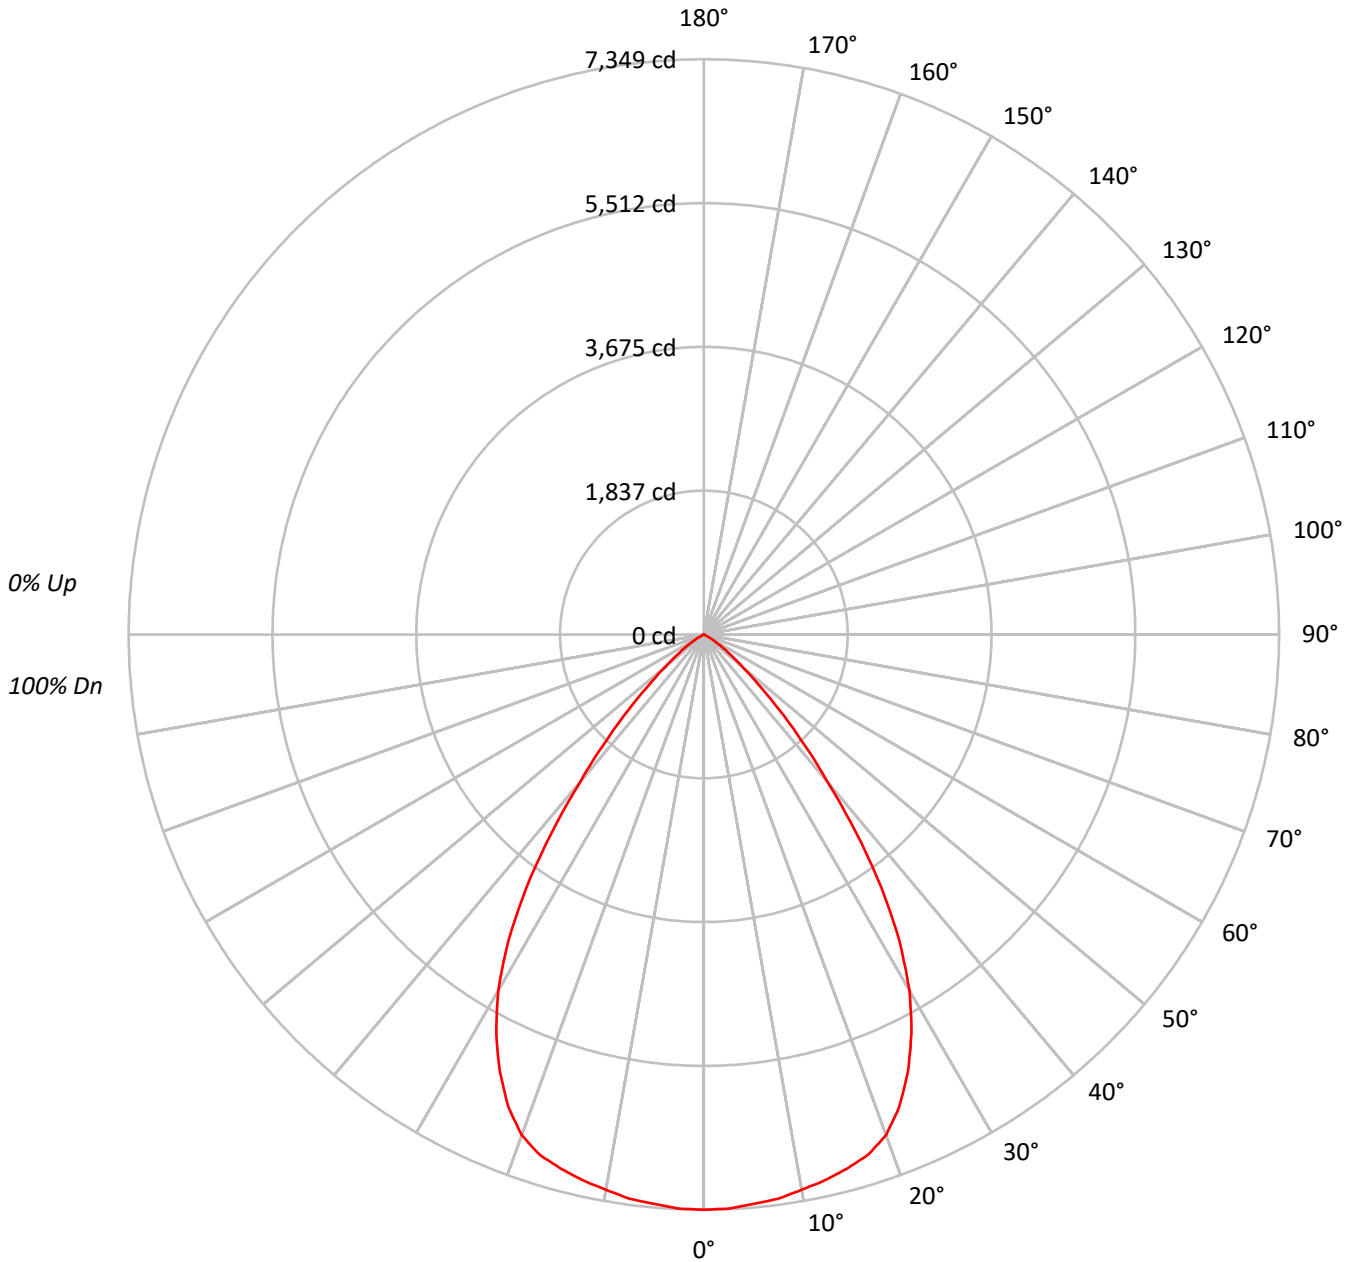



TEST NUMBER: P756795

CATALOG NUMBER: LD4D95BD010-EU4DR7070959050-4LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93						93													
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85						85													
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78						78													
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71						71													
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65						65													
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60						60													
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56						56													
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51						51													
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48						48													
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44						44													

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	802990
5°	800990
10°	799257
15°	799033
20°	791214
25°	743251
30°	662610
35°	528302
40°	350798
45°	209727
50°	108719
55°	57147
60°	20213
65°	336
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 209727 cd/sqm



TEST NUMBER: P756795

CATALOG NUMBER: LD4D95BD010-EU4DR7070959050-4LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	694.5	7.5
10°-20°	1991.9	21.4
20°-30°	2810.0	30.2
30°-40°	2425.8	26.1
40°-50°	1086.3	11.7
50°-60°	284.4	3.1
60°-70°	18.5	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5496.4	59.0
0°-40°	7922.2	85.1
0°-60°	9292.9	99.8
0°-90°	9311.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9311.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7349	
5°	7303	695
15°	7064	1992
25°	6165	2810
35°	3961	2426
45°	1357	1086
55°	300	284
65°	1	19
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P756795

CATALOG NUMBER: LD4D95BD010-EU4DR7070959050-4LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	7349.3
2.5°	7341.4
5°	7303.1
7.5°	7271.4
10°	7204.0
12.5°	7143.2
15°	7063.9
17.5°	6972.7
20°	6804.8
22.5°	6528.6
25°	6165.2
27.5°	5743.6
30°	5252.0
32.5°	4650.7
35°	3960.8
37.5°	3199.6
40°	2459.5
42.5°	1868.7
45°	1357.3
47.5°	935.7
50°	639.6
52.5°	441.4
55°	300.0
57.5°	181.1
60°	92.5
62.5°	29.1
65°	1.3
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)