

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P207553

Luminaire Tested: **LD4B15D010 EU4B10208040 4LBMMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P207553  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD4B15D010 EU4B10208040 4LBMMW1  
Description: PORTFOLIO 4 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
MEDIUM DISTRIBUTION WITH MATTE WHITE TRIM  
WATTAGE D010TR-14.39W DE010-14.29W D5LT-14.34W DMX-14.46W DL2-15.8W  
DL3-15.28W DLE-15.432W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1212.2 lumens  
Efficiency: N/A  
Efficacy: 84.8 lumens/watt  
Spacing Criteria (0/90/45): 0.99 / 0.99 / 0.97  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P207553

CATALOG NUMBER: LD4B15D010 EU4B10208040 4LBMMW1

### Luminous Intensity Polar Plot

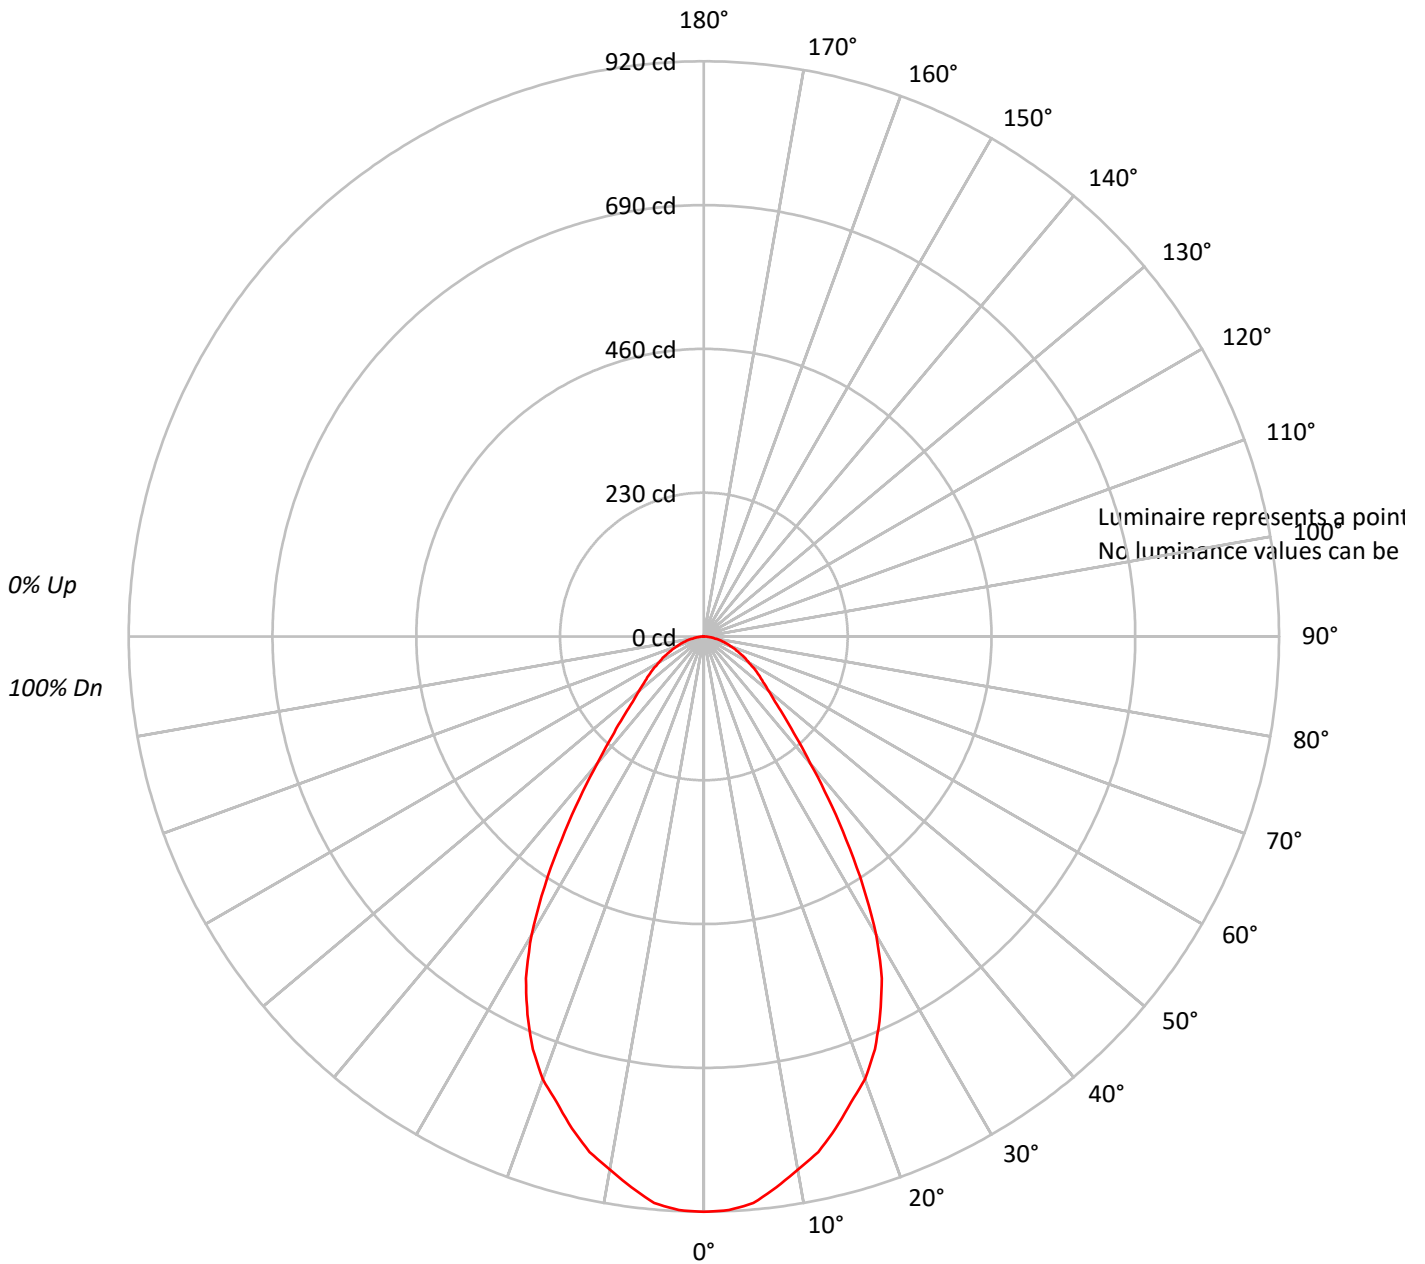



TEST NUMBER: P207553

CATALOG NUMBER: LD4B15D010 EU4B10208040 4LBMMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	91	89																			
2	104	98	92	88	102	96	91	87	93	89	85	89	86	83	87	84	81	80																			
3	97	89	83	77	95	87	82	77	85	80	76	82	78	74	80	76	73	71																			
4	91	81	74	69	89	80	74	69	78	72	68	76	71	67	74	69	66	64																			
5	85	75	67	62	83	74	67	62	72	66	61	70	65	61	68	64	60	58																			
6	80	69	62	56	78	68	61	56	66	60	56	65	59	55	63	59	55	53																			
7	75	64	57	52	74	63	56	51	62	56	51	60	55	51	59	54	50	49																			
8	71	59	52	47	69	59	52	47	58	51	47	56	51	47	55	50	47	45																			
9	67	55	48	44	66	55	48	44	54	48	44	53	47	43	52	47	43	42																			
10	63	52	45	41	62	51	45	41	51	45	40	50	44	40	49	44	40	39																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P207553

CATALOG NUMBER: LD4B15D010 EU4B10208040 4LBMMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	85.3	7.0
10°-20°	228.7	18.9
20°-30°	304.0	25.1
30°-40°	248.7	20.5
40°-50°	144.8	11.9
50°-60°	96.0	7.9
60°-70°	63.2	5.2
70°-80°	33.3	2.8
80°-90°	8.1	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	618.0	51.0
0°-40°	866.7	71.5
0°-60°	1107.5	91.4
0°-90°	1212.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1212.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	920	
5°	910	85
15°	815	229
25°	667	304
35°	397	249
45°	183	145
55°	107	96
65°	63	63
75°	32	33
85°	7	8
90°	0	



TEST NUMBER: P207553

CATALOG NUMBER: LD4B15D010 EU4B10208040 4LBMMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	920.2
2.5°	918.5
5°	909.7
7.5°	888.6
10°	865.8
12.5°	844.7
15°	814.8
17.5°	781.5
20°	753.4
22.5°	714.7
25°	667.3
27.5°	616.4
30°	551.4
32.5°	474.2
35°	396.9
37.5°	326.6
40°	265.2
42.5°	217.8
45°	182.6
47.5°	154.5
50°	135.2
52.5°	119.4
55°	107.1
57.5°	94.8
60°	82.5
62.5°	73.8
65°	63.2
67.5°	54.4
70°	45.7
72.5°	38.6
75°	31.6
77.5°	24.6
80°	17.6
82.5°	12.3
85°	7.0
87.5°	1.8
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)