

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P839322

Luminaire Tested: **LD4C50D010 EU4509040 4LBSLI**

Issue Date: 2/9/2022



Test Information

Test Method: LM-79-08
Report Number: P839322
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208407)
Test Lab: INNOVATION CENTER
Issue Date: 2/9/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LD4C50D010 EU4509040 4LBSLI
Description: 4 INCH 5000 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 4000K, 90CRI LEDS
AND 4LBS TRIM WITH LI FINISH
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5490.0 lumens
Efficiency: N/A
Efficacy: 94.0 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 1
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 58.4
Input Voltage (V):
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P839322

CATALOG NUMBER: LD4C50D010 EU4509040 4LBSLI

Luminous Intensity Polar Plot

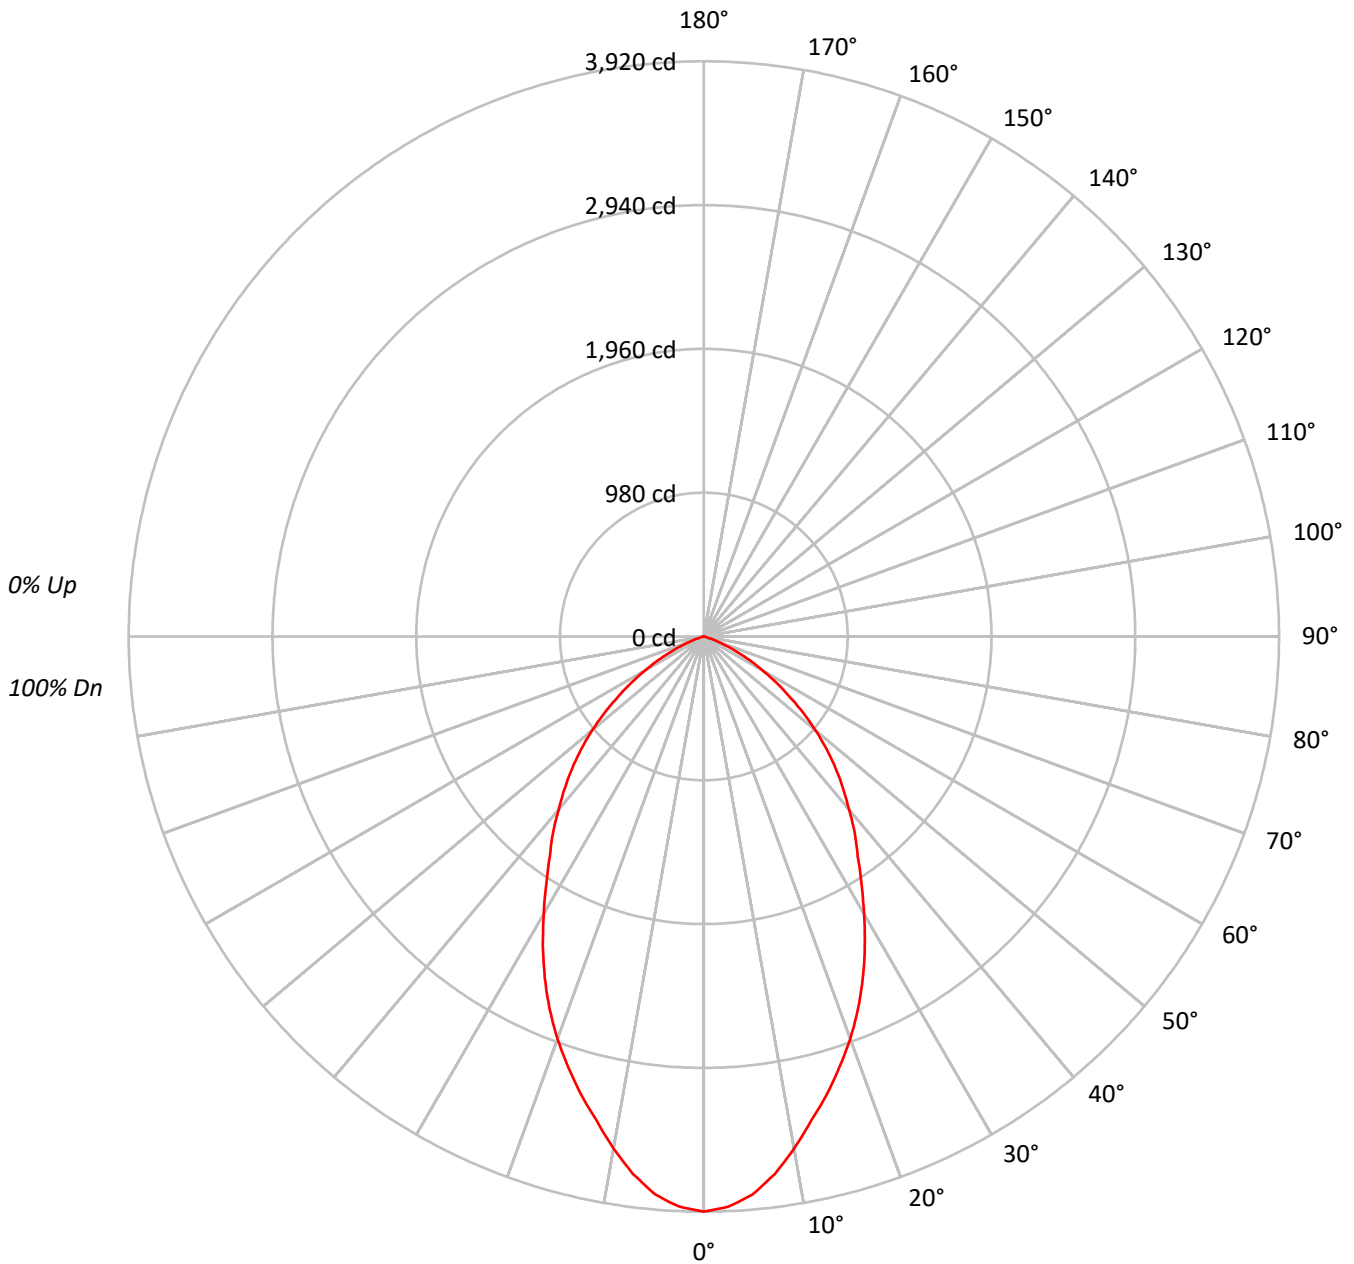



TEST NUMBER: P839322

CATALOG NUMBER: LD4C50D010 EU4509040 4LBSLI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	108	105	102	109	106	103	101	102	100	98	98	96	95	95	93	92	90																			
2	104	98	93	88	102	96	91	87	93	89	85	90	86	84	87	84	82	80																			
3	97	89	82	77	95	87	81	77	84	79	75	82	78	74	79	76	73	71																			
4	90	81	73	68	88	79	73	68	77	71	67	75	70	66	73	69	65	63																			
5	84	73	66	61	82	72	65	60	70	64	60	69	63	59	67	62	59	57																			
6	79	67	60	54	77	66	59	54	65	58	54	63	58	53	62	57	53	51																			
7	74	62	54	49	72	61	54	49	60	53	49	58	53	48	57	52	48	46																			
8	69	57	50	45	68	57	50	45	55	49	45	54	49	44	53	48	44	42																			
9	65	53	46	41	64	53	46	41	52	45	41	51	45	41	50	44	41	39																			
10	61	50	43	38	60	49	42	38	48	42	38	47	42	38	46	41	37	36																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	481586
5°	470686
10°	442010
15°	411222
20°	381389
25°	347668
30°	309522
35°	274352
40°	246591
45°	220703
50°	189329
55°	152309
60°	113492
65°	72441
70°	34914
75°	5791
80°	4245
85°	0



TEST NUMBER: P839322

CATALOG NUMBER: LD4C50D010 EU4509040 4LBSLI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	355.5	6.5
10°-20°	906.5	16.5
20°-30°	1174.7	21.4
30°-40°	1151.0	21.0
40°-50°	975.6	17.8
50°-60°	639.5	11.6
60°-70°	257.1	4.7
70°-80°	29.4	0.5
80°-90°	0.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2436.7	44.4
0°-40°	3587.6	65.3
0°-60°	5202.7	94.8
0°-90°	5490.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5490.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3920	
5°	3817	355
15°	3233	907
25°	2565	1175
35°	1829	1151
45°	1270	976
55°	711	640
65°	249	257
75°	12	29
85°	0	1
90°	0	



TEST NUMBER: P839322

CATALOG NUMBER: LD4C50D010 EU4509040 4LBSLI

CANDELA DISTRIBUTION (FULL):

	0°
0°	3920.0
2.5°	3889.6
5°	3816.7
7.5°	3695.1
10°	3543.2
12.5°	3379.1
15°	3233.2
17.5°	3075.3
20°	2917.2
22.5°	2747.1
25°	2564.8
27.5°	2376.3
30°	2181.9
32.5°	1999.6
35°	1829.3
37.5°	1689.6
40°	1537.6
42.5°	1403.9
45°	1270.3
47.5°	1130.4
50°	990.6
52.5°	850.9
55°	711.1
57.5°	583.4
60°	461.9
62.5°	352.5
65°	249.2
67.5°	164.1
70°	97.2
72.5°	42.5
75°	12.2
77.5°	6.0
80°	6.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180°







(END OF REPORT)