

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P859225

Luminaire Tested: **LX4C60D010 EX4C609035 4LBSLI**

Issue Date: 2/9/2022

Test Information

Test Method: LM-79-08
Report Number: P859225
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208407)
Test Lab: INNOVATION CENTER
Issue Date: 2/9/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LX4C60D010 EX4C609035 4LBSLI
Description: 4 INCH 6000 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 3500K, 90CRI LEDS
AND 4LBS TRIM WITH LI FINISH
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6625.0 lumens
Efficiency: N/A
Efficacy: 92.0 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 1
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 72
Input Voltage (V):
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P859225

CATALOG NUMBER: LX4C60D010 EX4C609035 4LBSLI

Luminous Intensity Polar Plot

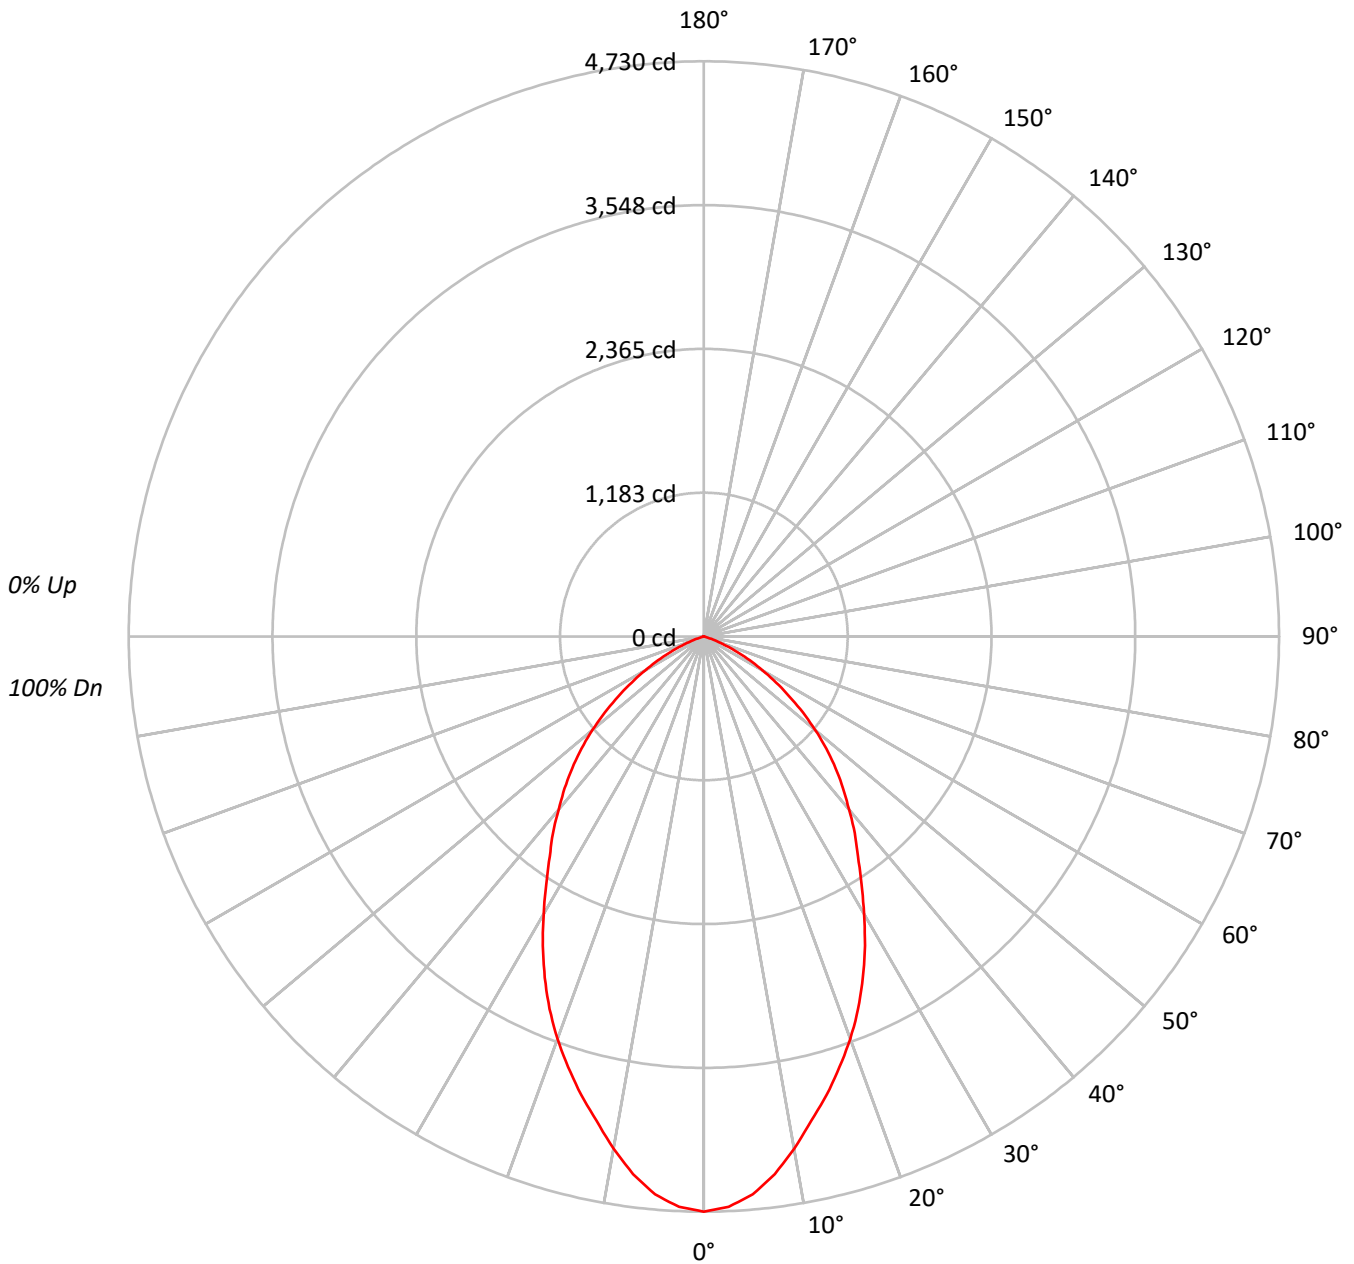



TEST NUMBER: P859225

CATALOG NUMBER: LX4C60D010 EX4C609035 4LBSLI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	108	105	102	109	106	103	101	102	100	98	98	96	95	95	93	92	90																			
2	104	98	93	88	102	96	91	87	93	89	85	90	86	84	87	84	82	80																			
3	97	89	82	77	95	87	81	77	84	79	75	82	78	74	79	76	73	71																			
4	90	81	73	68	88	79	73	68	77	71	67	75	70	66	73	69	65	63																			
5	84	73	66	61	82	72	65	60	70	64	60	69	63	59	67	62	59	57																			
6	79	67	60	54	77	66	59	54	65	58	54	63	58	53	62	57	53	51																			
7	74	62	54	49	72	61	54	49	60	53	49	58	53	48	57	52	48	46																			
8	69	57	50	45	68	57	50	45	55	49	45	54	49	44	53	48	44	42																			
9	65	53	46	41	64	53	46	41	52	45	41	51	45	41	50	44	41	39																			
10	61	50	43	38	60	49	42	38	48	42	38	47	42	38	46	41	37	36																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	581158
5°	567988
10°	533388
15°	496247
20°	460250
25°	419539
30°	373515
35°	331073
40°	297574
45°	266328
50°	228472
55°	183795
60°	136932
65°	87441
70°	42134
75°	6978
80°	5165
85°	0



TEST NUMBER: P859225

CATALOG NUMBER: LX4C60D010 EX4C609035 4LBSLI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	428.9	6.5
10°-20°	1093.9	16.5
20°-30°	1417.5	21.4
30°-40°	1388.9	21.0
40°-50°	1177.3	17.8
50°-60°	771.7	11.6
60°-70°	310.2	4.7
70°-80°	35.5	0.5
80°-90°	1.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2940.4	44.4
0°-40°	4329.4	65.3
0°-60°	6278.4	94.8
0°-90°	6625.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6625.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4730	
5°	4606	429
15°	3902	1094
25°	3095	1418
35°	2208	1389
45°	1533	1177
55°	858	772
65°	301	310
75°	15	35
85°	0	1
90°	0	



TEST NUMBER: P859225

CATALOG NUMBER: LX4C60D010 EX4C609035 4LBSLI

CANDELA DISTRIBUTION (FULL):

	0°
0°	4730.5
2.5°	4693.8
5°	4605.7
7.5°	4459.0
10°	4275.7
12.5°	4077.7
15°	3901.7
17.5°	3711.1
20°	3520.4
22.5°	3315.1
25°	3095.0
27.5°	2867.6
30°	2633.0
32.5°	2413.0
35°	2207.5
37.5°	2038.9
40°	1855.5
42.5°	1694.2
45°	1532.9
47.5°	1364.1
50°	1195.4
52.5°	1026.8
55°	858.1
57.5°	704.1
60°	557.3
62.5°	425.3
65°	300.8
67.5°	198.0
70°	117.3
72.5°	51.3
75°	14.7
77.5°	7.3
80°	7.3
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180°







(END OF REPORT)