

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P#

Luminaire Tested: **LD4C20D010 EX4C209030 4LBSQH**

Issue Date: 2/9/2022

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



**Test Information**

Test Method: LM-79-08  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)  
Test Lab: INNOVATION CENTER  
Issue Date: 2/9/2022  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LD4C20D010 EX4C209030 4LBSQH  
Description: 4 INCH 2000 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 3000K, 90CRI LEDS  
AND 4LBSQ TRIM WITH H FINISH  
Light Source: -  
Ballast/Driver: -

Luminaire Equipment: Sample No.   Condition   Description


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1586.0 lumens  
Efficiency: N/A  
Efficacy: 72.8 lumens/watt  
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93  
Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 21.8  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P#  
CATALOG NUMBER: LD4C20D010 EX4C209030 4LBSQH

### Luminous Intensity Polar Plot

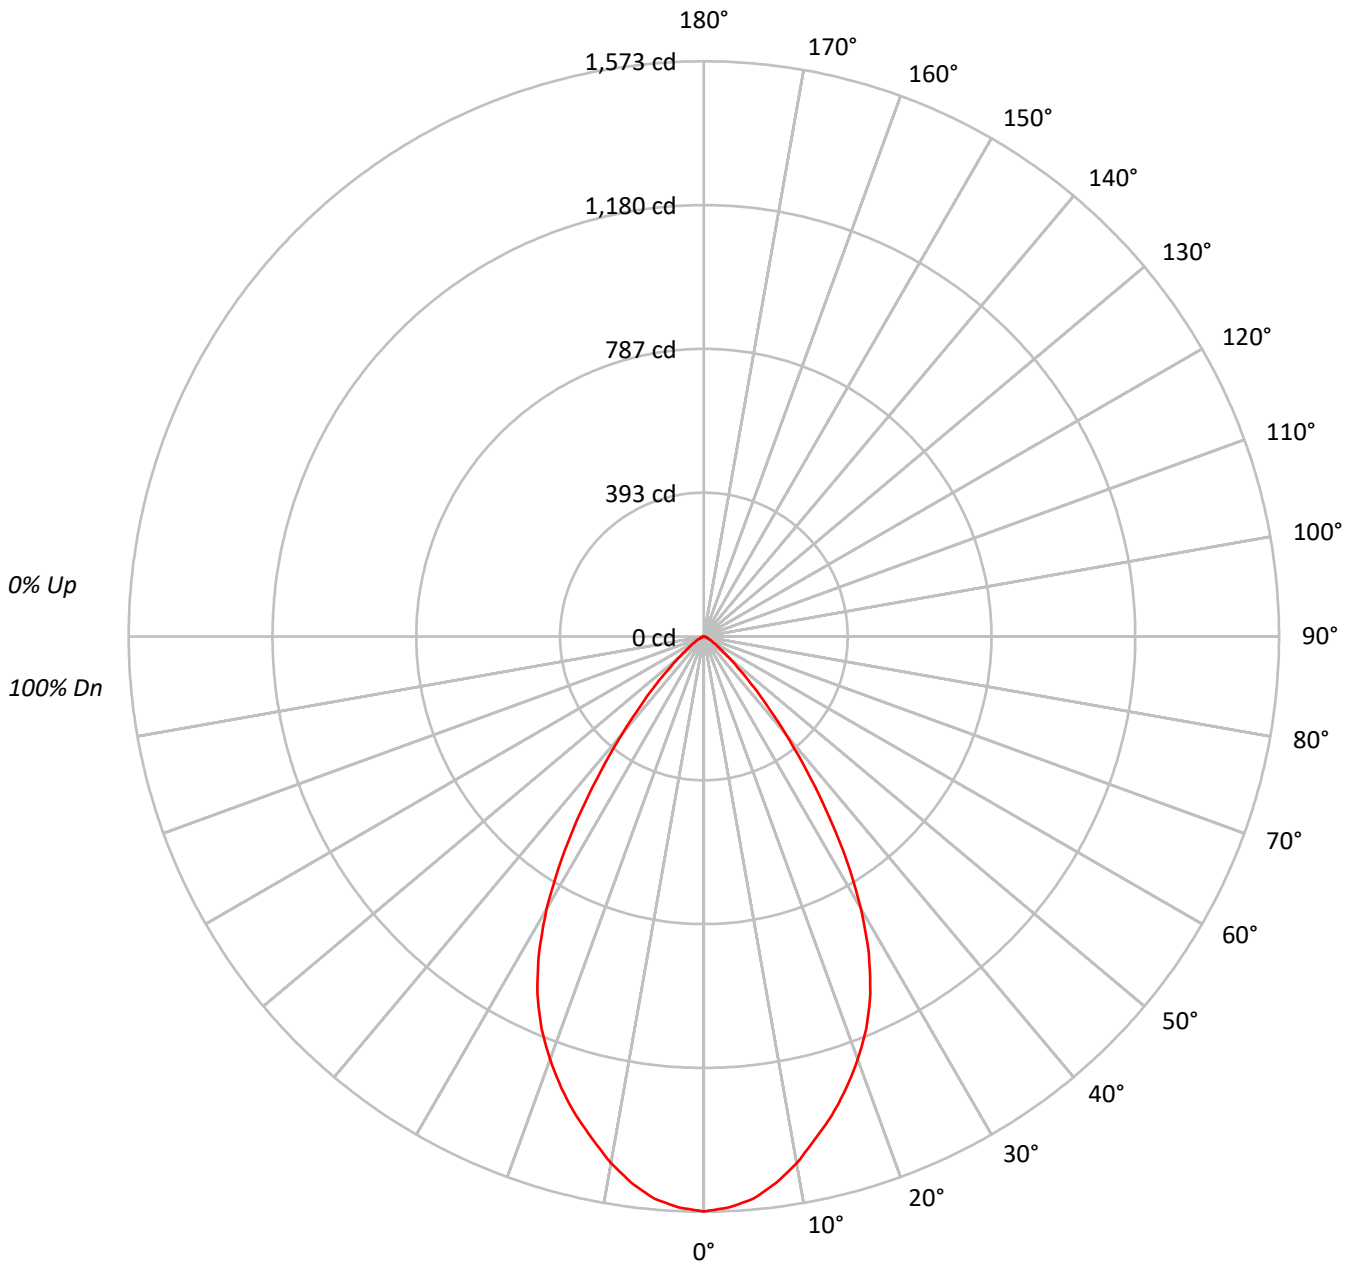



TEST NUMBER: P#

CATALOG NUMBER: LD4C20D010 EX4C209030 4LBSQH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85
3	101	94	89	85	99	93	88	84	90	86	83	88	84	82	86	83	80	79
4	96	88	82	77	94	86	81	77	84	80	76	82	78	75	80	77	74	73
5	90	82	75	71	89	81	75	70	79	74	70	77	73	69	75	72	69	67
6	86	76	70	65	84	75	69	65	74	68	64	72	68	64	71	67	64	62
7	81	71	65	60	80	70	64	60	69	64	60	68	63	59	67	62	59	58
8	77	67	60	56	75	66	60	56	65	59	56	64	59	55	63	58	55	54
9	73	63	56	52	72	62	56	52	61	56	52	60	55	52	59	55	52	50
10	69	59	53	49	68	59	53	49	58	52	49	57	52	48	56	52	48	47

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	151738
5°	149538
10°	143292
15°	135335
20°	126329
25°	114672
30°	95740
35°	69367
40°	43417
45°	24821
50°	12939
55°	7250
60°	4612
65°	2740
70°	2031
75°	895
80°	1334
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LD4C20D010 EX4C209030 4LBSQH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	144.7	9.1
10°-20°	379.6	23.9
20°-30°	487.9	30.8
30°-40°	367.1	23.1
40°-50°	147.4	9.3
50°-60°	41.9	2.6
60°-70°	13.3	0.8
70°-80°	3.8	0.2
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1012.2	63.8
0°-40°	1379.3	87.0
0°-60°	1568.6	98.9
0°-90°	1586.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1586.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1573	
5°	1544	145
15°	1355	380
25°	1077	488
35°	589	367
45°	182	147
55°	43	42
65°	12	13
75°	2	4
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LD4C20D010 EX4C209030 4LBSQH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1572.6
2.5°	1563.0
5°	1543.9
7.5°	1508.0
10°	1462.5
12.5°	1407.5
15°	1354.8
17.5°	1294.9
20°	1230.3
22.5°	1161.0
25°	1077.1
27.5°	976.6
30°	859.3
32.5°	727.6
35°	588.9
37.5°	459.6
40°	344.7
42.5°	253.7
45°	181.9
47.5°	124.5
50°	86.2
52.5°	59.9
55°	43.1
57.5°	31.1
60°	23.9
62.5°	16.8
65°	12.0
67.5°	9.6
70°	7.2
72.5°	4.8
75°	2.4
77.5°	2.4
80°	2.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-50001EG







— 0°-180°







(END OF REPORT)