

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P840316

Luminaire Tested: **LDS4C10D010 EU4109050 4LBPSSQMB**

Issue Date: 8/24/2022

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P840316
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2105-247-18)
Test Lab: INNOVATION CENTER
Issue Date: 8/24/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDS4C10D010 EU4109050 4LBPSSQMB
Description: 4 INCH 1000 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 5000K, 90CRI LEDS
AND 4LBPSSQ TRIM WITH MB FINISH
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 820.0 lumens
Efficiency: N/A
Efficacy: 83.7 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.25
Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 9.8
Input Voltage (V):
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P840316

CATALOG NUMBER: LDS4C10D010 EU4109050 4LBPSSQMB

Luminous Intensity Polar Plot

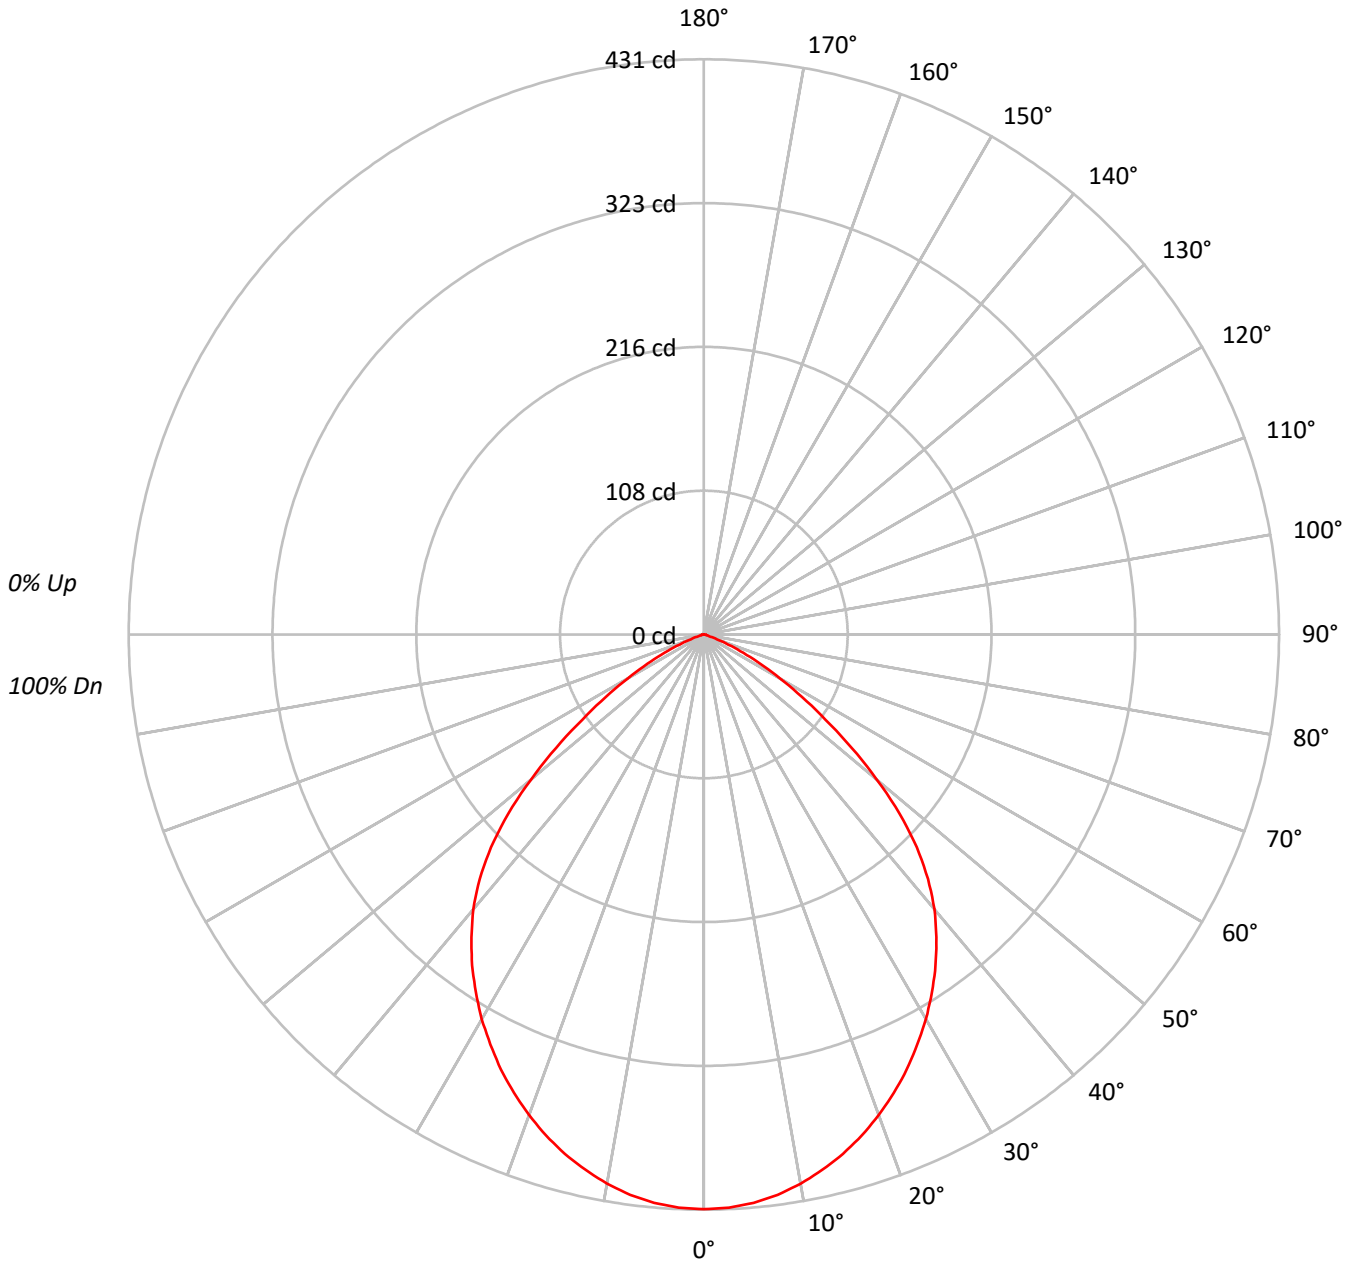



TEST NUMBER: P840316

CATALOG NUMBER: LDS4C10D010 EU4109050 4LBPSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	92	90			
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79			
3	96	88	81	76	94	86	80	75	83	78	74	81	76	73	78	75	72	70			
4	89	79	72	66	87	78	71	66	76	70	65	73	68	64	71	67	63	62			
5	83	72	64	59	81	71	64	58	69	63	58	67	61	57	65	60	57	55			
6	77	66	58	52	75	65	57	52	63	56	52	61	56	51	60	55	51	49			
7	72	60	52	47	70	59	52	47	58	51	46	56	50	46	55	50	46	44			
8	67	55	47	42	66	54	47	42	53	47	42	52	46	42	51	46	41	40			
9	63	51	43	38	62	50	43	38	49	43	38	48	42	38	47	42	38	36			
10	59	47	40	35	58	47	40	35	46	39	35	45	39	35	44	39	35	33			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	41548
5°	41407
10°	40945
15°	40247
20°	39337
25°	38295
30°	37079
35°	35655
40°	33857
45°	30784
50°	25414
55°	18706
60°	12698
65°	7443
70°	2934
75°	671
80°	889
85°	1439



TEST NUMBER: P840316

CATALOG NUMBER: LDS4C10D010 EU4109050 4LBPSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	40.5	4.9
10°-20°	113.4	13.8
20°-30°	165.5	20.2
30°-40°	188.9	23.0
40°-50°	171.7	20.9
50°-60°	101.3	12.3
60°-70°	33.9	4.1
70°-80°	3.6	0.4
80°-90°	1.2	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	319.4	39.0
0°-40°	508.3	62.0
0°-60°	781.2	95.3
0°-90°	820.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	820.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	431	
5°	428	41
15°	403	113
25°	360	165
35°	303	189
45°	226	172
55°	111	101
65°	33	34
75°	2	4
85°	1	1
90°	0	



TEST NUMBER: P840316

CATALOG NUMBER: LDS4C10D010 EU4109050 4LBPSSQMB

CANDELA DISTRIBUTION (FULL):

	0°
0°	430.6
2.5°	429.9
5°	427.5
7.5°	423.5
10°	417.9
12.5°	410.8
15°	402.9
17.5°	393.6
20°	383.1
22.5°	371.8
25°	359.7
27.5°	346.4
30°	332.8
32.5°	318.0
35°	302.7
37.5°	286.1
40°	268.8
42.5°	248.6
45°	225.6
47.5°	199.0
50°	169.3
52.5°	139.6
55°	111.2
57.5°	87.1
60°	65.8
62.5°	47.6
65°	32.6
67.5°	19.9
70°	10.4
72.5°	4.0
75°	1.8
77.5°	1.8
80°	1.6
82.5°	1.3
85°	1.3
87.5°	1.1
90°	0.0



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180°







(END OF REPORT)