

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P170522

Luminaire Tested: **LDA4A18930D010TE LAR25NF 4LAL1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P170522
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26145)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA4A18930D010TE LAR25NF 4LAL1
Description: PORTFOLIO 4" Lensed Adjustable, Self-flange Trim Ring, 25° Narrow Flood Optic, at 0° tilt
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1534.9 lumens
Efficiency: N/A
Efficacy: 52.7 lumens/watt
Spacing Criteria (0/90/45): 0.41 / 0.41 / 0.45
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 29.12
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P170522

CATALOG NUMBER: LDA4A18930D010TE LAR25NF 4LAL1

Luminous Intensity Polar Plot

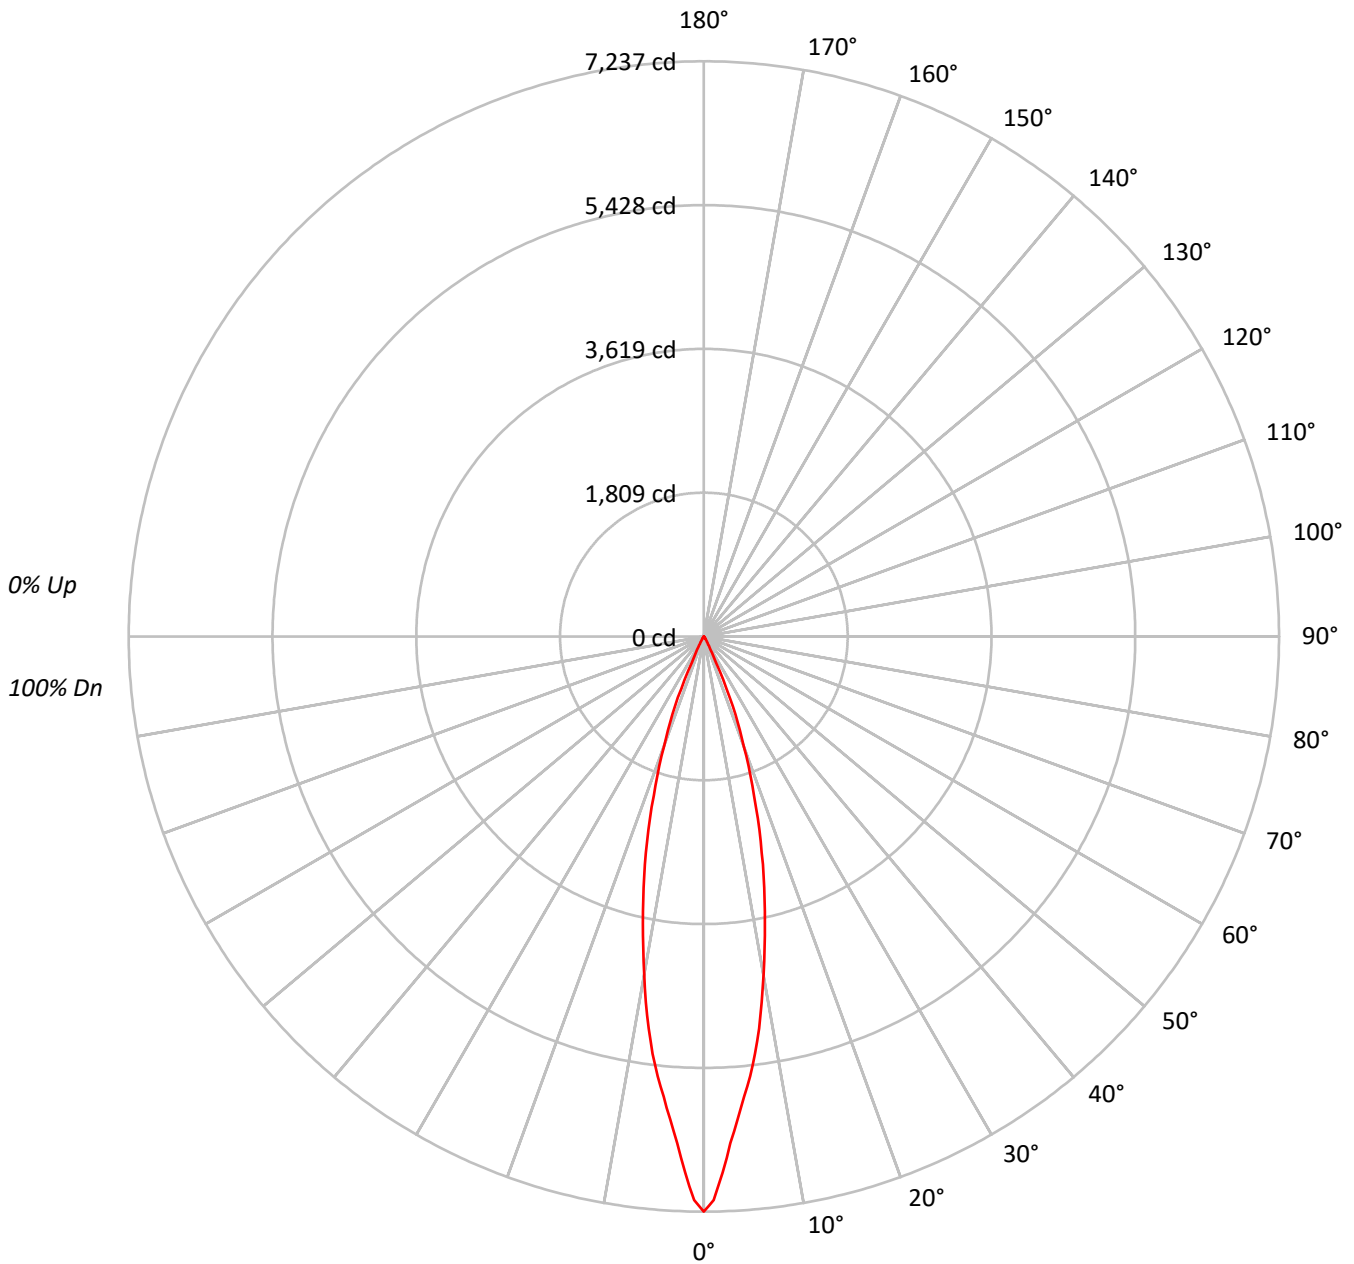



TEST NUMBER: P170522

CATALOG NUMBER: LDA4A18930D010TE LAR25NF 4LAL1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	97	97
2	111	108	105	103	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	94	94
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	94	92	91	91	91	91
4	105	100	96	93	103	98	95	92	97	94	91	95	92	90	93	91	89	88	88	88	88
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	85	85
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	83	83
7	96	90	86	83	95	89	85	83	88	85	82	87	84	82	86	84	82	81	81	81	81
8	94	87	83	80	93	87	83	80	86	82	80	85	82	80	84	81	79	78	78	78	78
9	91	85	81	78	90	84	80	78	83	80	78	83	80	77	82	79	77	76	76	76	76
10	89	82	78	76	88	82	78	76	81	78	76	81	78	75	80	77	75	74	74	74	74

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	892628
5°	719995
10°	541173
15°	359696
20°	192928
25°	48818
30°	11579
35°	3795
40°	1578
45°	715
50°	307
55°	172
60°	197
65°	233
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P170522

CATALOG NUMBER: LDA4A18930D010TE LAR25NF 4LAL1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	511.1	33.3
10°-20°	761.7	49.6
20°-30°	237.9	15.5
30°-40°	19.5	1.3
40°-50°	3.4	0.2
50°-60°	0.8	0.1
60°-70°	0.5	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1510.7	98.4
0°-40°	1530.3	99.7
0°-60°	1534.4	100.0
0°-90°	1534.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1534.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7237	
5°	5815	511
15°	2817	762
25°	359	238
35°	25	20
45°	4	3
55°	1	1
65°	1	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P170522

CATALOG NUMBER: LDA4A18930D010TE LAR25NF 4LAL1

CANDELA DISTRIBUTION (FULL):

	0°
0°	7236.8
1°	7093.7
2°	6748.0
3°	6385.2
4°	6085.9
5°	5815.0
6°	5562.0
7°	5289.6
8°	4980.5
9°	4660.0
10°	4320.8
11°	3996.2
12°	3691.2
13°	3396.8
14°	3105.6
15°	2816.8
17.5°	2100.2
20°	1469.8
22.5°	952.5
25°	358.7
27.5°	143.2
30°	81.3
32.5°	43.1
35°	25.2
37.5°	15.5
40°	9.8
42.5°	5.7
45°	4.1
47.5°	2.4
50°	1.6
52.5°	0.8
55°	0.8
57.5°	0.8
60°	0.8
62.5°	0.8
65°	0.8
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P170522

CATALOG NUMBER: LDA4A18930D010TE LAR25NF 4LAL1

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)