

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P170579

Luminaire Tested: **LDA4A28935D010TE LAR35FL 4LAL1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P170579
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26146)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA4A28935D010TE LAR35FL 4LAL1
Description: PORTFOLIO 4" Lensed Adjustable, Self-flange Trim Ring, 35° Flood Optic, at 0° tilt
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2506.8 lumens
Efficiency: N/A
Efficacy: 56.3 lumens/watt
Spacing Criteria (0/90/45): 0.58 / 0.58 / 0.55
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 44.49
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P170579

CATALOG NUMBER: LDA4A28935D010TE LAR35FL 4LAL1

Luminous Intensity Polar Plot

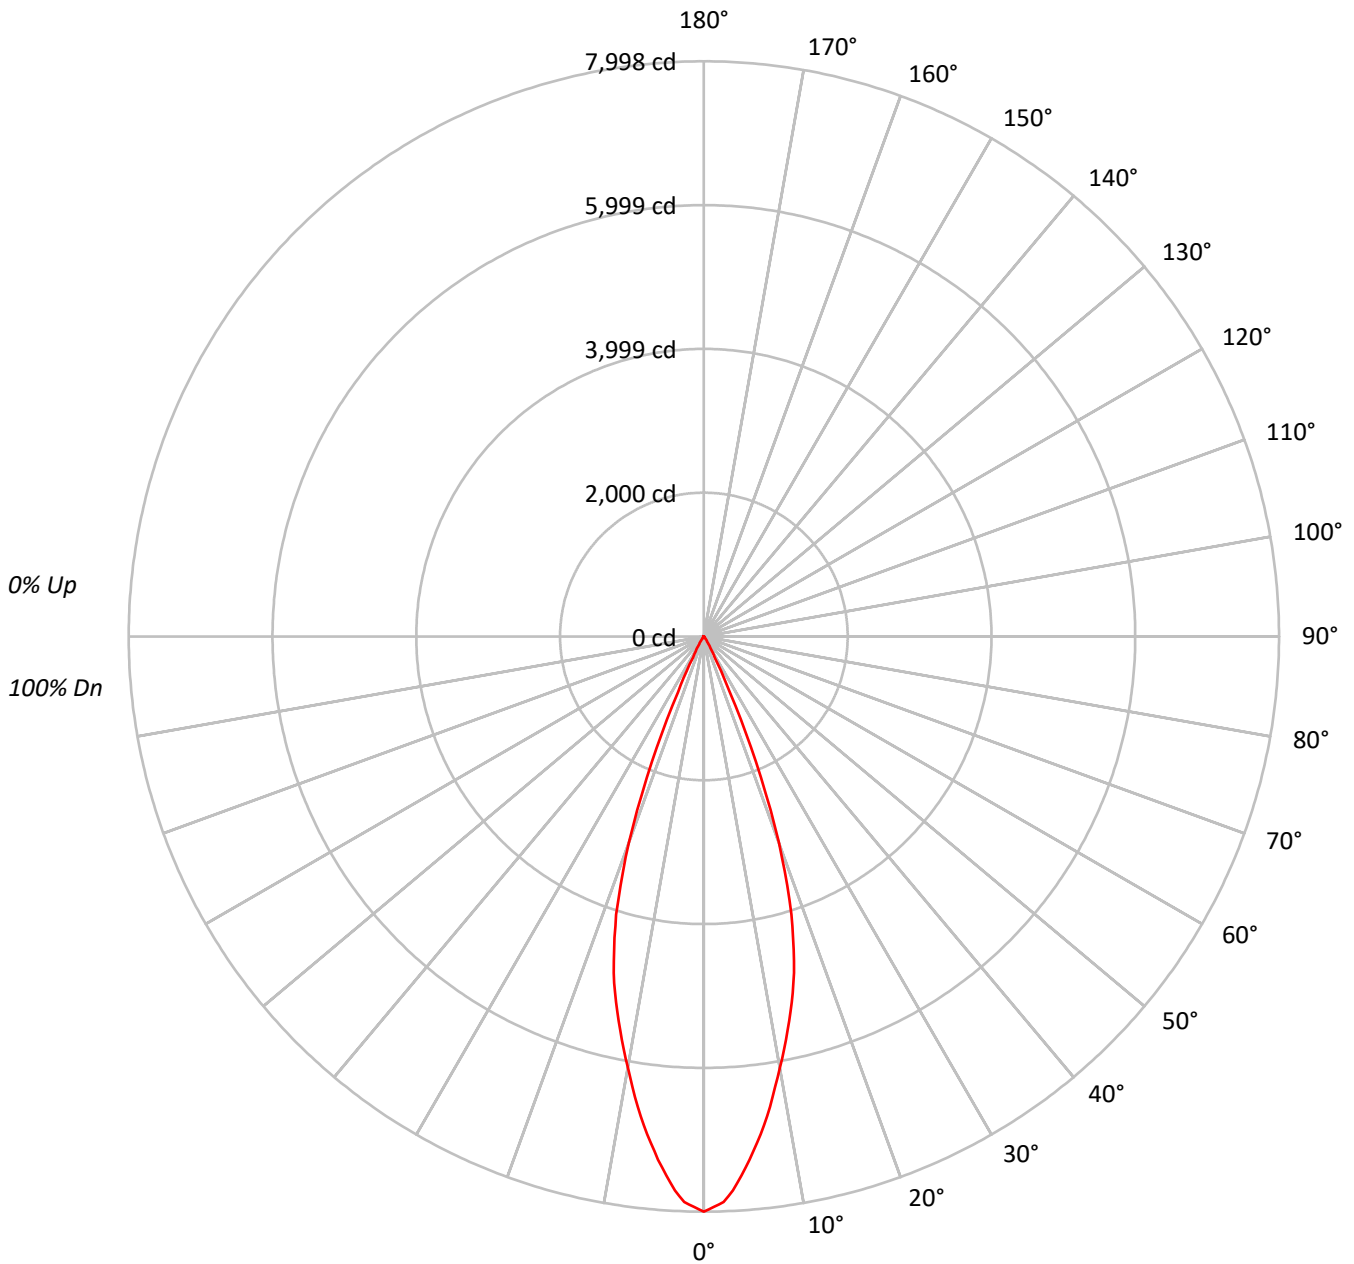



TEST NUMBER: P170579

CATALOG NUMBER: LDA4A28935D010TE LAR35FL 4LAL1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	111	109	113	111	109	107	107	105	104	103	102	101	100	99	98	96	96	96	96
2	111	107	104	102	109	106	103	100	102	100	98	100	98	96	97	96	94	93	93	93	93
3	107	103	99	96	105	101	98	95	99	96	94	96	94	92	94	92	91	90	90	90	90
4	104	98	94	91	102	97	93	91	95	92	90	93	91	89	92	89	88	86	86	86	86
5	101	94	90	87	99	94	90	87	92	89	86	90	88	85	89	87	85	83	83	83	83
6	97	91	87	83	96	90	86	83	89	85	83	88	85	82	86	84	82	81	81	81	81
7	94	88	83	80	93	87	83	80	86	82	80	85	82	79	84	81	79	78	78	78	78
8	92	85	80	77	91	84	80	77	83	80	77	82	79	77	82	79	76	75	75	75	75
9	89	82	78	75	88	82	77	75	81	77	74	80	77	74	79	76	74	73	73	73	73
10	86	79	75	72	86	79	75	72	78	75	72	78	74	72	77	74	72	71	71	71	71

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	986518
5°	904308
10°	762675
15°	618436
20°	400492
25°	115478
30°	25224
35°	7152
40°	2689
45°	1116
50°	499
55°	280
60°	321
65°	379
70°	469
75°	0
80°	0
85°	0



TEST NUMBER: P170579

CATALOG NUMBER: LDA4A28935D010TE LAR35FL 4LAL1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	658.1	26.3
10°-20°	1299.4	51.8
20°-30°	500.5	20.0
30°-40°	39.6	1.6
40°-50°	5.7	0.2
50°-60°	1.3	0.1
60°-70°	1.3	0.1
70°-80°	0.5	0.0
80°-90°	0.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2458.0	98.1
0°-40°	2497.6	99.6
0°-60°	2504.6	99.9
0°-90°	2507.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2506.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7998	
5°	7304	658
15°	4843	1299
25°	848	501
35°	48	40
45°	6	6
55°	1	1
65°	1	1
75°	0	1
85°	0	1
90°	0	



TEST NUMBER: P170579

CATALOG NUMBER: LDA4A28935D010TE LAR35FL 4LAL1

CANDELA DISTRIBUTION (FULL):

	0°
0°	7998.0
1°	7933.9
2°	7868.4
3°	7714.4
4°	7511.6
5°	7303.6
6°	7075.1
7°	6853.1
8°	6607.9
9°	6342.2
10°	6089.3
11°	5848.0
12°	5596.4
13°	5356.4
14°	5111.3
15°	4843.0
17.5°	4054.9
20°	3051.1
22.5°	1885.6
25°	848.5
27.5°	326.0
30°	177.1
32.5°	91.1
35°	47.5
37.5°	28.2
40°	16.7
42.5°	10.3
45°	6.4
47.5°	3.9
50°	2.6
52.5°	1.3
55°	1.3
57.5°	1.3
60°	1.3
62.5°	1.3
65°	1.3
67.5°	1.3
70°	1.3
72.5°	0.0
75°	0.0
77.5°	1.3
80°	0.0
82.5°	0.0



TEST NUMBER: P170579

CATALOG NUMBER: LDA4A28935D010TE LAR35FL 4LAL1

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		1.3



(END OF REPORT)