

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P777055

Luminaire Tested: LERS4D02D010-EC4DR300210IC9024-4LBS1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P777055
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D02D010-EC4DR300210IC9024-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 297.1 lumens
Efficiency: N/A
Efficacy: 58.3 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P777055

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9024-4LBS1MW

Luminous Intensity Polar Plot

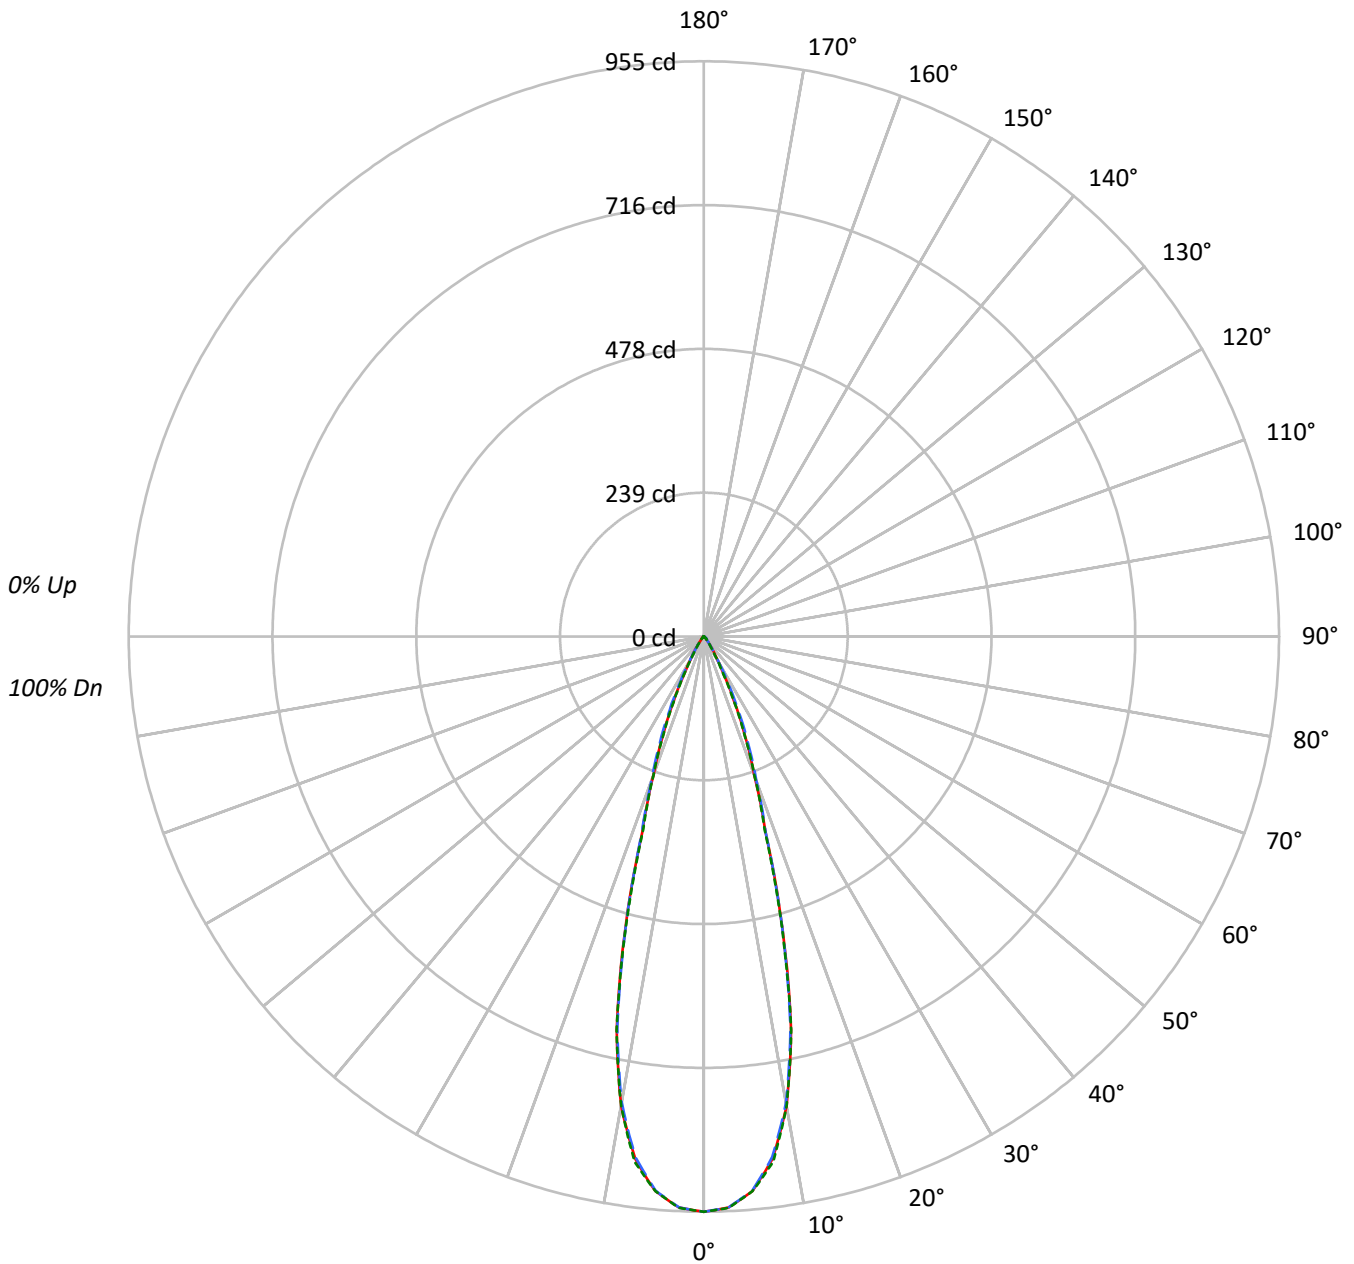



TEST NUMBER: P777055

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9024-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	73122	73122	73122
5°	71019	70942	71027
10°	61519	61083	61495
15°	40137	39923	39717
20°	19957	20706	19932
25°	10059	11334	9848
30°	4022	4384	3509
35°	1869	1785	1495
40°	809	889	759
45°	574	704	574
50°	202	512	202
55°	120	214	120
60°	77	92	77
65°	54	54	54
70°	22	22	22
75°	0	30	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 704 cd/sqm



TEST NUMBER: P777055

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9024-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	84.0	28.3
10°-20°	135.3	45.5
20°-30°	58.5	19.7
30°-40°	13.3	4.5
40°-50°	4.6	1.5
50°-60°	1.1	0.4
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	277.7	93.5
0°-40°	291.1	98.0
0°-60°	296.8	99.9
0°-90°	297.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	297.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	955	955	955	955	955	
5°	924	923	923	925	924	84
15°	506	500	504	502	501	136
25°	119	124	134	120	117	57
35°	20	20	19	19	16	14
45°	5	6	6	6	5	4
55°	1	1	2	1	1	1
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P777055

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9024-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	955.3	955.3	955.3	955.3	955.3
2.5°	949.0	948.3	948.7	949.2	949.3
5°	924.3	923.4	923.3	925.2	924.4
7.5°	874.7	873.4	871.5	875.8	879.9
10°	791.5	790.0	785.9	787.9	791.2
12.5°	668.6	664.0	664.0	670.5	669.7
15°	506.5	500.4	503.8	502.1	501.2
17.5°	340.6	338.3	342.7	341.4	335.5
20°	245.0	245.6	254.2	249.9	244.7
22.5°	178.8	181.0	191.2	180.1	176.0
25°	119.1	123.5	134.2	120.4	116.6
27.5°	73.2	75.3	86.1	72.2	70.2
30°	45.5	44.5	49.6	42.6	39.7
32.5°	29.9	28.6	30.2	27.1	24.8
35°	20.0	20.4	19.1	19.0	16.0
37.5°	12.5	14.3	12.7	13.5	10.3
40°	8.1	10.4	8.9	9.9	7.6
42.5°	6.6	8.0	7.4	7.8	6.8
45°	5.3	6.5	6.5	6.5	5.3
47.5°	2.9	4.4	5.6	4.5	3.1
50°	1.7	2.2	4.3	2.3	1.7
52.5°	1.1	1.3	3.0	1.3	1.1
55°	0.9	0.9	1.6	0.9	0.9
57.5°	0.6	0.7	0.9	0.7	0.6
60°	0.5	0.5	0.6	0.6	0.5
62.5°	0.4	0.4	0.4	0.4	0.4
65°	0.3	0.3	0.3	0.3	0.3
67.5°	0.1	0.2	0.2	0.2	0.2
70°	0.1	0.1	0.1	0.1	0.1
72.5°	0.1	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)