

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P777060

Luminaire Tested: LERS4D02D010-EC4DR300210IC9030-4LBS1B

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P777060  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LERS4D02D010-EC4DR300210IC9030-4LBS1B  
Description: 4 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 30° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 335.9 lumens  
Efficiency: N/A  
Efficacy: 65.9 lumens/watt  
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49  
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')  
CIE Type: Direct

Input Watts (W): 5.1  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P777060

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9030-4LBS1B

### Luminous Intensity Polar Plot

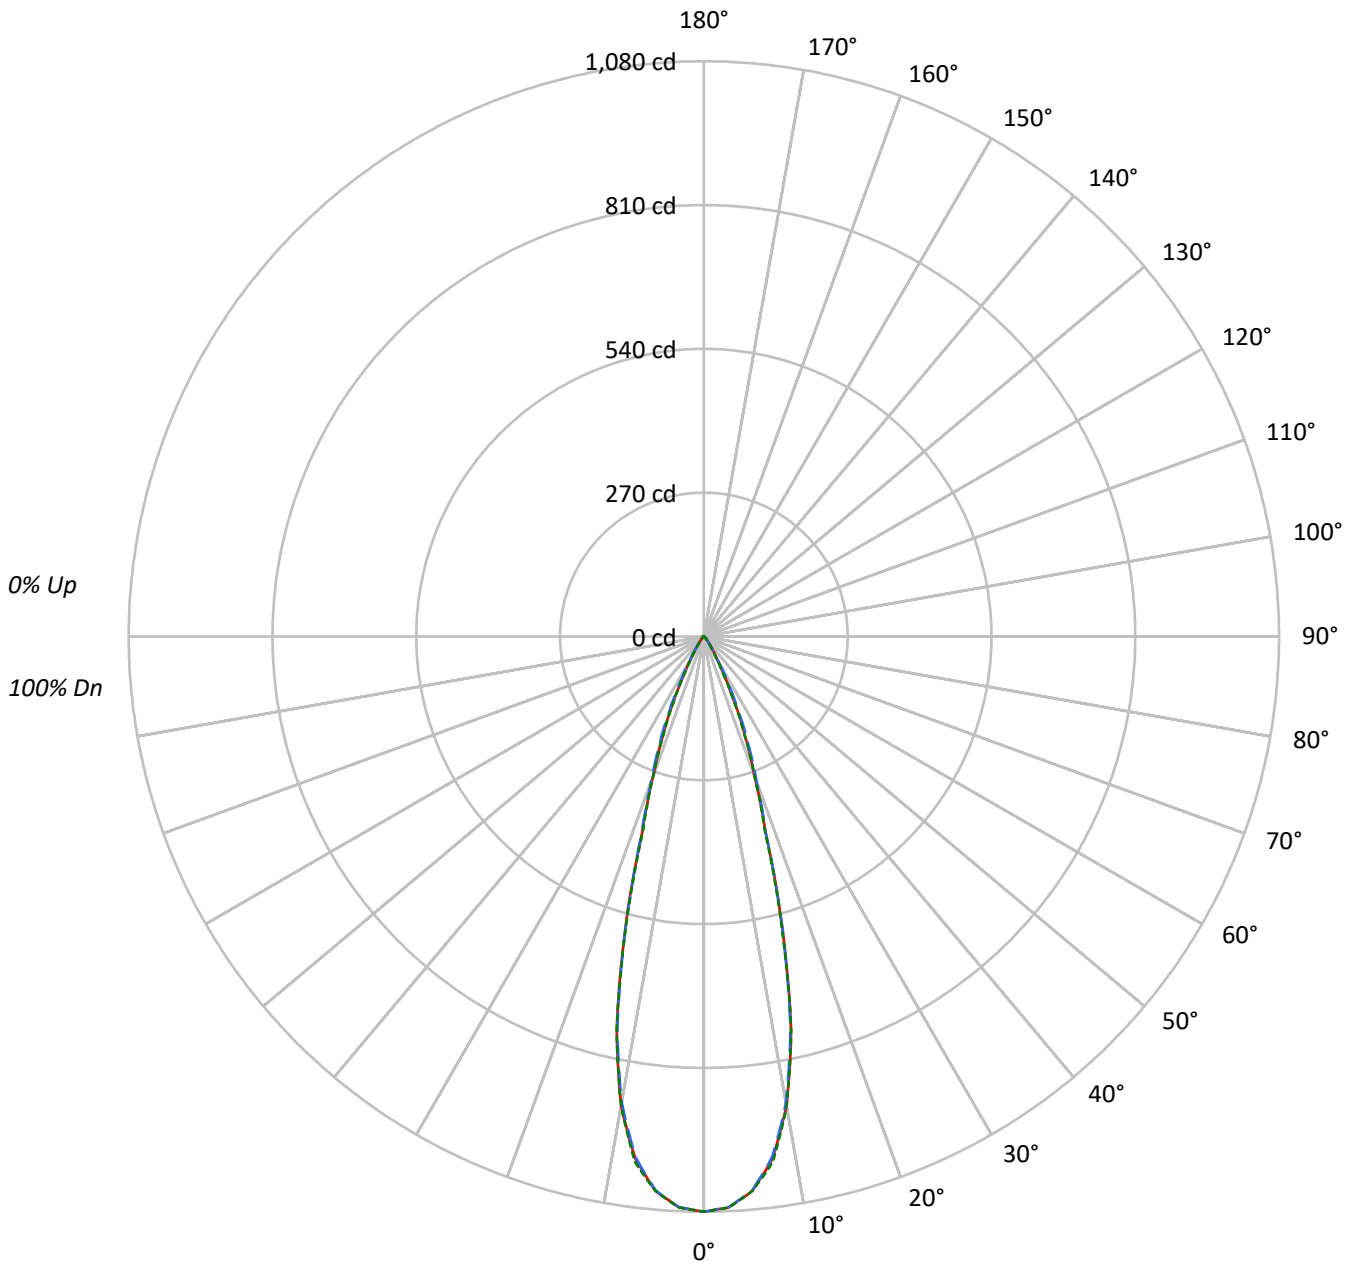



TEST NUMBER: P777060

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9030-4LBS1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	82667	82667	82667
5°	80293	80201	80301
10°	69548	69058	69532
15°	45375	45137	44907
20°	22563	23410	22531
25°	11368	12820	11131
30°	4552	4958	3968
35°	2112	2028	1701
40°	909	1009	859
45°	649	801	649
50°	214	583	226
55°	133	240	133
60°	92	107	92
65°	54	54	54
70°	45	22	45
75°	0	30	0
80°	0	0	0
85°	0	0	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 801 cd/sqm



TEST NUMBER: P777060

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9030-4LBS1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	95.0	28.3
10°-20°	153.0	45.5
20°-30°	66.1	19.7
30°-40°	15.1	4.5
40°-50°	5.2	1.5
50°-60°	1.3	0.4
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	314.0	93.5
0°-40°	329.1	98.0
0°-60°	335.5	99.9
0°-90°	335.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	335.9	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1080	1080	1080	1080	1080	
5°	1045	1044	1044	1046	1045	95
15°	573	566	570	568	567	153
25°	135	140	152	136	132	64
35°	23	23	22	22	18	15
45°	6	7	7	7	6	4
55°	1	1	2	1	1	1
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P777060

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9030-4LBS1B

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	1080.0	1080.0	1080.0	1080.0	1080.0
2.5°	1072.9	1072.1	1072.6	1073.1	1073.3
5°	1045.0	1044.0	1043.8	1046.0	1045.1
7.5°	988.9	987.4	985.2	990.2	994.8
10°	894.8	893.2	888.5	890.8	894.6
12.5°	756.0	750.8	750.7	758.1	757.1
15°	572.6	565.7	569.6	567.7	566.7
17.5°	385.1	382.4	387.5	386.0	379.4
20°	277.0	277.7	287.4	282.5	276.6
22.5°	202.1	204.6	216.1	203.6	198.9
25°	134.6	139.7	151.8	136.1	131.8
27.5°	82.8	85.1	97.3	81.7	79.4
30°	51.5	50.3	56.1	48.1	44.9
32.5°	33.8	32.3	34.1	30.7	28.0
35°	22.6	23.1	21.7	21.5	18.2
37.5°	14.1	16.2	14.3	15.3	11.7
40°	9.1	11.7	10.1	11.2	8.6
42.5°	7.4	9.1	8.3	8.9	7.6
45°	6.0	7.4	7.4	7.4	6.0
47.5°	3.3	4.9	6.3	5.0	3.5
50°	1.8	2.5	4.9	2.6	1.9
52.5°	1.3	1.4	3.3	1.5	1.3
55°	1.0	1.0	1.8	1.1	1.0
57.5°	0.7	0.8	1.0	0.8	0.7
60°	0.6	0.6	0.7	0.6	0.6
62.5°	0.4	0.4	0.5	0.4	0.4
65°	0.3	0.3	0.3	0.3	0.3
67.5°	0.2	0.2	0.2	0.2	0.2
70°	0.2	0.1	0.1	0.1	0.2
72.5°	0.1	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)