

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P777073

Luminaire Tested: LERS4D02D010-EC4DR300210IC9050-4LBS1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P777073
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D02D010-EC4DR300210IC9050-4LBS1H
Description: 4 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 384.1 lumens
Efficiency: N/A
Efficacy: 75.3 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P777073

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9050-4LBS1H

Luminous Intensity Polar Plot

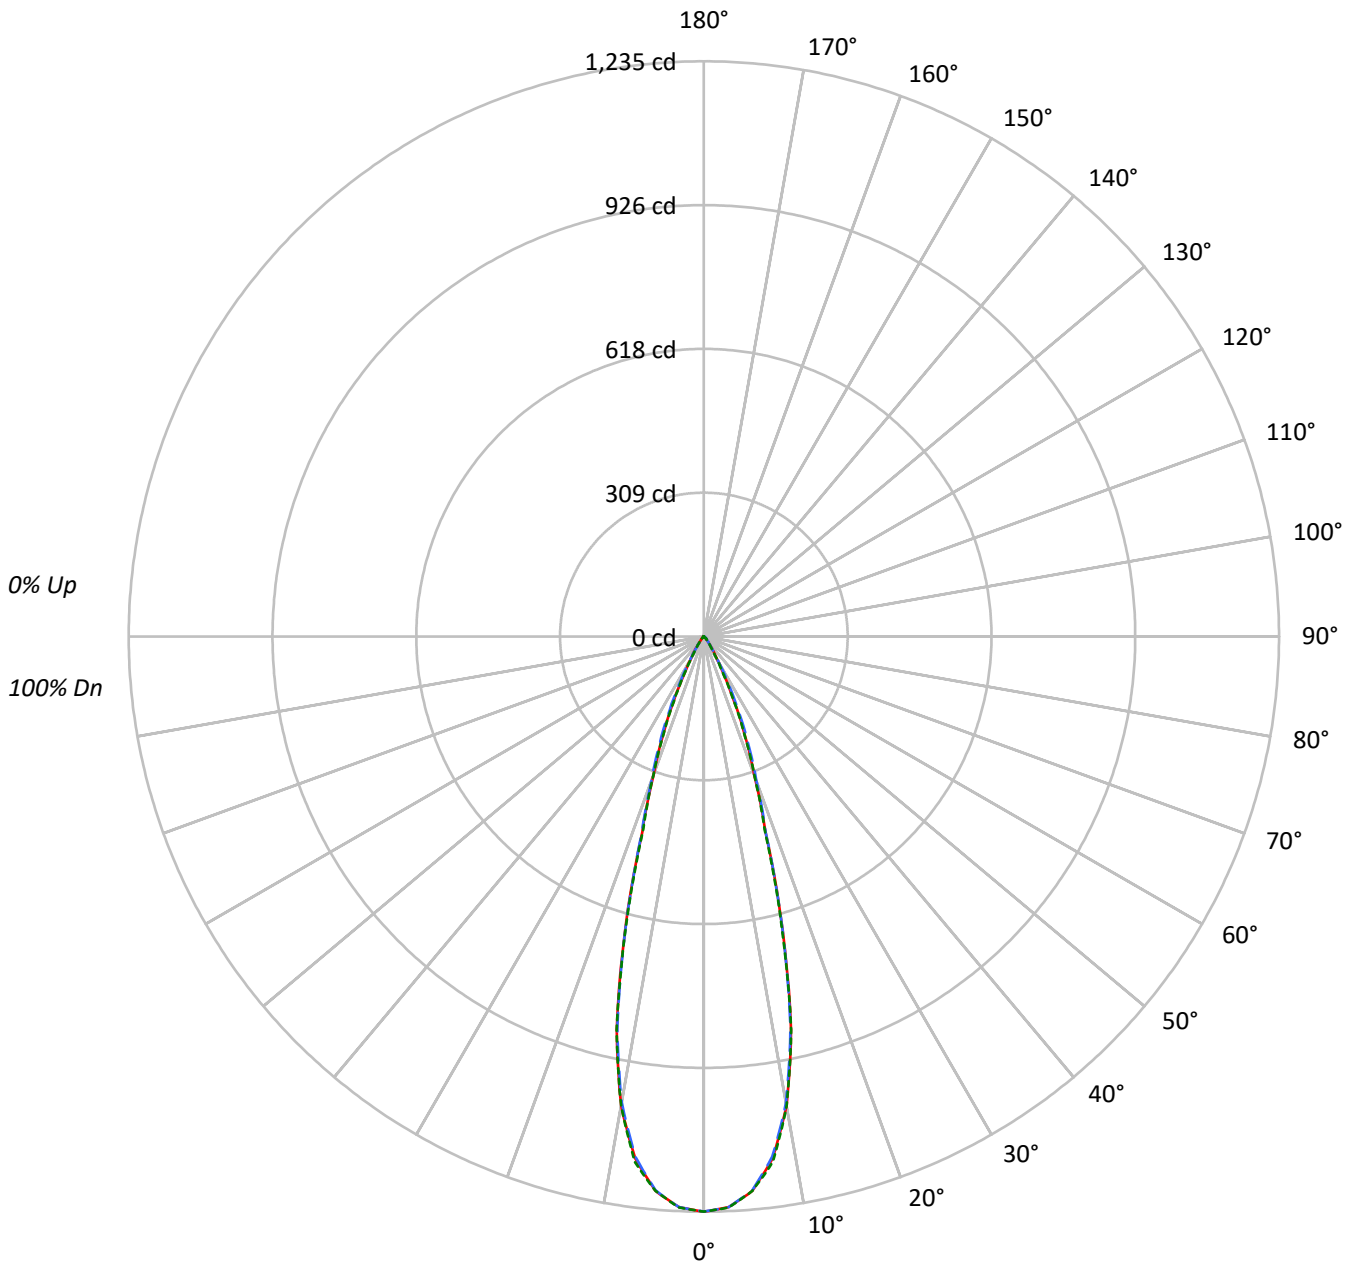



TEST NUMBER: P777073

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9050-4LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	94523	94523	94523
5°	91811	91704	91819
10°	79527	78968	79504
15°	51889	51611	51350
20°	25797	26766	25764
25°	12998	14653	12728
30°	5206	5674	4534
35°	2411	2317	1934
40°	1039	1159	979
45°	736	909	747
50°	250	667	262
55°	147	280	147
60°	107	122	107
65°	54	54	54
70°	45	22	45
75°	0	30	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 909 cd/sqm



TEST NUMBER: P777073

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9050-4LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	108.6	28.3
10°-20°	174.9	45.5
20°-30°	75.6	19.7
30°-40°	17.2	4.5
40°-50°	5.9	1.5
50°-60°	1.4	0.4
60°-70°	0.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	359.1	93.5
0°-40°	376.3	98.0
0°-60°	383.7	99.9
0°-90°	384.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	384.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1235	1235	1235	1235	1235	
5°	1195	1194	1194	1196	1195	109
15°	655	647	651	649	648	175
25°	154	160	174	156	151	74
35°	26	26	25	25	21	18
45°	7	8	8	8	7	5
55°	1	1	2	1	1	1
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P777073

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9050-4LBS1H

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1234.9	1234.9	1234.9	1234.9	1234.9
2.5°	1226.7	1225.9	1226.4	1227.0	1227.3
5°	1194.9	1193.8	1193.5	1196.0	1195.0
7.5°	1130.7	1129.1	1126.6	1132.3	1137.5
10°	1023.2	1021.3	1016.0	1018.6	1022.9
12.5°	864.4	858.5	858.4	866.9	865.7
15°	654.8	646.9	651.3	649.2	648.0
17.5°	440.3	437.3	443.1	441.3	433.8
20°	316.7	317.5	328.6	323.0	316.3
22.5°	231.1	234.0	247.1	232.8	227.5
25°	153.9	159.7	173.5	155.7	150.7
27.5°	94.7	97.3	111.3	93.4	90.8
30°	58.9	57.5	64.2	55.1	51.3
32.5°	38.6	36.9	39.1	35.1	32.0
35°	25.8	26.4	24.8	24.6	20.7
37.5°	16.1	18.6	16.4	17.5	13.3
40°	10.4	13.5	11.6	12.8	9.8
42.5°	8.5	10.4	9.5	10.1	8.7
45°	6.8	8.4	8.4	8.4	6.9
47.5°	3.8	5.6	7.2	5.8	4.0
50°	2.1	2.9	5.6	3.0	2.2
52.5°	1.4	1.7	3.8	1.7	1.5
55°	1.1	1.1	2.1	1.2	1.1
57.5°	0.9	0.9	1.1	0.9	0.9
60°	0.7	0.7	0.8	0.7	0.7
62.5°	0.5	0.5	0.6	0.5	0.5
65°	0.3	0.3	0.3	0.3	0.3
67.5°	0.2	0.2	0.2	0.2	0.2
70°	0.2	0.1	0.1	0.1	0.2
72.5°	0.1	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)