

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P777075

Luminaire Tested: LERS4D02D010-EC4DR300210IC9050-4LBS1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P777075
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D02D010-EC4DR300210IC9050-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 365.1 lumens
Efficiency: N/A
Efficacy: 71.6 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P777075

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9050-4LBS1MW

Luminous Intensity Polar Plot

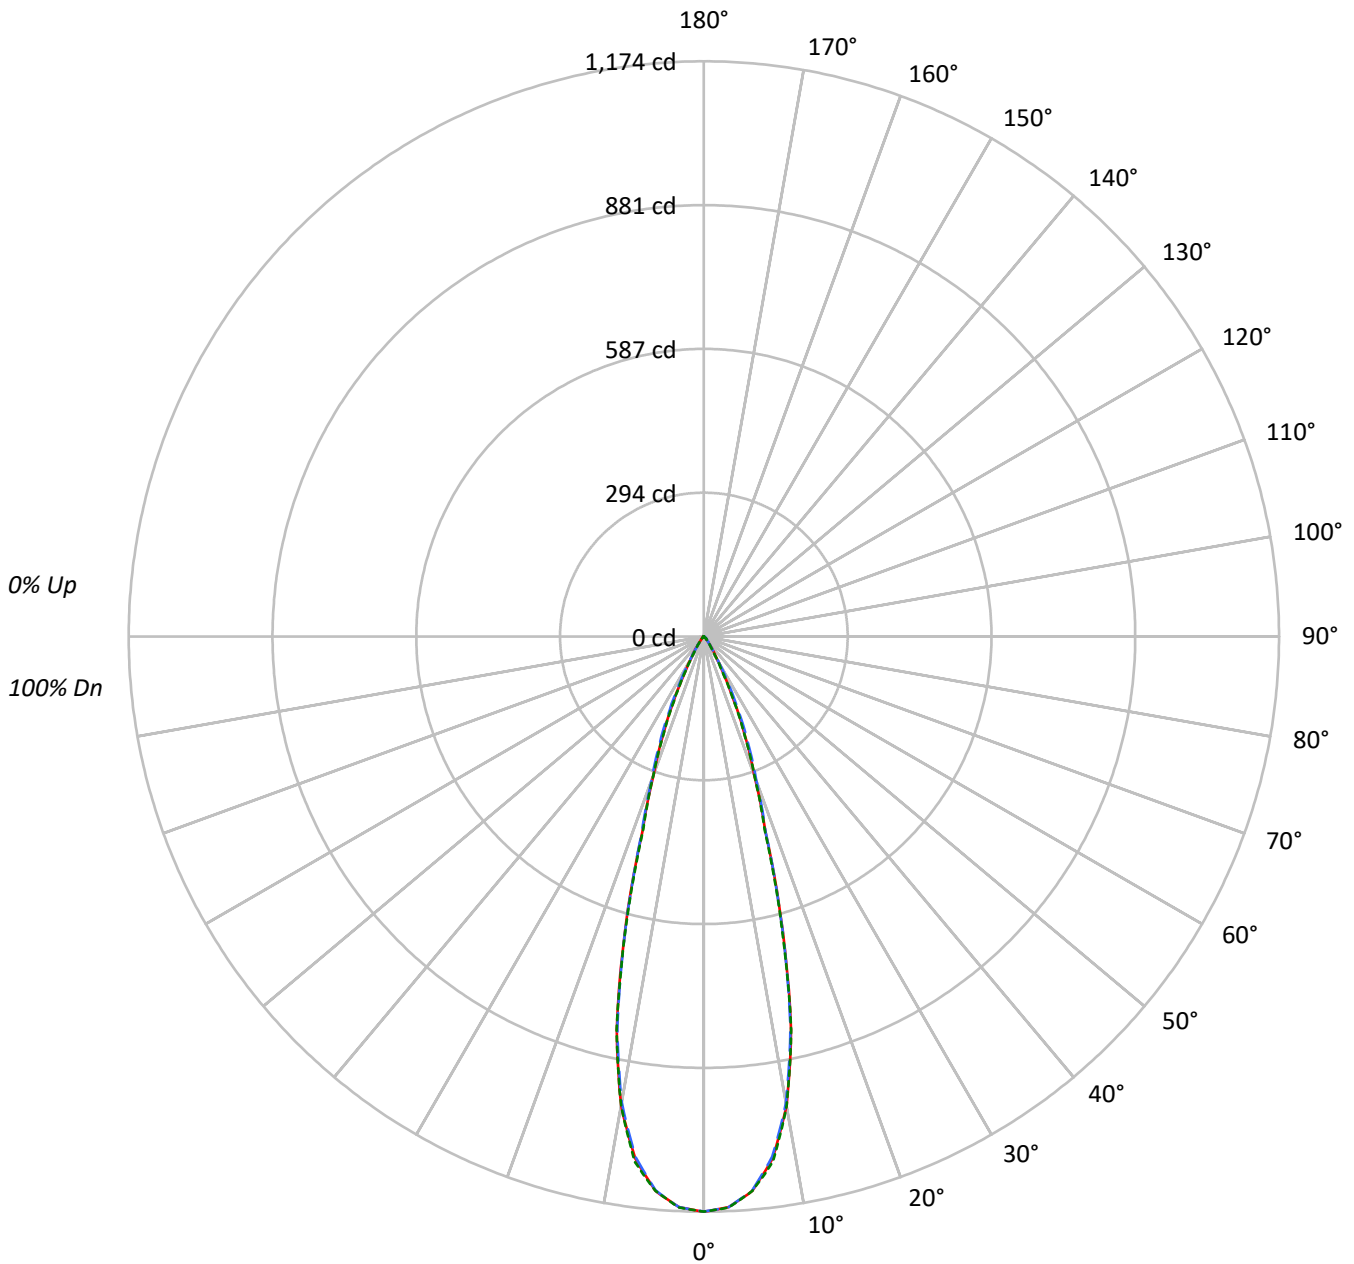



TEST NUMBER: P777075

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9050-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	87	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	89854	89854	89854
5°	87278	87170	87278
10°	75595	75058	75579
15°	49321	49060	48806
20°	24526	25447	24494
25°	12356	13935	12103
30°	4950	5391	4313
35°	2299	2196	1841
40°	989	1099	929
45°	704	866	704
50°	238	631	250
55°	133	254	147
60°	92	107	92
65°	54	54	54
70°	45	22	45
75°	0	30	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 866 cd/sqm



TEST NUMBER: P777075

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9050-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	103.2	28.3
10°-20°	166.2	45.5
20°-30°	71.8	19.7
30°-40°	16.4	4.5
40°-50°	5.6	1.5
50°-60°	1.4	0.4
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	341.3	93.5
0°-40°	357.7	98.0
0°-60°	364.7	99.9
0°-90°	365.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	365.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1174	1174	1174	1174	1174	
5°	1136	1135	1134	1137	1136	103
15°	622	615	619	617	616	167
25°	146	152	165	148	143	70
35°	25	25	24	23	20	17
45°	6	8	8	8	6	5
55°	1	1	2	1	1	1
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P777075

CATALOG NUMBER: LERS4D02D010-EC4DR300210IC9050-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1173.9	1173.9	1173.9	1173.9	1173.9
2.5°	1166.1	1165.3	1165.8	1166.4	1166.6
5°	1135.9	1134.7	1134.5	1136.9	1135.9
7.5°	1074.8	1073.3	1070.9	1076.2	1081.3
10°	972.6	970.9	965.7	968.2	972.4
12.5°	821.6	816.1	815.9	824.0	822.9
15°	622.4	614.9	619.1	617.0	615.9
17.5°	418.5	415.7	421.2	419.5	412.3
20°	301.1	301.8	312.4	307.1	300.7
22.5°	219.7	222.4	234.9	221.3	216.2
25°	146.3	151.8	165.0	147.9	143.3
27.5°	90.0	92.5	105.8	88.8	86.3
30°	56.0	54.7	61.0	52.3	48.8
32.5°	36.7	35.1	37.1	33.3	30.4
35°	24.6	25.1	23.5	23.3	19.7
37.5°	15.4	17.6	15.6	16.6	12.7
40°	9.9	12.8	11.0	12.1	9.3
42.5°	8.1	9.9	9.1	9.6	8.3
45°	6.5	8.0	8.0	8.0	6.5
47.5°	3.6	5.4	6.9	5.5	3.8
50°	2.0	2.7	5.3	2.8	2.1
52.5°	1.4	1.5	3.6	1.6	1.4
55°	1.0	1.1	1.9	1.1	1.1
57.5°	0.8	0.9	1.0	0.9	0.8
60°	0.6	0.6	0.7	0.7	0.6
62.5°	0.5	0.5	0.5	0.5	0.5
65°	0.3	0.3	0.3	0.3	0.3
67.5°	0.2	0.2	0.2	0.2	0.2
70°	0.2	0.1	0.1	0.1	0.2
72.5°	0.1	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)