

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P777146

Luminaire Tested: LERS4D02D010-EC4DR450210IC9050-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P777146
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D02D010-EC4DR450210IC9050-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 423.0 lumens
Efficiency: N/A
Efficacy: 82.9 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P777146

CATALOG NUMBER: LERS4D02D010-EC4DR450210IC9050-4LBS1LI

Luminous Intensity Polar Plot

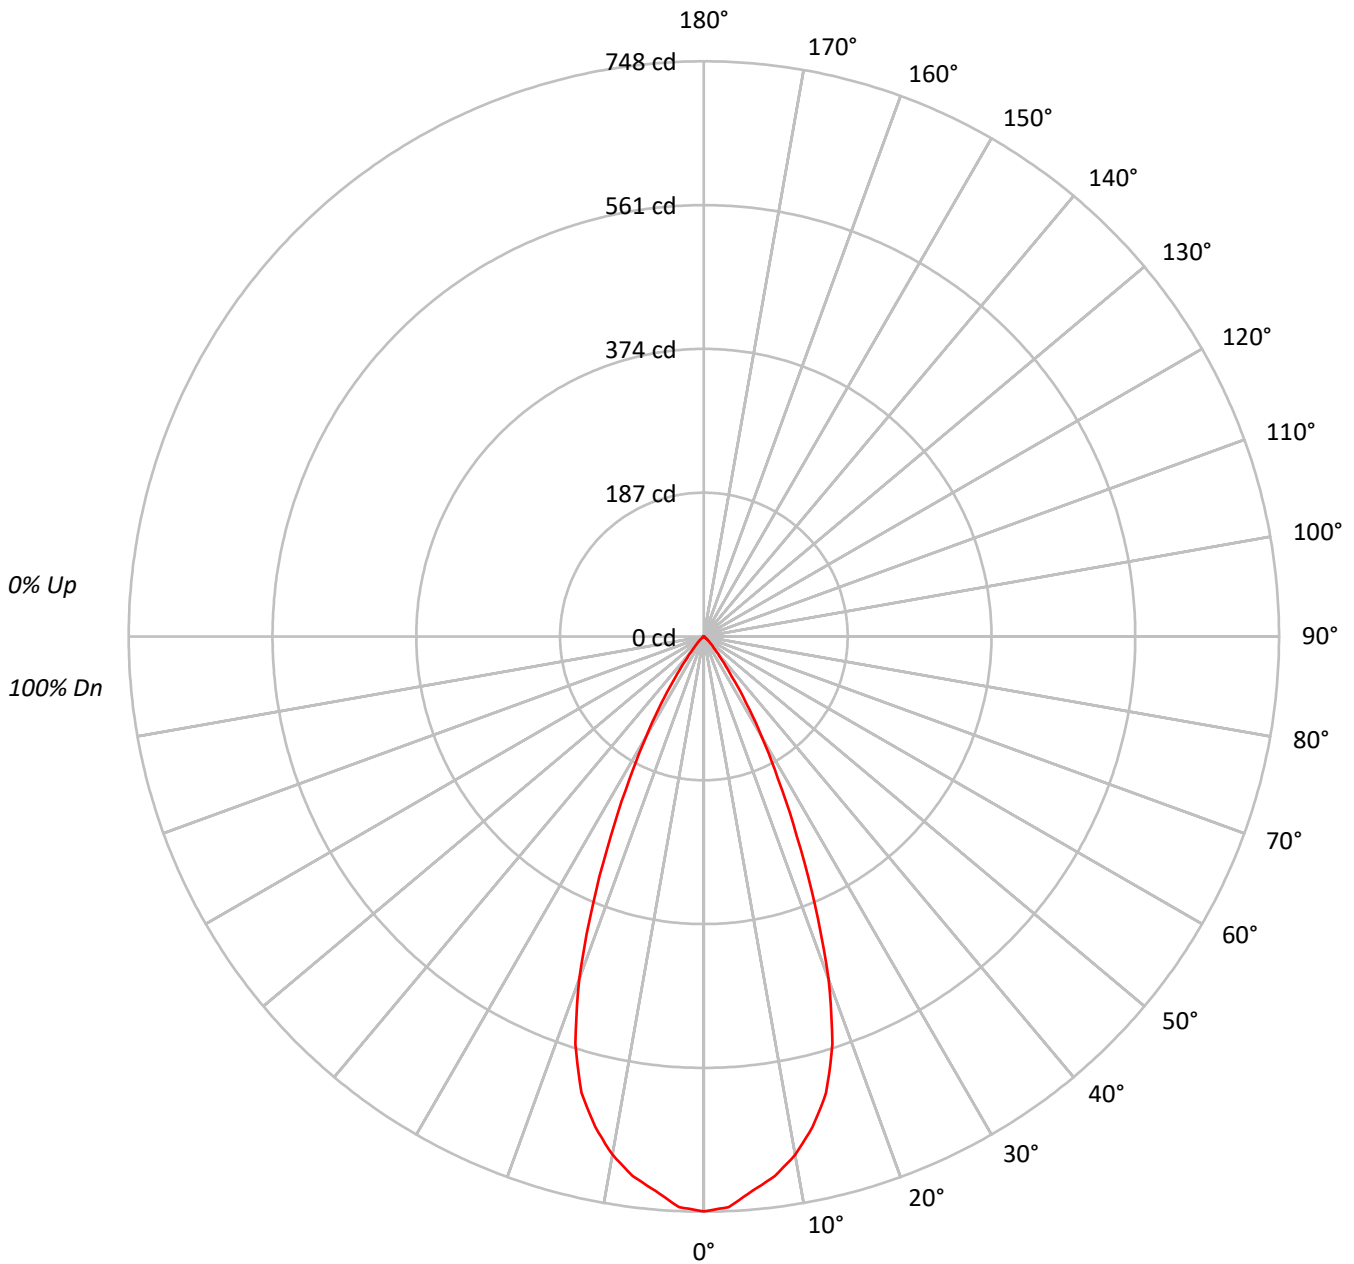



TEST NUMBER: P777146

CATALOG NUMBER: LERS4D02D010-EC4DR450210IC9050-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95					95			
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90					90			
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85					85			
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81					81			
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77					77			
6	92	85	79	76	91	84	79	76	82	78	75	81	77	75	80	77	74	73					73			
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	70	69					69			
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66					66			
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63					63			
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60					60			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	81683
5°	79352
10°	75921
15°	69487
20°	55125
25°	34419
30°	18962
35°	8523
40°	3352
45°	1592
50°	748
55°	400
60°	197
65°	52
70°	32
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1592 cd/sqm



TEST NUMBER: P777146

CATALOG NUMBER: LERS4D02D010-EC4DR450210IC9050-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	68.0	16.1
10°-20°	167.3	39.6
20°-30°	132.5	31.3
30°-40°	44.1	10.4
40°-50°	8.8	2.1
50°-60°	2.0	0.5
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	367.8	86.9
0°-40°	411.9	97.4
0°-60°	422.7	99.9
0°-90°	423.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	423.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	748	
5°	724	68
15°	614	167
25°	286	132
35°	64	44
45°	10	9
55°	2	2
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P777146

CATALOG NUMBER: LERS4D02D010-EC4DR450210IC9050-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	747.6
2.5°	742.7
5°	723.5
7.5°	707.7
10°	684.3
12.5°	653.2
15°	614.3
17.5°	555.8
20°	474.1
22.5°	376.7
25°	285.5
27.5°	209.0
30°	150.3
32.5°	102.3
35°	63.9
37.5°	37.9
40°	23.5
42.5°	15.5
45°	10.3
47.5°	6.6
50°	4.4
52.5°	2.9
55°	2.1
57.5°	1.4
60°	0.9
62.5°	0.5
65°	0.2
67.5°	0.1
70°	0.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)