

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P777626

Luminaire Tested: LERS4D08D010-EC4DR150210IC9050-4LBS1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P777626  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LERS4D08D010-EC4DR150210IC9050-4LBS1LI  
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 15° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 894.5 lumens  
Efficiency: N/A  
Efficacy: 100.5 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23  
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')  
CIE Type: Direct

Input Watts (W): 8.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P777626

CATALOG NUMBER: LERS4D08D010-EC4DR150210IC9050-4LBS1LI

### Luminous Intensity Polar Plot

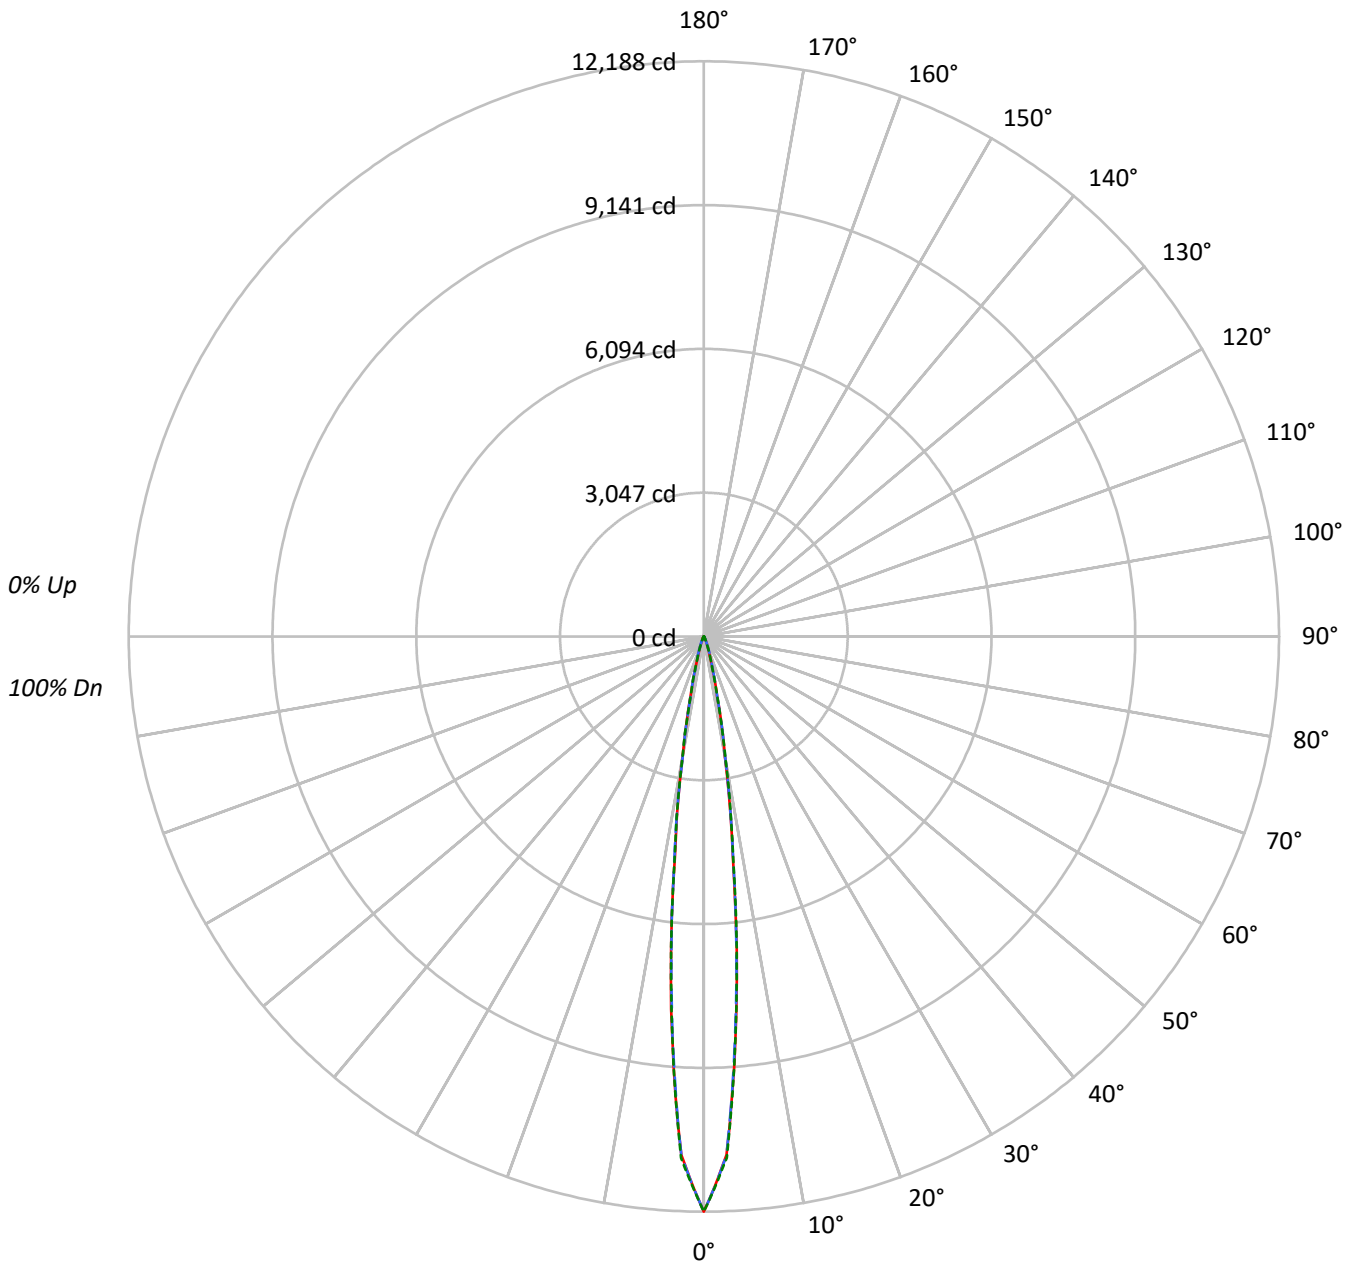



TEST NUMBER: P777626

CATALOG NUMBER: LERS4D08D010-EC4DR150210IC9050-4LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	99	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	1371449	1371449	1371449
5°	805927	795490	801781
10°	240528	242217	245921
15°	59827	60991	59115
20°	17903	20726	18279
25°	6310	8039	6388
30°	2321	3055	2359
35°	1162	1314	1126
40°	731	810	731
45°	539	581	539
50°	431	431	431
55°	362	362	362
60°	288	288	288
65°	221	221	221
70°	190	190	190
75°	113	113	159
80°	79	79	79
85°	42	42	42

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 581 cd/sqm



TEST NUMBER: P777626

CATALOG NUMBER: LERS4D08D010-EC4DR150210IC9050-4LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	580.2	64.9
10°-20°	238.6	26.7
20°-30°	47.4	5.3
30°-40°	11.8	1.3
40°-50°	6.2	0.7
50°-60°	4.6	0.5
60°-70°	3.3	0.4
70°-80°	1.8	0.2
80°-90°	0.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	866.2	96.8
0°-40°	878.1	98.2
0°-60°	888.9	99.4
0°-90°	894.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	894.5	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	12188	12188	12188	12188	12188	
5°	7930	7849	7827	7882	7889	579
15°	689	702	702	690	681	236
25°	81	92	103	91	82	43
35°	16	17	18	17	16	11
45°	8	8	8	8	8	6
55°	5	5	5	5	5	5
65°	3	3	3	3	3	3
75°	2	2	2	2	2	2
85°	0	0	0	0	0	1
90°	0	0	0	0	0	



TEST NUMBER: P777626

CATALOG NUMBER: LERS4D08D010-EC4DR150210IC9050-4LBS1LI

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	12188.5	12188.5	12188.5	12188.5	12188.5
2.5°	10994.5	11003.8	11007.4	11018.2	11058.5
5°	7930.1	7848.6	7827.4	7881.6	7889.3
7.5°	4697.5	4714.0	4774.4	4787.8	4739.3
10°	2577.8	2599.0	2595.9	2614.5	2635.6
12.5°	1318.3	1301.8	1296.7	1317.8	1288.4
15°	688.8	701.7	702.2	689.9	680.6
17.5°	370.5	385.4	410.2	390.1	359.1
20°	218.8	232.2	253.3	236.8	223.4
22.5°	135.2	146.0	161.0	148.1	137.3
25°	81.0	91.8	103.2	91.3	82.0
27.5°	48.0	57.3	64.5	56.8	47.5
30°	31.0	36.1	40.8	35.6	31.5
32.5°	21.7	23.7	25.8	23.7	21.7
35°	16.0	17.0	18.1	17.0	15.5
37.5°	12.4	13.4	13.9	12.9	11.9
40°	10.3	10.8	11.4	10.8	10.3
42.5°	8.8	9.3	9.3	9.3	8.8
45°	7.7	7.7	8.3	7.7	7.7
47.5°	6.7	6.7	7.2	6.7	6.7
50°	6.2	6.2	6.2	6.2	6.2
52.5°	5.7	5.7	5.7	5.7	5.7
55°	5.2	5.2	5.2	5.2	5.2
57.5°	4.6	4.6	4.6	4.6	4.6
60°	4.1	4.1	4.1	4.1	4.1
62.5°	3.6	3.6	3.6	3.6	3.6
65°	3.1	3.1	3.1	3.1	3.1
67.5°	3.1	3.1	3.1	3.1	3.1
70°	2.6	2.6	2.6	2.6	2.6
72.5°	2.1	2.1	2.1	2.1	2.1
75°	1.5	1.5	1.5	1.5	2.1
77.5°	1.5	1.5	1.5	1.5	1.5
80°	1.0	1.0	1.0	1.0	1.0
82.5°	1.0	1.0	1.0	1.0	1.0
85°	0.5	0.5	0.5	0.5	0.5
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)