

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P777630

Luminaire Tested: LERS4D08D010-EC4DR200210IC9024-4LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P777630
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D08D010-EC4DR200210IC9024-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 763.8 lumens
Efficiency: N/A
Efficacy: 85.8 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P777630

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9024-4LBS1LI

Luminous Intensity Polar Plot

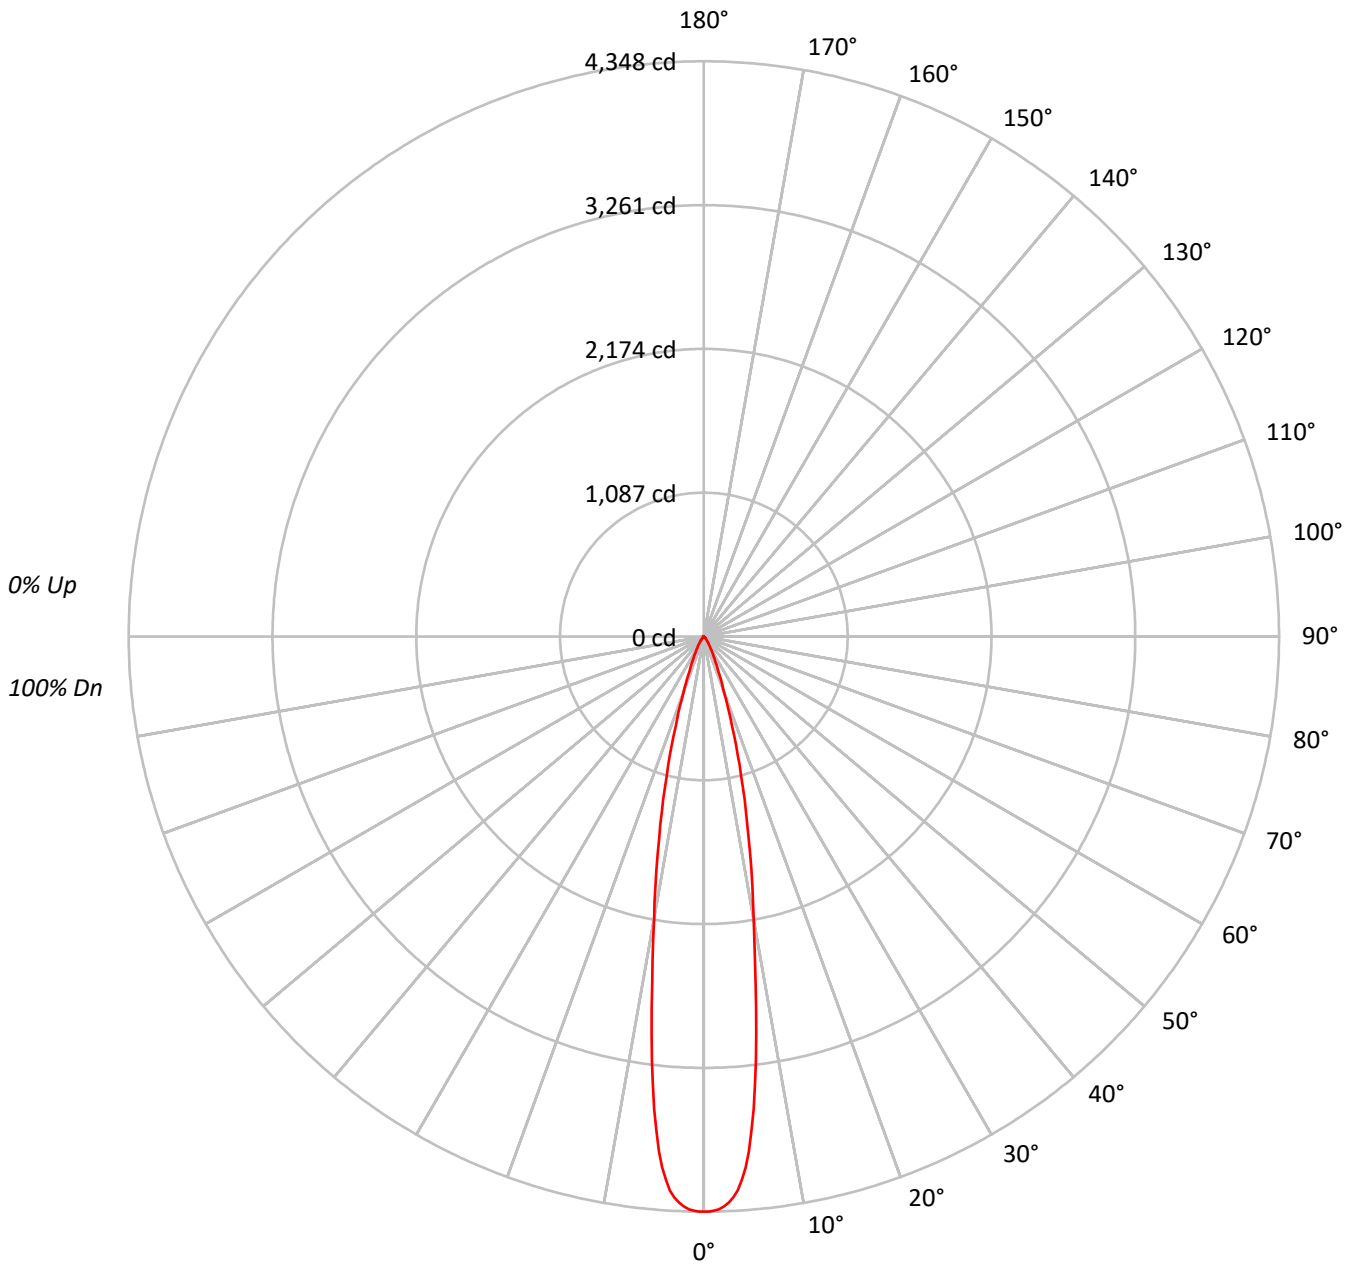



TEST NUMBER: P777630

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9024-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	98	97															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	96	95															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	98	93	92															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	91	89															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	88	86															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	86	84															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	84	82															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	82	80															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	80	78															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	78	76															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	475022
5°	428556
10°	240532
15°	122266
20°	51765
25°	23894
30°	12654
35°	6816
40°	3651
45°	2148
50°	1258
55°	667
60°	415
65°	310
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2148 cd/sqm



TEST NUMBER: P777630

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9024-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	309.5	40.5
10°-20°	304.8	39.9
20°-30°	99.6	13.0
30°-40°	33.9	4.4
40°-50°	11.4	1.5
50°-60°	3.4	0.4
60°-70°	1.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	713.9	93.5
0°-40°	747.8	97.9
0°-60°	762.6	99.8
0°-90°	763.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	763.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4348	
5°	3907	310
15°	1081	305
25°	198	100
35°	51	34
45°	14	11
55°	4	3
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P777630

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9024-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	4347.6
0.5°	4347.6
1°	4342.2
1.5°	4331.3
2°	4311.6
2.5°	4285.2
3°	4248.1
3.5°	4196.2
4°	4119.2
4.5°	4025.5
5°	3907.4
5.5°	3752.2
6°	3593.0
6.5°	3410.7
7°	3232.2
7.5°	3023.2
8°	2836.6
8.5°	2648.8
9°	2475.4
9.5°	2316.3
10°	2168.0
12.5°	1556.7
15°	1080.9
17.5°	706.1
20°	445.2
22.5°	288.4
25°	198.2
27.5°	139.4
30°	100.3
32.5°	72.0
35°	51.1
37.5°	35.6
40°	25.6
42.5°	18.6
45°	13.9
47.5°	10.8
50°	7.4
52.5°	4.6
55°	3.5
57.5°	2.7
60°	1.9
62.5°	1.5
65°	1.2



TEST NUMBER: P777630

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9024-4LBS1LI

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		0.8
70°		0.4

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)