

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P777638

Luminaire Tested: LERS4D08D010-EC4DR200210IC9030-4LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P777638
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D08D010-EC4DR200210IC9030-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 875.5 lumens
Efficiency: N/A
Efficacy: 98.4 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P777638

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9030-4LBS1LI

Luminous Intensity Polar Plot

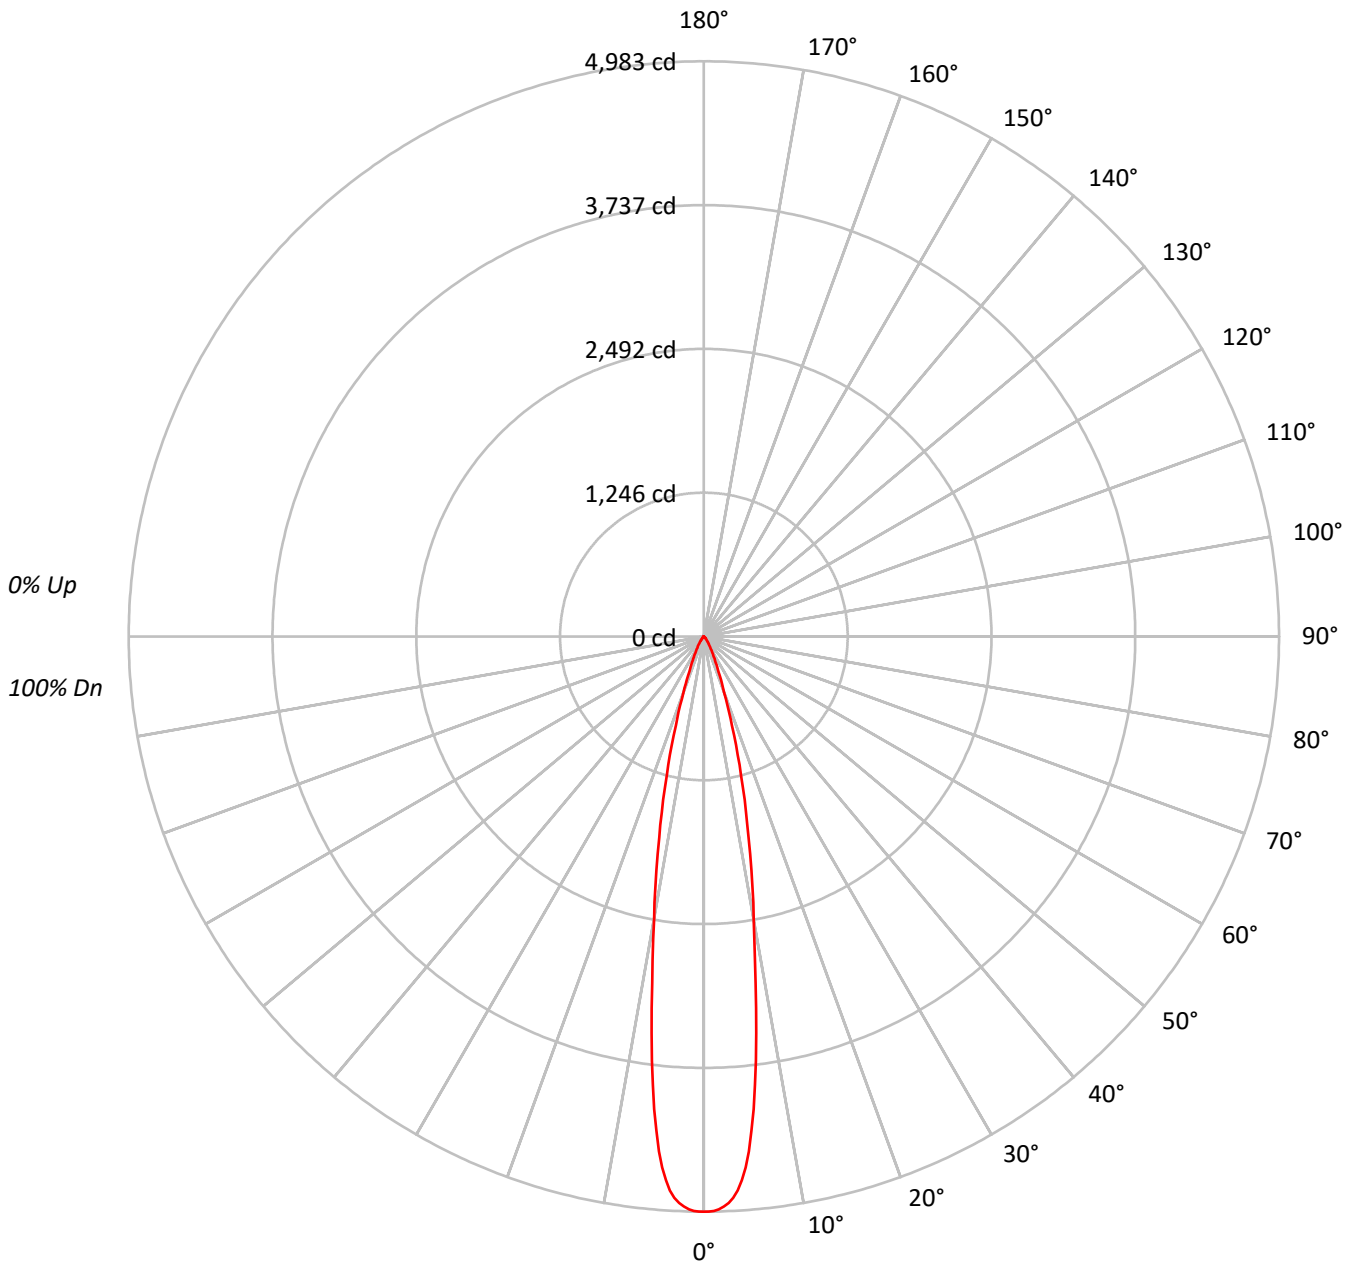



TEST NUMBER: P777638

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9030-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	98	97															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	96	95															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	95	93	92															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	91	89															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	88	86															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	86	84															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	84	82															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	82	80															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	80	78															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	78	76															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	544479
5°	491215
10°	275701
15°	140138
20°	59334
25°	27390
30°	14496
35°	7816
40°	4179
45°	2472
50°	1428
55°	762
60°	481
65°	336
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2472 cd/sqm



TEST NUMBER: P777638

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9030-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	354.8	40.5
10°-20°	349.4	39.9
20°-30°	114.1	13.0
30°-40°	38.9	4.4
40°-50°	13.1	1.5
50°-60°	3.9	0.4
60°-70°	1.3	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	818.3	93.5
0°-40°	857.1	97.9
0°-60°	874.1	99.8
0°-90°	875.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	875.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4983	
5°	4479	355
15°	1239	349
25°	227	114
35°	59	39
45°	16	13
55°	4	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P777638

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9030-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	4983.3
0.5°	4983.3
1°	4977.1
1.5°	4964.6
2°	4942.0
2.5°	4911.8
3°	4869.2
3.5°	4809.8
4°	4721.5
4.5°	4614.1
5°	4478.7
5.5°	4300.8
6°	4118.4
6.5°	3909.4
7°	3704.8
7.5°	3465.2
8°	3251.3
8.5°	3036.1
9°	2837.3
9.5°	2654.9
10°	2485.0
12.5°	1784.3
15°	1238.9
17.5°	809.4
20°	510.3
22.5°	330.6
25°	227.2
27.5°	159.7
30°	114.9
32.5°	82.5
35°	58.6
37.5°	40.8
40°	29.3
42.5°	21.3
45°	16.0
47.5°	12.4
50°	8.4
52.5°	5.3
55°	4.0
57.5°	3.1
60°	2.2
62.5°	1.8
65°	1.3



TEST NUMBER: P777638

CATALOG NUMBER: LERS4D08D010-EC4DR200210IC9030-4LBS1LI

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		0.9
70°		0.4

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)