

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P778230

Luminaire Tested: LERS4D15D010-EC4DR1515309024-4LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P778230
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D15D010-EC4DR1515309024-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1307.8 lumens
Efficiency: N/A
Efficacy: 82.8 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P778230
CATALOG NUMBER: LERS4D15D010-EC4DR1515309024-4LBS1LI

Luminous Intensity Polar Plot

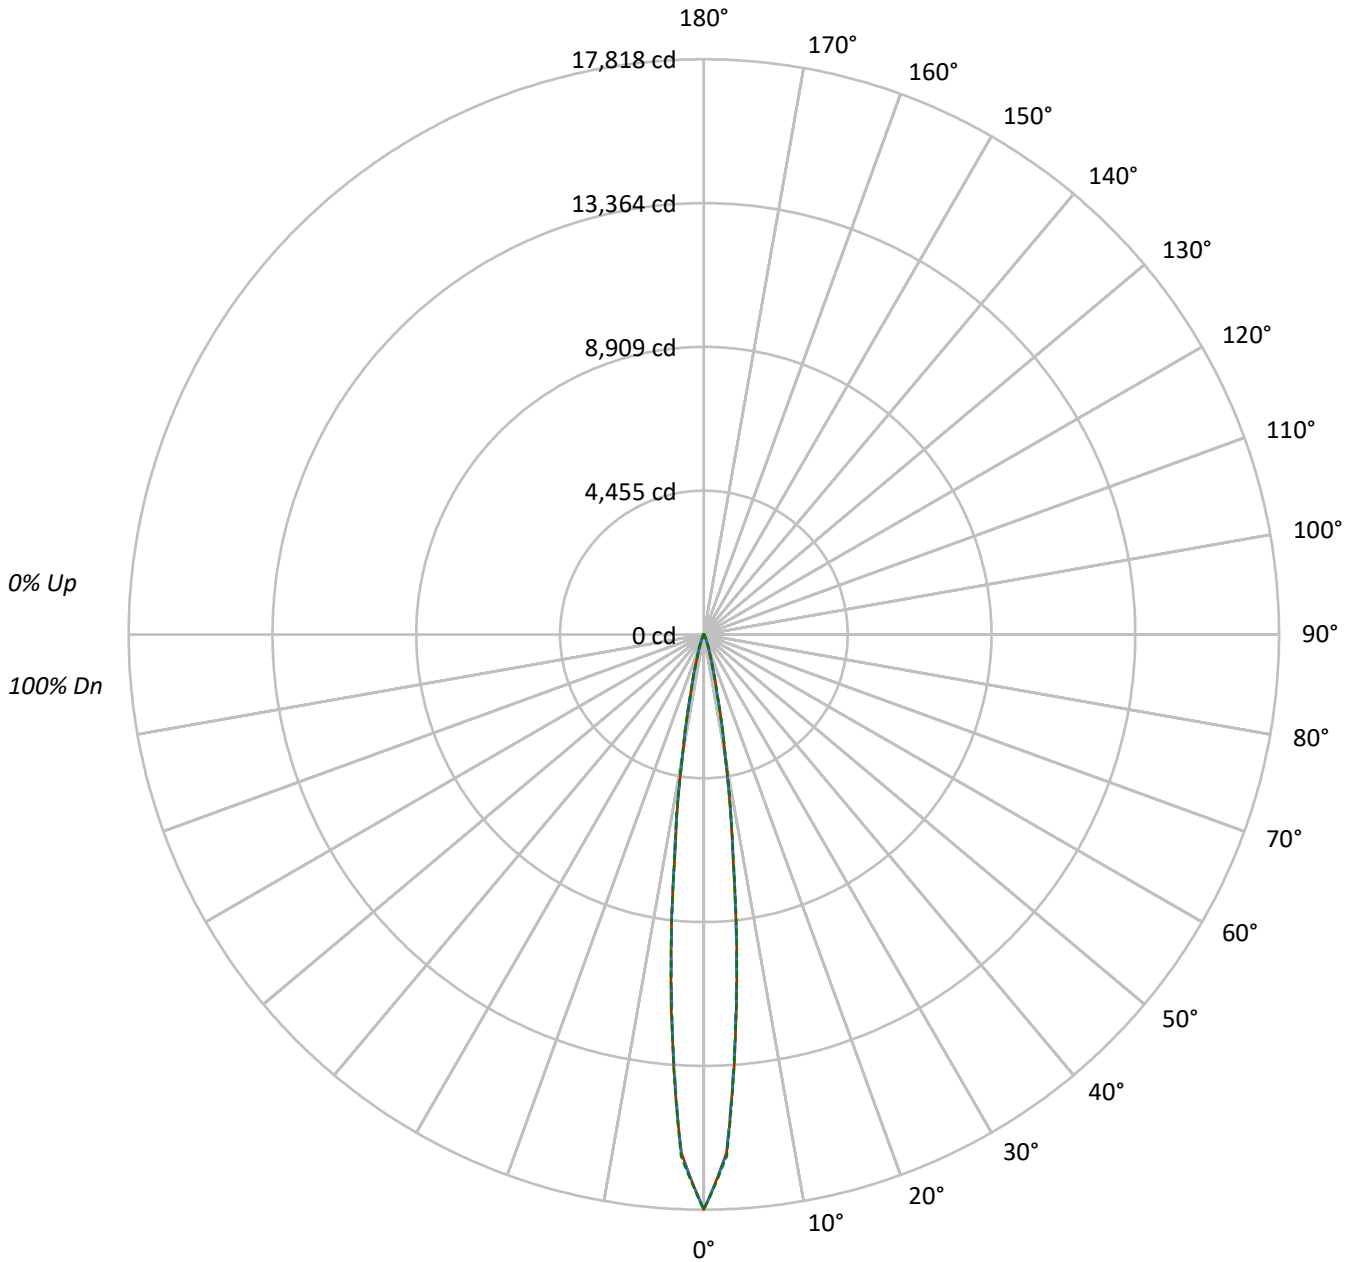



TEST NUMBER: P778230

CATALOG NUMBER: LERS4D15D010-EC4DR1515309024-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100														
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98					98														
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96					96														
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94					94														
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93					93														
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92					92														
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90					90														
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89					89														
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88					88														
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87					87														
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86					86														

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2004880	2004880	2004880
5°	1178164	1162909	1172106
10°	351630	354093	359505
15°	87465	89167	86414
20°	26167	30307	26723
25°	9223	11755	9340
30°	3392	4463	3445
35°	1699	1917	1641
40°	1072	1179	1072
45°	791	847	791
50°	633	633	633
55°	522	522	522
60°	421	421	421
65°	321	321	321
70°	278	278	278
75°	174	174	227
80°	118	118	118
85°	66	66	66

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 847 cd/sqm



TEST NUMBER: P778230

CATALOG NUMBER: LERS4D15D010-EC4DR1515309024-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	848.2	64.9
10°-20°	348.9	26.7
20°-30°	69.3	5.3
30°-40°	17.3	1.3
40°-50°	9.1	0.7
50°-60°	6.7	0.5
60°-70°	4.8	0.4
70°-80°	2.7	0.2
80°-90°	0.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1266.3	96.8
0°-40°	1283.6	98.2
0°-60°	1299.5	99.4
0°-90°	1307.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1307.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	17818	17818	17818	17818	17818	
5°	11593	11474	11443	11522	11533	847
15°	1007	1026	1027	1008	995	345
25°	118	134	151	134	120	62
35°	23	25	26	25	23	16
45°	11	11	12	11	11	9
55°	8	8	8	8	8	7
65°	4	4	4	4	4	5
75°	2	2	2	2	3	3
85°	1	1	1	1	1	1
90°	0	0	0	0	0	



TEST NUMBER: P778230

CATALOG NUMBER: LERS4D15D010-EC4DR1515309024-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	17818.0	17818.0	17818.0	17818.0	17818.0
2.5°	16072.6	16086.1	16091.4	16107.3	16166.1
5°	11592.8	11473.6	11442.7	11521.9	11533.2
7.5°	6867.1	6891.3	6979.5	6999.1	6928.2
10°	3768.5	3799.4	3794.9	3822.0	3852.9
12.5°	1927.2	1903.1	1895.5	1926.5	1883.5
15°	1007.0	1025.8	1026.6	1008.5	994.9
17.5°	541.6	563.5	599.7	570.2	525.0
20°	319.8	339.4	370.4	346.2	326.6
22.5°	197.6	213.5	235.3	216.5	200.6
25°	118.4	134.3	150.9	133.5	119.9
27.5°	70.1	83.7	94.3	83.0	69.4
30°	45.3	52.8	59.6	52.0	46.0
32.5°	31.7	34.7	37.7	34.7	31.7
35°	23.4	24.9	26.4	24.9	22.6
37.5°	18.1	19.6	20.4	18.9	17.3
40°	15.1	15.8	16.6	15.8	15.1
42.5°	12.8	13.6	13.6	13.6	12.8
45°	11.3	11.3	12.1	11.3	11.3
47.5°	9.8	9.8	10.6	9.8	9.8
50°	9.1	9.1	9.1	9.1	9.1
52.5°	8.3	8.3	8.3	8.3	8.3
55°	7.5	7.5	7.5	7.5	7.5
57.5°	6.8	6.8	6.8	6.8	6.8
60°	6.0	6.0	6.0	6.0	6.0
62.5°	5.3	5.3	5.3	5.3	5.3
65°	4.5	4.5	4.5	4.5	4.5
67.5°	4.5	4.5	4.5	4.5	4.5
70°	3.8	3.8	3.8	3.8	3.8
72.5°	3.0	3.0	3.0	3.0	3.0
75°	2.3	2.3	2.3	2.3	3.0
77.5°	2.3	2.3	2.3	2.3	2.3
80°	1.5	1.5	1.5	1.5	1.5
82.5°	1.5	1.5	1.5	1.5	1.5
85°	0.8	0.8	0.8	0.8	0.8
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)