

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P778330

Luminaire Tested: LERS4D15D010-EC4DR350215IC9027-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P778330
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D15D010-EC4DR350215IC9027-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1373.0 lumens
Efficiency: N/A
Efficacy: 86.9 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P778330

CATALOG NUMBER: LERS4D15D010-EC4DR350215IC9027-4LBS1LI

Luminous Intensity Polar Plot

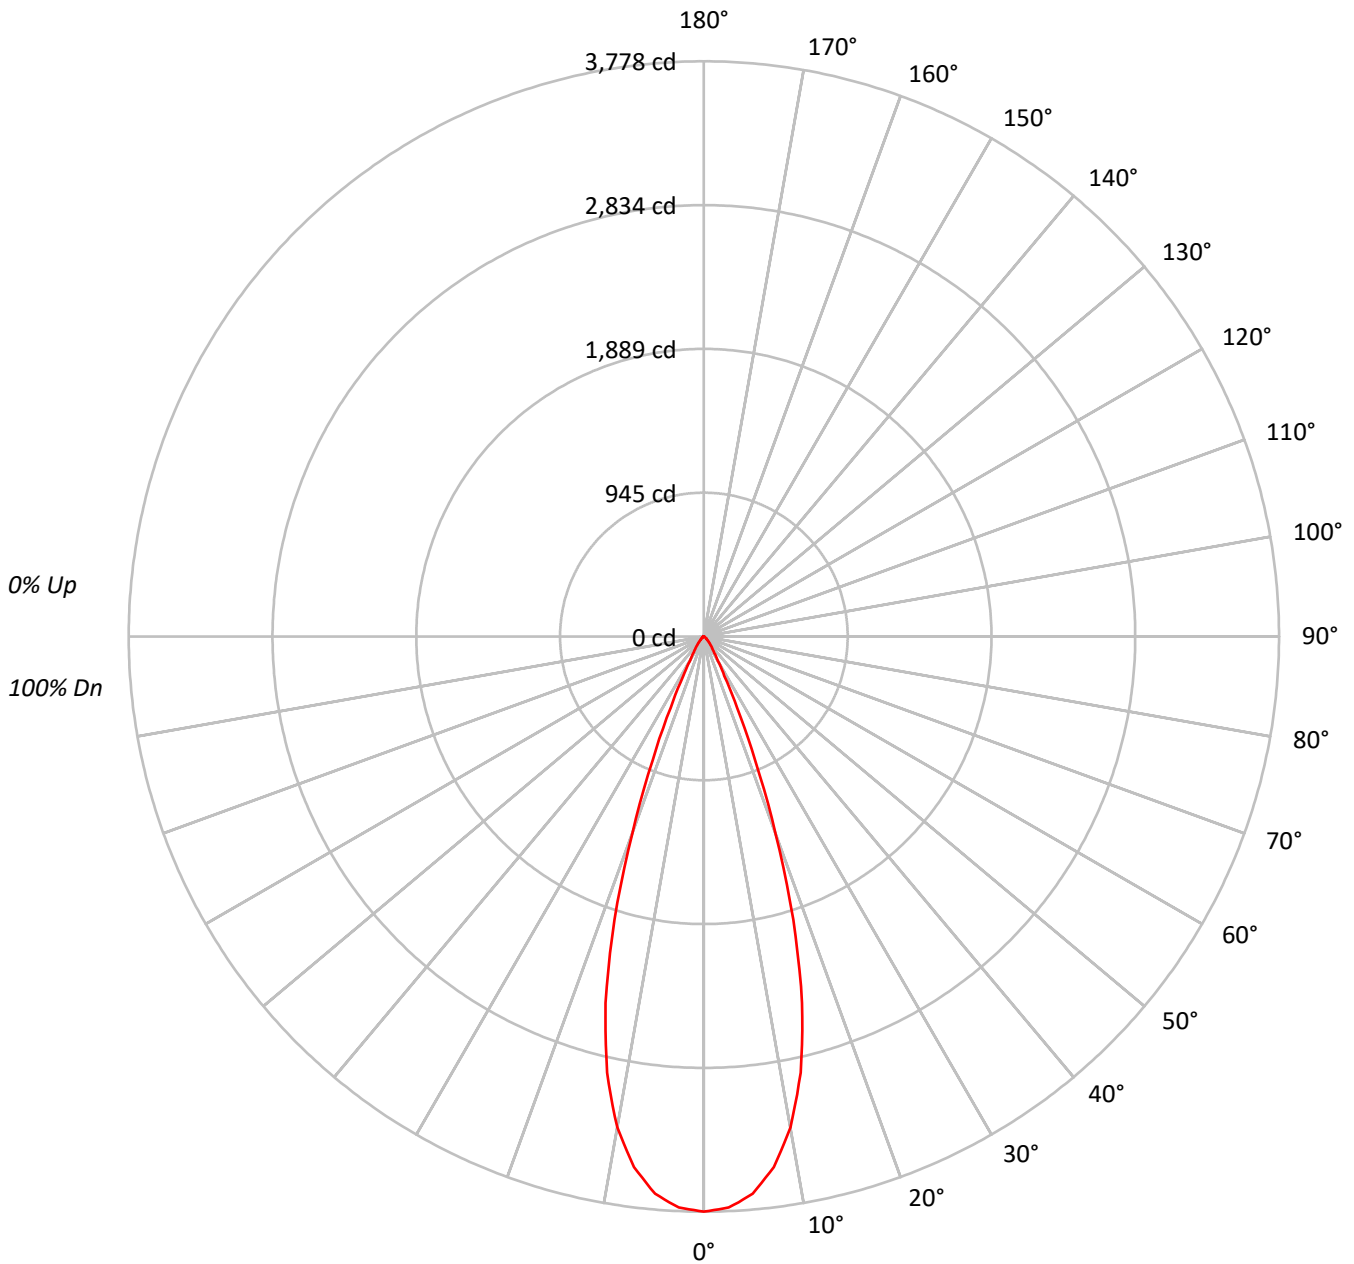



TEST NUMBER: P778330

CATALOG NUMBER: LERS4D15D010-EC4DR350215IC9027-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96				96															
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92				92															
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88				88															
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84				84															
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81				81															
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78				78															
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75				75															
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72				72															
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70				70															
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68				68															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	412754
5°	403056
10°	363260
15°	281951
20°	159922
25°	62219
30°	23214
35°	12725
40°	8315
45°	5068
50°	3230
55°	2286
60°	1661
65°	905
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5068 cd/sqm



TEST NUMBER: P778330

CATALOG NUMBER: LERS4D15D010-EC4DR350215IC9027-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	338.0	24.6
10°-20°	659.9	48.1
20°-30°	269.1	19.6
30°-40°	64.4	4.7
40°-50°	26.8	2.0
50°-60°	11.1	0.8
60°-70°	3.5	0.3
70°-80°	0.1	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1267.0	92.3
0°-40°	1331.4	97.0
0°-60°	1369.4	99.7
0°-90°	1373.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1373.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3778	
5°	3675	338
15°	2493	660
25°	516	269
35°	95	64
45°	33	27
55°	12	11
65°	4	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P778330

CATALOG NUMBER: LERS4D15D010-EC4DR350215IC9027-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	3777.7
2.5°	3755.0
5°	3674.9
7.5°	3515.0
10°	3274.2
12.5°	2935.1
15°	2492.6
17.5°	1951.4
20°	1375.4
22.5°	877.0
25°	516.1
27.5°	291.7
30°	184.0
32.5°	129.1
35°	95.4
37.5°	73.7
40°	58.3
42.5°	44.9
45°	32.8
47.5°	24.5
50°	19.0
52.5°	15.0
55°	12.0
57.5°	9.7
60°	7.6
62.5°	5.6
65°	3.5
67.5°	1.3
70°	0.2
72.5°	0.2
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.2
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)