

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P778338

Luminaire Tested: LERS4D15D010-EC4DR350215IC9035-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P778338
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D15D010-EC4DR350215IC9035-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1496.6 lumens
Efficiency: N/A
Efficacy: 94.7 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P778338

CATALOG NUMBER: LERS4D15D010-EC4DR350215IC9035-4LBS1LI

Luminous Intensity Polar Plot

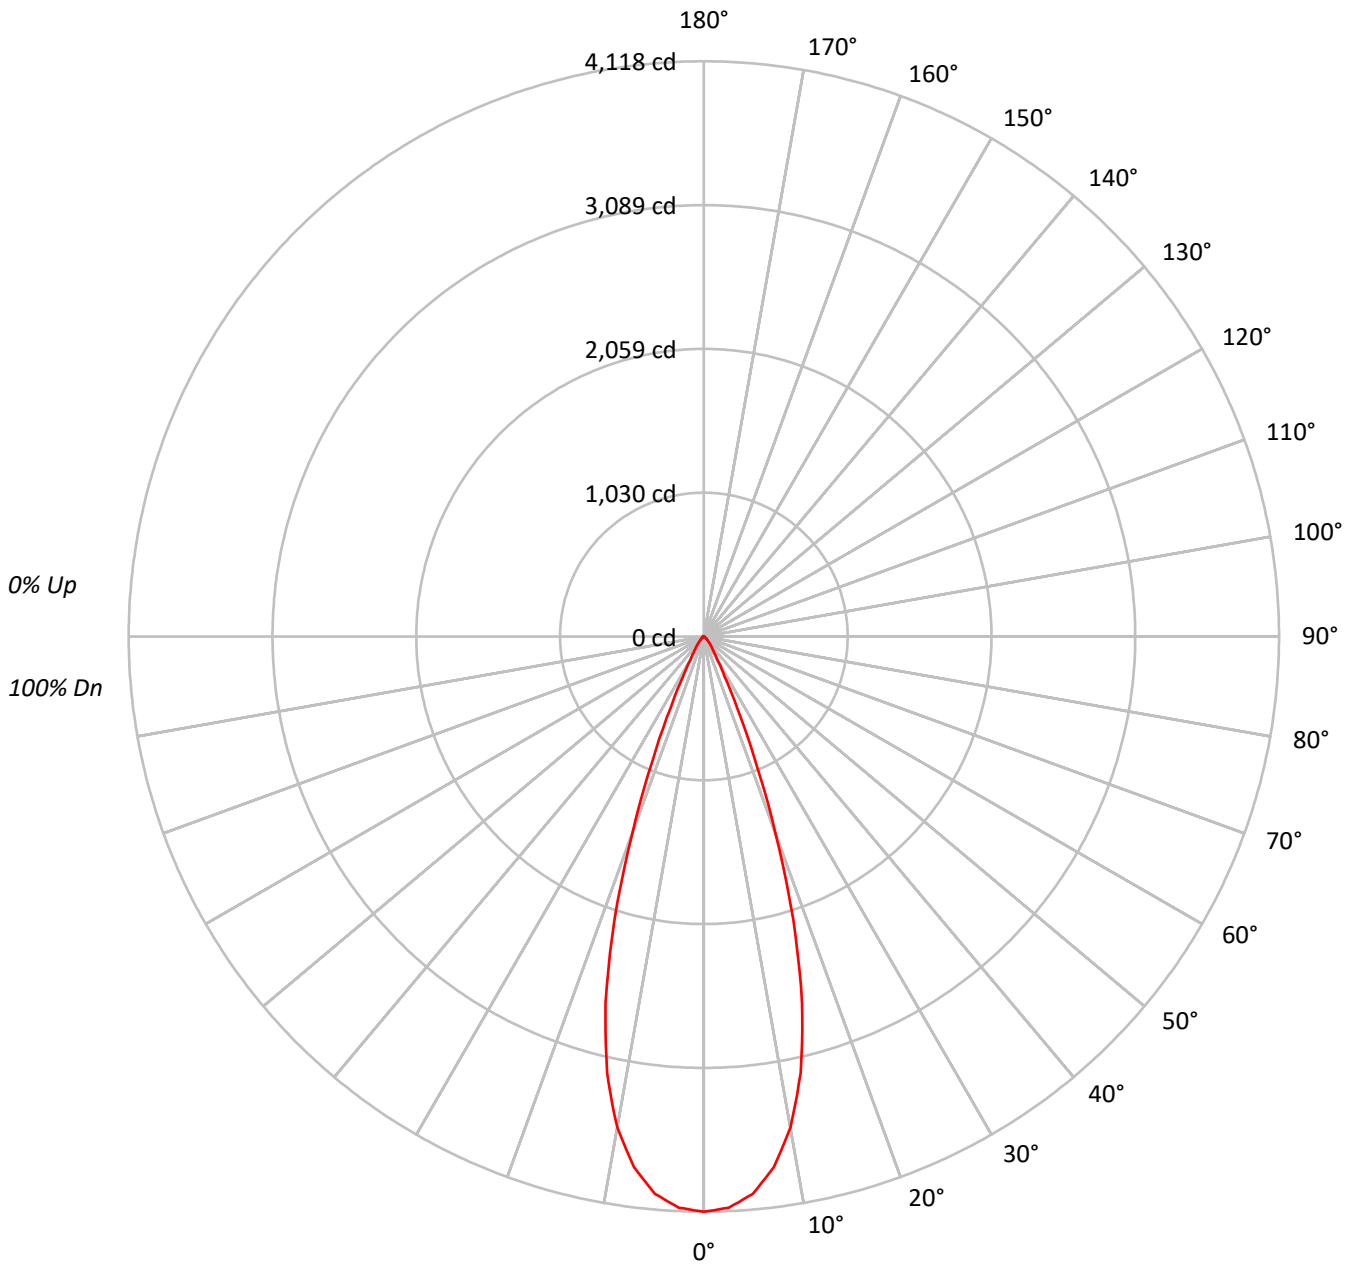



TEST NUMBER: P778338

CATALOG NUMBER: LERS4D15D010-EC4DR350215IC9035-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96				96															
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92				92															
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88				88															
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84				84															
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81				81															
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78				78															
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75				75															
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72				72															
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70				70															
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68				68															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	449925
5°	439349
10°	395967
15°	307334
20°	174316
25°	67813
30°	25296
35°	13872
40°	9057
45°	5516
50°	3519
55°	2476
60°	1814
65°	982
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5516 cd/sqm



TEST NUMBER: P778338

CATALOG NUMBER: LERS4D15D010-EC4DR350215IC9035-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	368.4	24.6
10°-20°	719.3	48.1
20°-30°	293.4	19.6
30°-40°	70.2	4.7
40°-50°	29.2	2.0
50°-60°	12.1	0.8
60°-70°	3.8	0.3
70°-80°	0.1	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1381.1	92.3
0°-40°	1451.3	97.0
0°-60°	1492.6	99.7
0°-90°	1496.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1496.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4118	
5°	4006	368
15°	2717	719
25°	562	293
35°	104	70
45°	36	29
55°	13	12
65°	4	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P778338

CATALOG NUMBER: LERS4D15D010-EC4DR350215IC9035-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	4117.9
2.5°	4093.2
5°	4005.8
7.5°	3831.6
10°	3569.0
12.5°	3199.4
15°	2717.0
17.5°	2127.1
20°	1499.2
22.5°	956.0
25°	562.5
27.5°	318.0
30°	200.5
32.5°	140.8
35°	104.0
37.5°	80.4
40°	63.5
42.5°	48.9
45°	35.7
47.5°	26.7
50°	20.7
52.5°	16.4
55°	13.0
57.5°	10.5
60°	8.3
62.5°	6.1
65°	3.8
67.5°	1.4
70°	0.2
72.5°	0.2
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.2
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)