

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P778444

Luminaire Tested: LERS4D15D010-EC4DR600215IC9024-4LBS1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P778444
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D15D010-EC4DR600215IC9024-4LBS1B
Description: 4 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1158.9 lumens
Efficiency: N/A
Efficacy: 73.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P778444

CATALOG NUMBER: LERS4D15D010-EC4DR600215IC9024-4LBS1B

Luminous Intensity Polar Plot

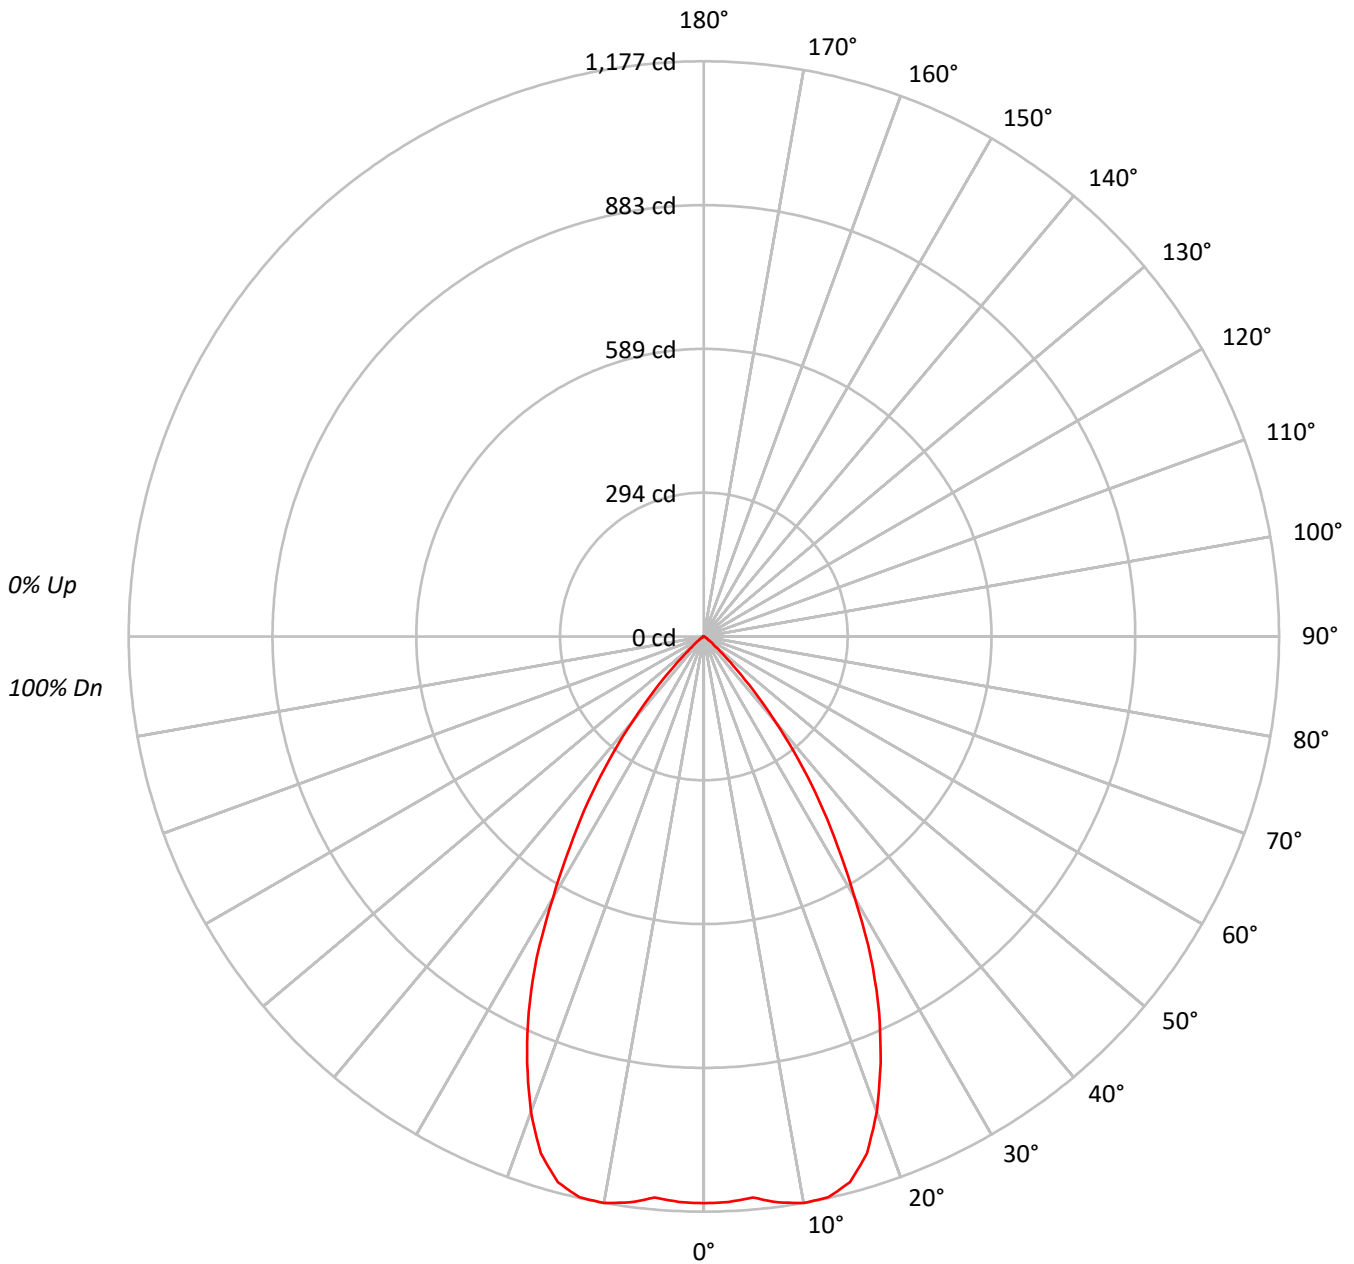



TEST NUMBER: P778444

CATALOG NUMBER: LERS4D15D010-EC4DR600215IC9024-4LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94																			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75																			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70																			
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65																			
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61																			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57																			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53																			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	126710
5°	126404
10°	130606
15°	130738
20°	120296
25°	102316
30°	77956
35°	55127
40°	32377
45°	13072
50°	4368
55°	2095
60°	874
65°	129
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13072 cd/sqm



TEST NUMBER: P778444

CATALOG NUMBER: LERS4D15D010-EC4DR600215IC9024-4LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	111.2	9.6
10°-20°	320.2	27.6
20°-30°	383.2	33.1
30°-40°	256.3	22.1
40°-50°	76.0	6.6
50°-60°	10.9	0.9
60°-70°	1.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	814.6	70.3
0°-40°	1070.9	92.4
0°-60°	1157.8	99.9
0°-90°	1158.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1158.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1160	
5°	1152	111
15°	1156	320
25°	849	383
35°	413	256
45°	85	76
55°	11	11
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P778444

CATALOG NUMBER: LERS4D15D010-EC4DR600215IC9024-4LBS1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	1159.7
2.5°	1158.2
5°	1152.5
7.5°	1168.1
10°	1177.2
12.5°	1175.5
15°	1155.8
17.5°	1109.2
20°	1034.6
22.5°	944.9
25°	848.7
27.5°	740.3
30°	617.9
32.5°	508.7
35°	413.3
37.5°	317.8
40°	227.0
42.5°	149.7
45°	84.6
47.5°	43.3
50°	25.7
52.5°	16.6
55°	11.0
57.5°	7.0
60°	4.0
62.5°	1.7
65°	0.5
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)