

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P778470

Luminaire Tested: LERS4D15D010-EC4DR650215IC9024-4LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P778470
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D15D010-EC4DR650215IC9024-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1134.7 lumens
Efficiency: N/A
Efficacy: 71.8 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P778470

CATALOG NUMBER: LERS4D15D010-EC4DR650215IC9024-4LBS1LI

Luminous Intensity Polar Plot

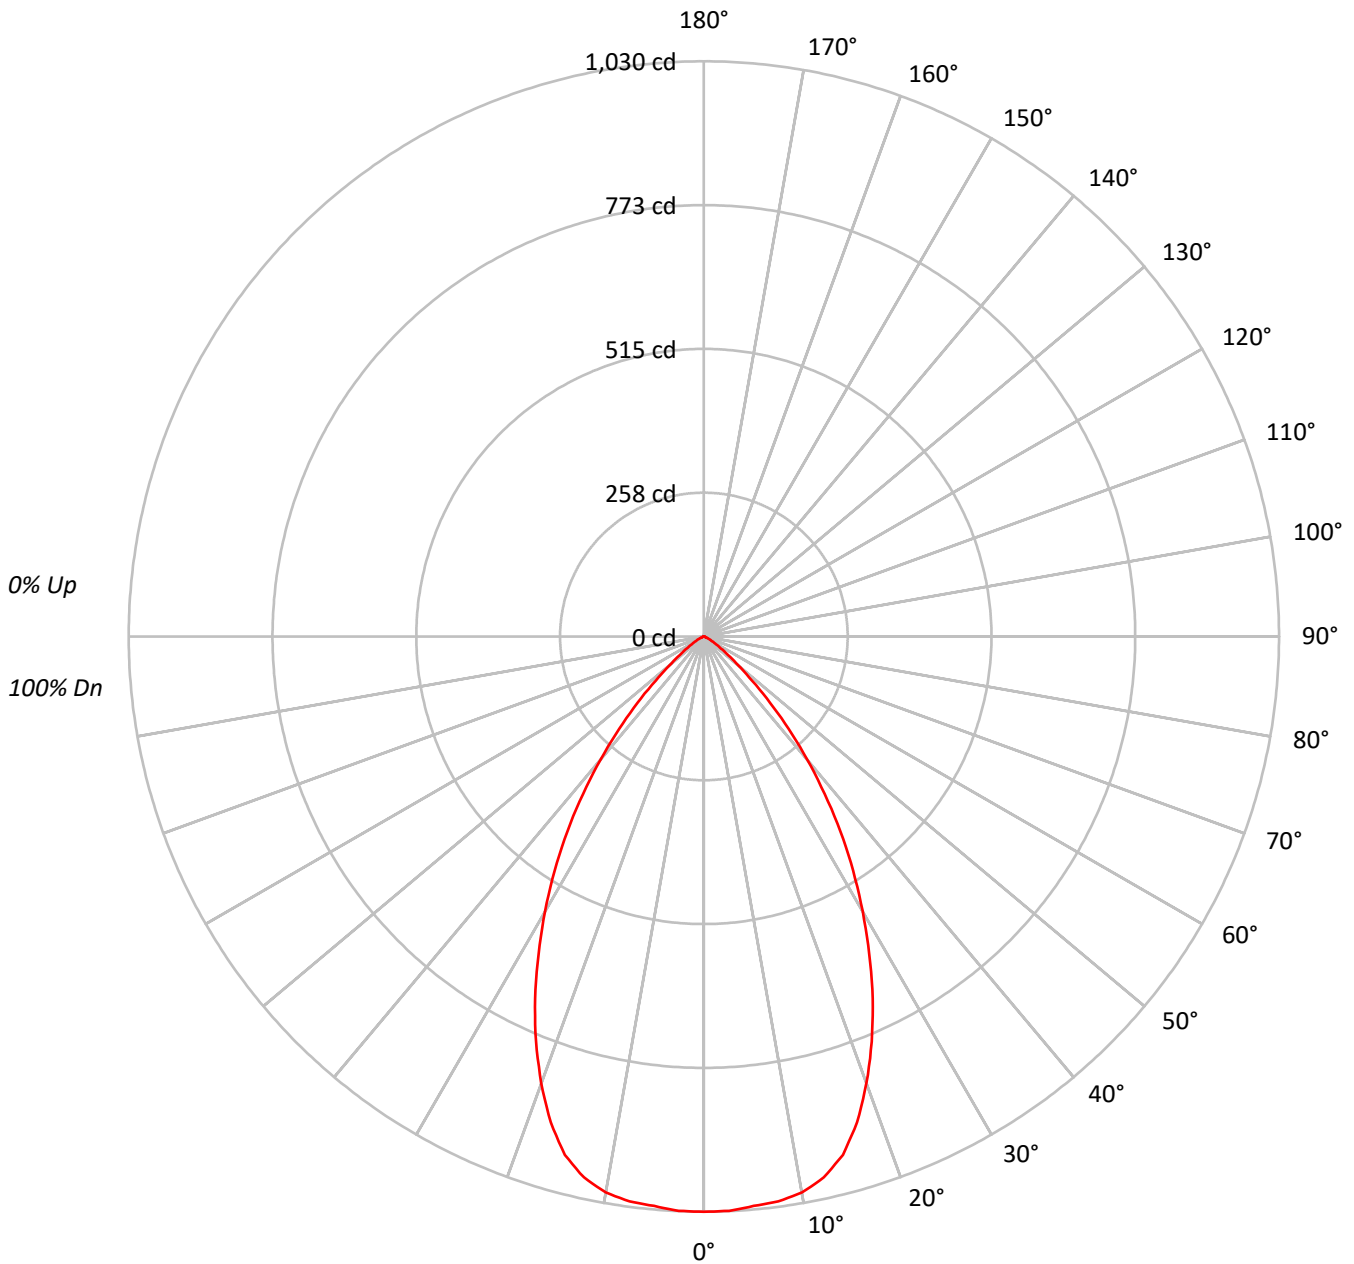



TEST NUMBER: P778470

CATALOG NUMBER: LERS4D15D010-EC4DR650215IC9024-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93																			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																			
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78																			
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72																			
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66																			
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61																			
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56																			
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52																			
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49																			
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46																			

AVERAGE LUMINANCE (cd/sqm):

0°	
0°	60168
5°	60016
10°	59963
15°	58118
20°	52910
25°	46108
30°	38353
35°	30387
40°	21927
45°	13860
50°	7223
55°	3839
60°	2009
65°	1106
70°	478
75°	519
80°	336
85°	335

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13860 cd/sqm



TEST NUMBER: P778470

CATALOG NUMBER: LERS4D15D010-EC4DR650215IC9024-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	97.4	8.6
10°-20°	266.8	23.5
20°-30°	326.1	28.7
30°-40°	264.6	23.3
40°-50°	131.9	11.6
50°-60°	36.8	3.2
60°-70°	8.4	0.7
70°-80°	2.2	0.2
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	690.3	60.8
0°-40°	954.9	84.2
0°-60°	1123.6	99.0
0°-90°	1134.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1134.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1030	
5°	1024	97
15°	961	267
25°	716	326
35°	426	265
45°	168	132
55°	38	37
65°	8	8
75°	2	2
85°	0	1
90°	0	



TEST NUMBER: P778470

CATALOG NUMBER: LERS4D15D010-EC4DR650215IC9024-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1030.2
2.5°	1029.5
5°	1023.7
7.5°	1020.4
10°	1011.1
12.5°	992.4
15°	961.2
17.5°	912.4
20°	851.3
22.5°	785.3
25°	715.5
27.5°	640.8
30°	568.7
32.5°	497.3
35°	426.2
37.5°	355.2
40°	287.6
42.5°	224.4
45°	167.8
47.5°	116.9
50°	79.5
52.5°	54.8
55°	37.7
57.5°	25.4
60°	17.2
62.5°	12.0
65°	8.0
67.5°	4.1
70°	2.8
72.5°	2.6
75°	2.3
77.5°	1.5
80°	1.0
82.5°	0.7
85°	0.5
87.5°	0.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)