

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P211752

Luminaire Tested: **LE\_4B20D010 EC4B10209040 4LBS1WMH**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P211752  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LE\_4B20D010 EC4B10209040 4LBS1WMH  
Description: PORTFOLIO 4 INCH CYLINDER  
SHALLOW DISTRIBUTION WITH WARM HAZE TRIM  
WATTAGE D010TR-21.86W DE010-20.46W D5LT-21.24W DMX-20.89W DL2-22.5W  
DL3-21.8 6W DLE-22.46W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2029.2 lumens  
Efficiency: N/A  
Efficacy: 97.6 lumens/watt  
Spacing Criteria (0/90/45): 0.99 / 0.99 / 1.08  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 20.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P211752

CATALOG NUMBER: LE\_4B20D010 EC4B10209040 4LBS1WMH

### Luminous Intensity Polar Plot

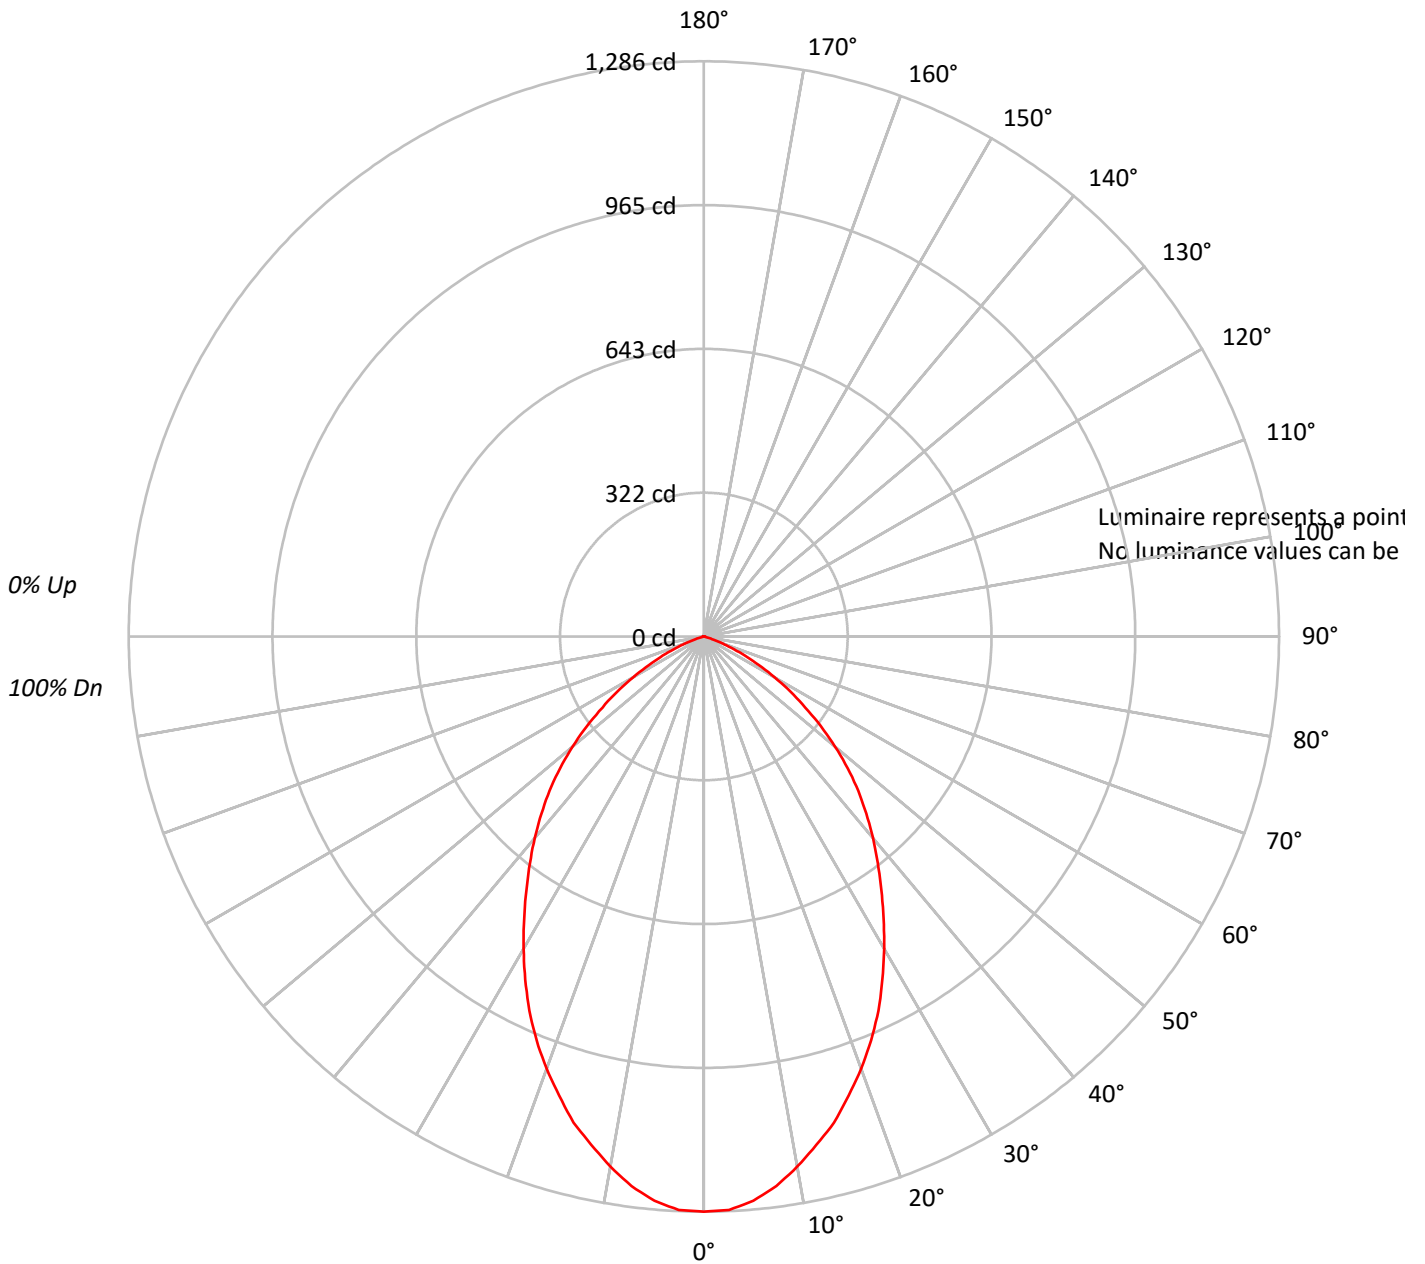



TEST NUMBER: P211752

CATALOG NUMBER: LE\_4B20D010 EC4B10209040 4LBS1WMH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	108	105	102	109	106	103	101	102	100	97	98	96	94	95	93	92	90																			
2	104	98	92	88	102	96	91	87	92	88	85	89	86	83	86	84	81	79																			
3	96	88	82	76	94	87	81	76	84	79	74	81	77	73	79	75	72	70																			
4	90	80	73	67	88	79	72	67	76	70	66	74	69	65	72	68	64	62																			
5	83	73	65	59	82	72	64	59	70	63	59	68	62	58	66	61	57	56																			
6	78	66	59	53	76	65	58	53	64	57	53	62	57	52	61	56	52	50																			
7	73	61	53	48	71	60	53	48	59	52	48	57	52	47	56	51	47	45																			
8	68	56	49	44	67	56	48	43	54	48	43	53	47	43	52	47	43	41																			
9	64	52	45	40	63	52	45	40	50	44	40	49	44	39	49	43	39	38																			
10	60	48	41	37	59	48	41	37	47	41	36	46	40	36	45	40	36	35																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P211752

CATALOG NUMBER: LE\_4B20D010 EC4B10209040 4LBS1WMH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	118.9	5.9
10°-20°	315.0	15.5
20°-30°	423.0	20.8
30°-40°	433.1	21.3
40°-50°	374.8	18.5
50°-60°	249.3	12.3
60°-70°	102.4	5.0
70°-80°	12.2	0.6
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	856.9	42.2
0°-40°	1290.0	63.6
0°-60°	1914.1	94.3
0°-90°	2029.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2029.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1286	
5°	1266	119
15°	1125	315
25°	923	423
35°	692	433
45°	488	375
55°	277	249
65°	101	102
75°	5	12
85°	0	1
90°	0	



TEST NUMBER: P211752

CATALOG NUMBER: LE\_4B20D010 EC4B10209040 4LBS1WMH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1286.1
2.5°	1283.4
5°	1266.1
7.5°	1239.6
10°	1203.6
12.5°	1163.7
15°	1125.2
17.5°	1076.0
20°	1028.1
22.5°	977.5
25°	923.0
27.5°	864.5
30°	806.0
32.5°	747.5
35°	691.6
37.5°	638.5
40°	587.9
42.5°	537.3
45°	488.1
47.5°	436.3
50°	383.0
52.5°	329.8
55°	276.7
57.5°	230.1
60°	182.2
62.5°	138.3
65°	101.0
67.5°	66.5
70°	38.6
72.5°	18.7
75°	5.3
77.5°	2.7
80°	1.3
82.5°	1.3
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)