

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P211965

Luminaire Tested: **LE_4B30D010 EC4B30509030 4LBM1B**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P211965
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LE_4B30D010 EC4B30509030 4LBM1B
Description: PORTFOLIO 4 INCH CYLINDER
MEDIUM DISTRIBUTION WITH SPECULAR BLACK TRIM
WATTAGE D010TR-27.4W DE010-27.95W D5LT-27.65W DMX-27.73W DL2-29.56W
DL3-29.67W DLE-29.73W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1190.3 lumens
Efficiency: N/A
Efficacy: 42.5 lumens/watt
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.87
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 28
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P211965

CATALOG NUMBER: LE_4B30D010 EC4B30509030 4LBM1B

Luminous Intensity Polar Plot

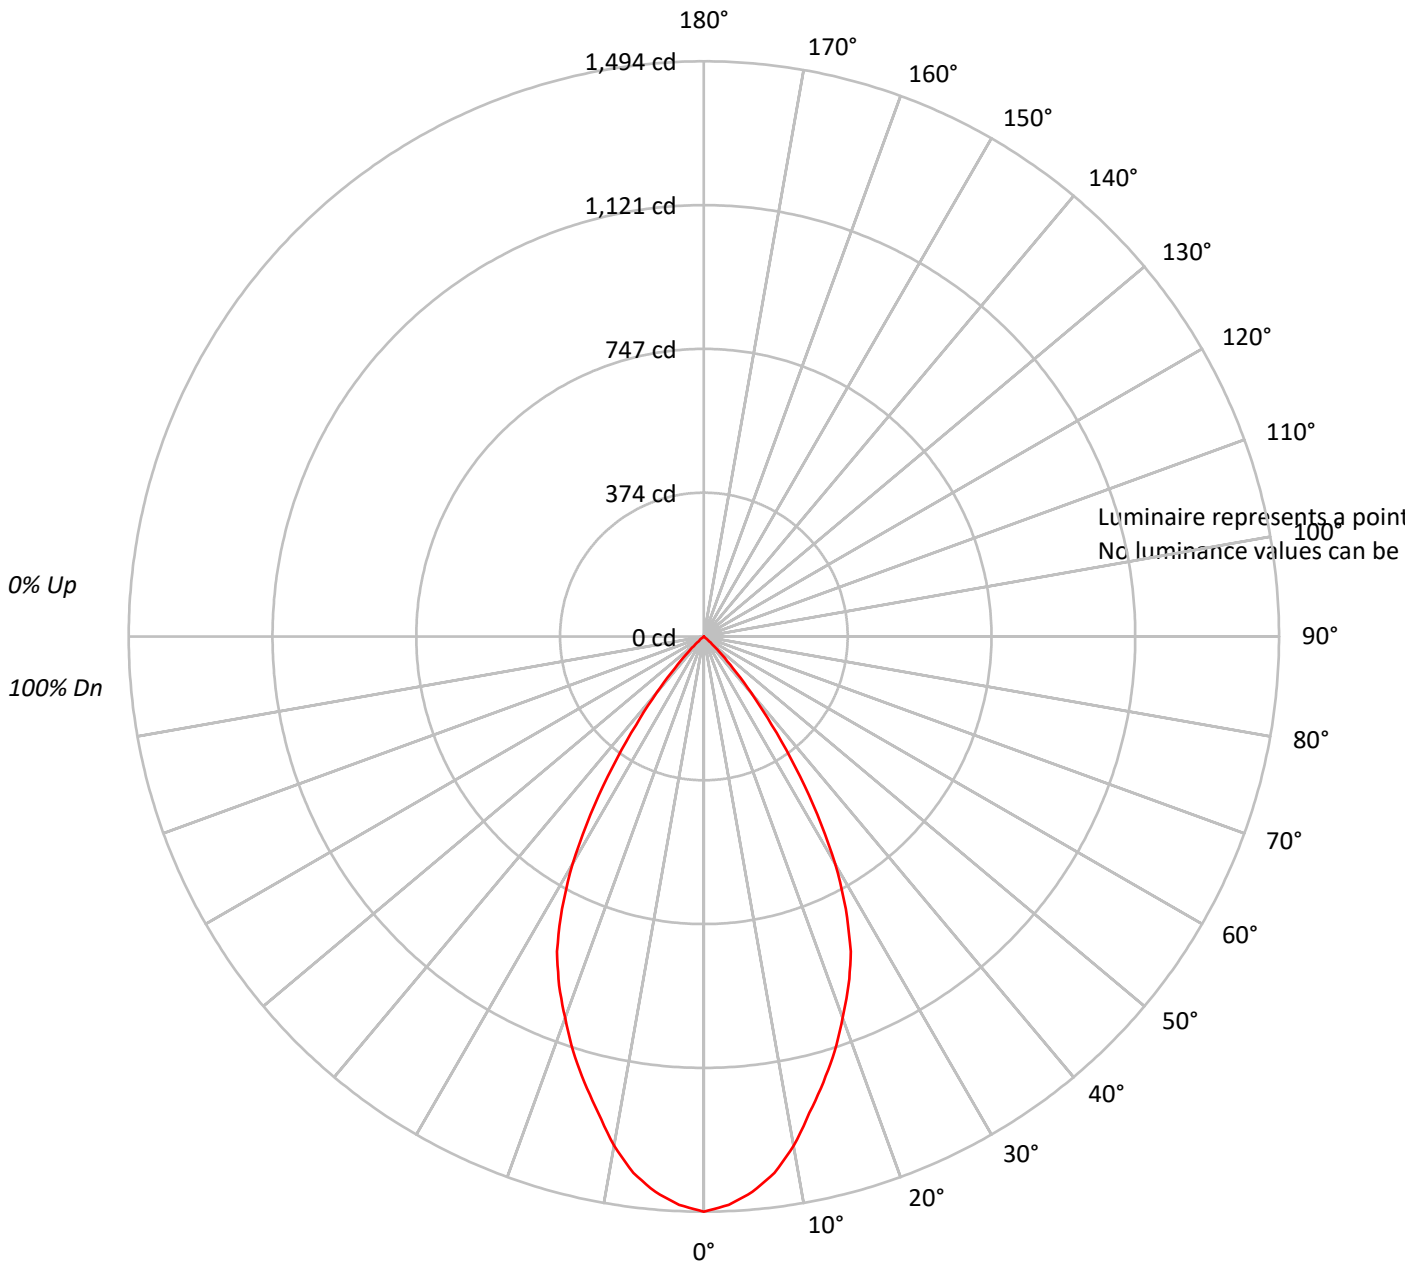



TEST NUMBER: P211965

CATALOG NUMBER: LE_4B30D010 EC4B30509030 4LBM1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 114 | 111 | 109 | 106 | 111 | 109 | 107 | 105 | 105 | 103 | 102 | 101 | 100 | 99 | 98 | 97 | 96 | 94 | | | |
| 2 | 108 | 104 | 100 | 96 | 106 | 102 | 98 | 95 | 99 | 96 | 93 | 96 | 93 | 91 | 93 | 91 | 89 | 88 | | | |
| 3 | 103 | 97 | 92 | 88 | 101 | 95 | 91 | 87 | 93 | 89 | 86 | 90 | 87 | 85 | 88 | 86 | 83 | 82 | | | |
| 4 | 98 | 91 | 85 | 81 | 96 | 90 | 85 | 81 | 87 | 83 | 80 | 85 | 82 | 79 | 84 | 81 | 78 | 77 | | | |
| 5 | 93 | 85 | 79 | 75 | 92 | 84 | 79 | 75 | 82 | 78 | 74 | 81 | 77 | 74 | 79 | 76 | 73 | 72 | | | |
| 6 | 89 | 80 | 74 | 70 | 87 | 79 | 74 | 70 | 78 | 73 | 69 | 76 | 72 | 69 | 75 | 71 | 68 | 67 | | | |
| 7 | 84 | 75 | 70 | 65 | 83 | 75 | 69 | 65 | 73 | 68 | 65 | 72 | 68 | 65 | 71 | 67 | 64 | 63 | | | |
| 8 | 80 | 71 | 65 | 61 | 79 | 71 | 65 | 61 | 69 | 64 | 61 | 68 | 64 | 61 | 67 | 63 | 60 | 59 | | | |
| 9 | 77 | 67 | 61 | 58 | 76 | 67 | 61 | 57 | 66 | 61 | 57 | 65 | 60 | 57 | 64 | 60 | 57 | 56 | | | |
| 10 | 73 | 64 | 58 | 54 | 72 | 63 | 58 | 54 | 62 | 57 | 54 | 62 | 57 | 54 | 61 | 57 | 54 | 52 | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P211965

CATALOG NUMBER: LE_4B30D010 EC4B30509030 4LBM1B

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 135.0 | 11.3 |
| 10°-20° | 335.7 | 28.2 |
| 20°-30° | 406.0 | 34.1 |
| 30°-40° | 258.9 | 21.8 |
| 40°-50° | 54.0 | 4.5 |
| 50°-60° | 0.7 | 0.1 |
| 60°-70° | 0.0 | 0.0 |
| 70°-80° | 0.0 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 876.6 | 73.6 |
| 0°-40° | 1135.6 | 95.4 |
| 0°-60° | 1190.3 | 100.0 |
| 0°-90° | 1190.3 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1190.3 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1494 | |
| 5° | 1448 | 135 |
| 15° | 1199 | 336 |
| 25° | 903 | 406 |
| 35° | 414 | 259 |
| 45° | 56 | 54 |
| 55° | 0 | 1 |
| 65° | 0 | 0 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P211965

CATALOG NUMBER: LE_4B30D010 EC4B30509030 4LBM1B

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 1494.2 |
| 2.5° | 1477.7 |
| 5° | 1448.1 |
| 7.5° | 1405.5 |
| 10° | 1343.0 |
| 12.5° | 1267.5 |
| 15° | 1198.6 |
| 17.5° | 1129.6 |
| 20° | 1054.1 |
| 22.5° | 981.8 |
| 25° | 903.1 |
| 27.5° | 798.0 |
| 30° | 683.0 |
| 32.5° | 548.4 |
| 35° | 413.8 |
| 37.5° | 289.0 |
| 40° | 190.5 |
| 42.5° | 111.7 |
| 45° | 55.8 |
| 47.5° | 23.0 |
| 50° | 6.6 |
| 52.5° | 0.0 |
| 55° | 0.0 |
| 57.5° | 0.0 |
| 60° | 0.0 |
| 62.5° | 0.0 |
| 65° | 0.0 |
| 67.5° | 0.0 |
| 70° | 0.0 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)