

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P212056

Luminaire Tested: **LE\_4B30D010 EC4B30509035 4LBM1MW**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P212056  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LE\_4B30D010 EC4B30509035 4LBM1MW  
Description: PORTFOLIO 4 INCH CYLINDER  
MEDIUM DISTRIBUTION WITH MATTE WHITE TRIM  
WATTAGE D010TR-27.4W DE010-27.95W D5LT-27.65W DMX-27.73W DL2-29.56W  
DL3-29.67W DLE-29.73W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2295.0 lumens  
Efficiency: N/A  
Efficacy: 82.0 lumens/watt  
Spacing Criteria (0/90/45): 0.99 / 0.99 / 0.97  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P212056

CATALOG NUMBER: LE\_4B30D010 EC4B30509035 4LBM1MW

### Luminous Intensity Polar Plot

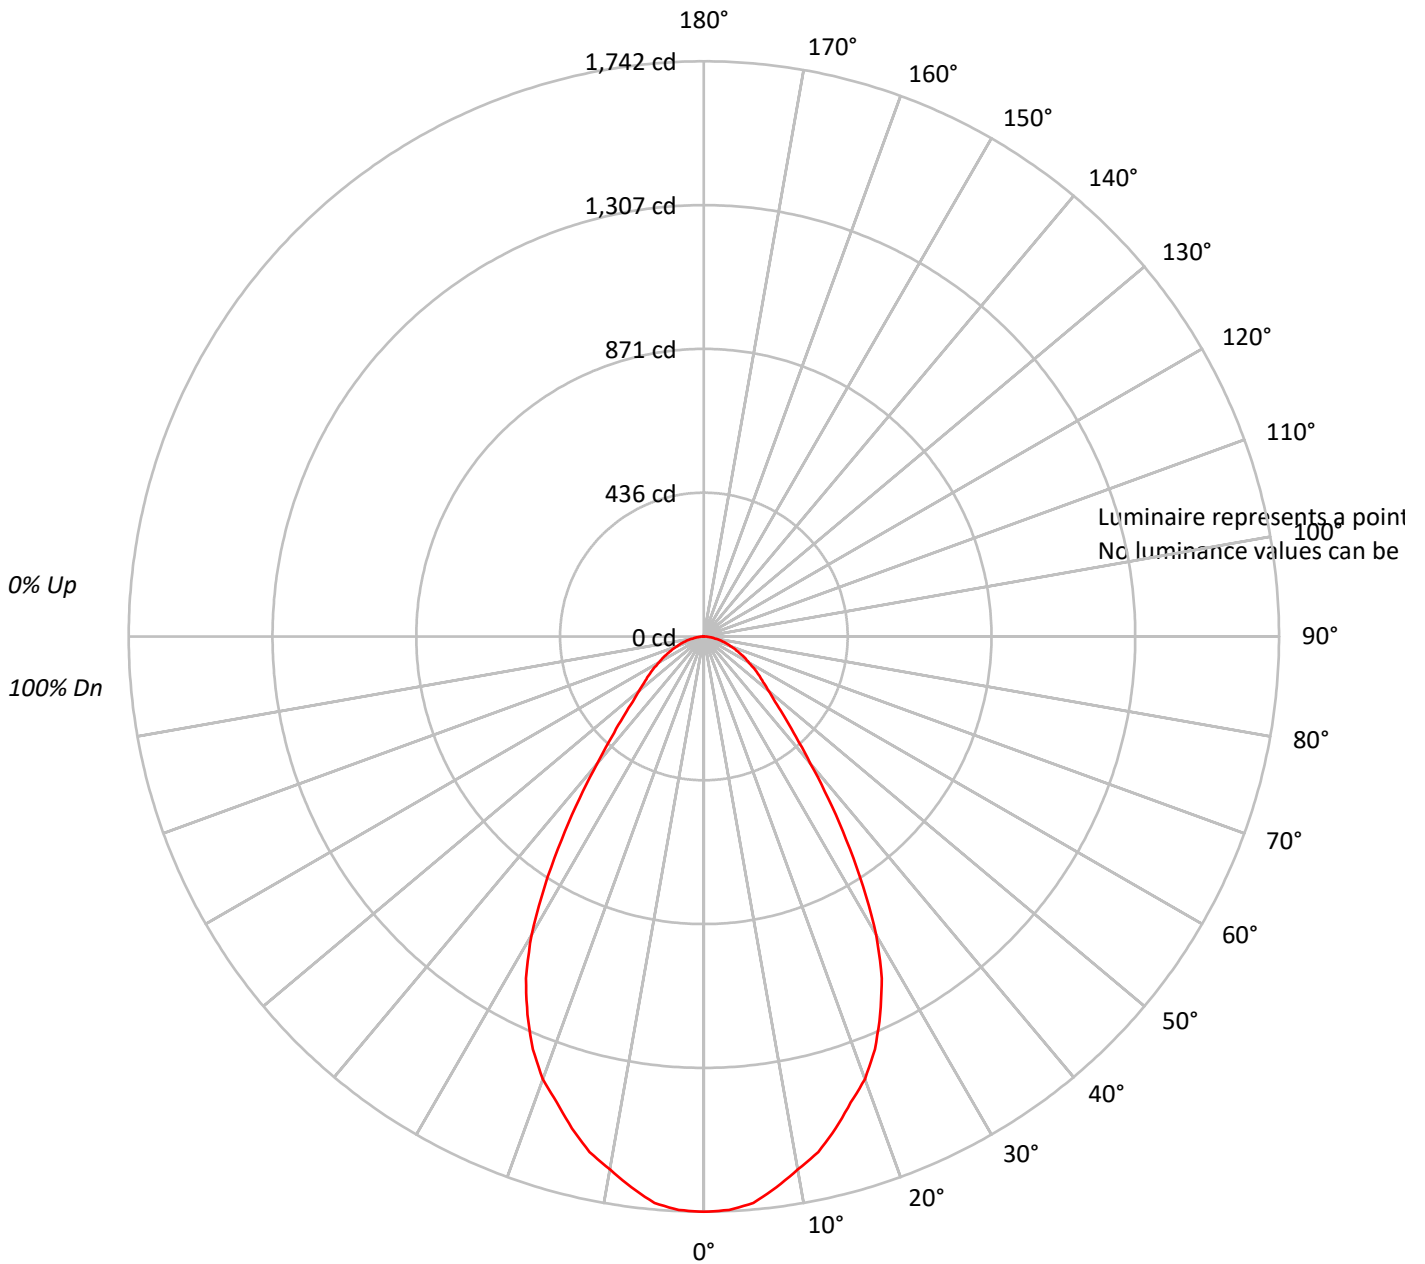



TEST NUMBER: P212056

CATALOG NUMBER: LE\_4B30D010 EC4B30509035 4LBM1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	91	89																			
2	104	98	92	88	102	96	91	87	93	89	85	89	86	83	87	84	81	80																			
3	97	89	83	77	95	87	82	77	85	80	76	82	78	74	80	76	73	71																			
4	91	81	74	69	89	80	74	69	78	72	68	76	71	67	74	69	66	64																			
5	85	75	67	62	83	74	67	62	72	66	61	70	65	61	68	64	60	58																			
6	80	69	62	56	78	68	61	56	66	60	56	65	59	55	63	59	55	53																			
7	75	64	57	52	74	63	56	51	62	56	51	60	55	51	59	54	50	49																			
8	71	59	52	47	69	59	52	47	58	51	47	56	51	47	55	50	47	45																			
9	67	55	48	44	66	55	48	44	54	48	44	53	47	43	52	47	43	42																			
10	63	52	45	41	62	51	45	41	51	45	40	50	44	40	49	44	40	39																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P212056

CATALOG NUMBER: LE\_4B30D010 EC4B30509035 4LBM1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	161.5	7.0
10°-20°	432.9	18.9
20°-30°	575.6	25.1
30°-40°	470.8	20.5
40°-50°	274.2	11.9
50°-60°	181.9	7.9
60°-70°	119.6	5.2
70°-80°	63.1	2.8
80°-90°	15.4	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1170.0	51.0
0°-40°	1640.8	71.5
0°-60°	2096.9	91.4
0°-90°	2295.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2295.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1742	
5°	1722	161
15°	1543	433
25°	1263	576
35°	751	471
45°	346	274
55°	203	182
65°	120	120
75°	60	63
85°	13	15
90°	0	



TEST NUMBER: P212056

CATALOG NUMBER: LE\_4B30D010 EC4B30509035 4LBM1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1742.2
2.5°	1738.8
5°	1722.3
7.5°	1682.3
10°	1639.1
12.5°	1599.2
15°	1542.7
17.5°	1479.5
20°	1426.3
22.5°	1353.1
25°	1263.4
27.5°	1167.0
30°	1044.0
32.5°	897.7
35°	751.3
37.5°	618.4
40°	502.0
42.5°	412.3
45°	345.8
47.5°	292.6
50°	256.0
52.5°	226.1
55°	202.8
57.5°	179.6
60°	156.3
62.5°	139.7
65°	119.7
67.5°	103.1
70°	86.4
72.5°	73.2
75°	59.9
77.5°	46.5
80°	33.3
82.5°	23.3
85°	13.3
87.5°	3.4
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)