

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P211835

Luminaire Tested: **LSR4B30D010BZ EC4B30509024 4LBSH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P211835
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LSR4B30D010BZ EC4B30509024 4LBSH1
Description: PORTFOLIO 4 INCH CYLINDER
SHALLOW DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM
WATTAGE D010TR-27.4W DE010-27.95W D5LT-27.65W DMX-27.73W DL2-29.56W
DL3-29.67W DLE-29.73W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2071.0 lumens
Efficiency: N/A
Efficacy: 74.0 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.06 / 1.17
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 28
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P211835

CATALOG NUMBER: LSR4B30D010BZ EC4B30509024 4LBSH1

Luminous Intensity Polar Plot

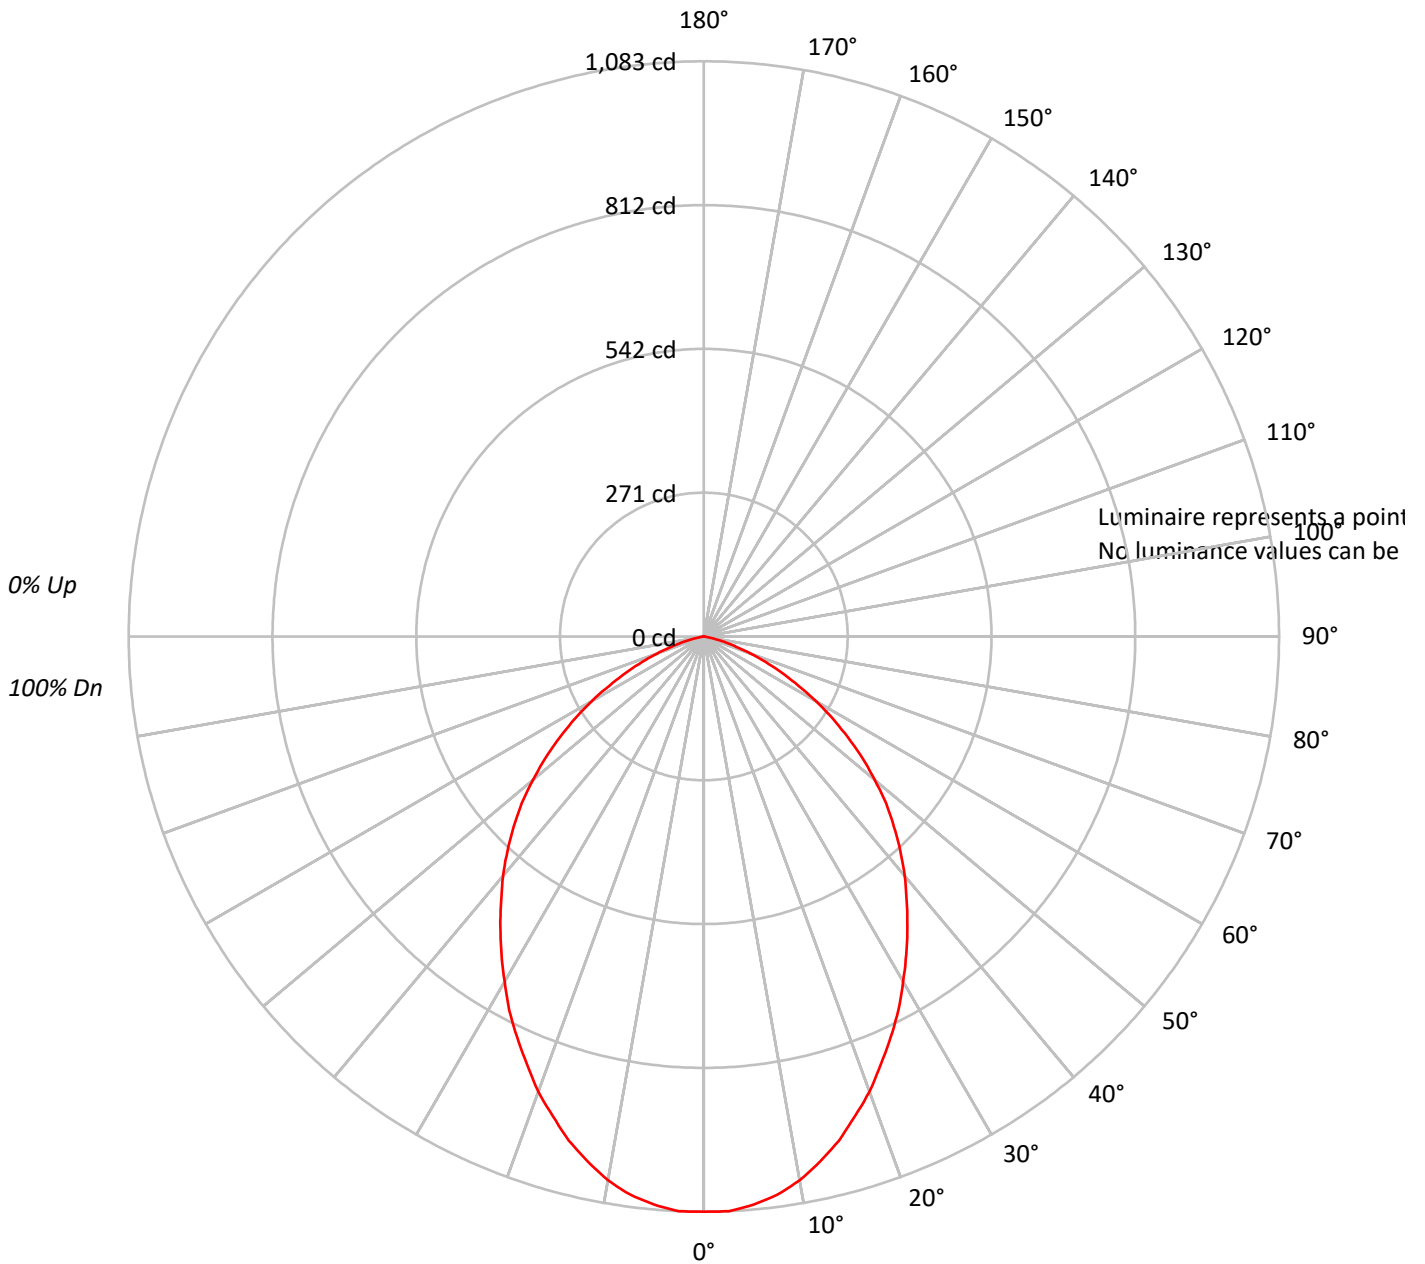



TEST NUMBER: P211835

CATALOG NUMBER: LSR4B30D010BZ EC4B30509024 4LBSH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 111 | 107 | 104 | 101 | 108 | 105 | 102 | 99 | 101 | 98 | 96 | 97 | 95 | 93 | 93 | 92 | 90 | 88 | | | | | | | | | | | | | | | | | | | |
| 2 | 102 | 96 | 90 | 85 | 100 | 94 | 88 | 84 | 90 | 86 | 82 | 87 | 83 | 80 | 84 | 81 | 79 | 77 | | | | | | | | | | | | | | | | | | | |
| 3 | 95 | 85 | 78 | 73 | 92 | 84 | 77 | 72 | 81 | 75 | 71 | 78 | 74 | 70 | 76 | 72 | 69 | 67 | | | | | | | | | | | | | | | | | | | |
| 4 | 87 | 77 | 69 | 63 | 85 | 75 | 68 | 63 | 73 | 67 | 62 | 71 | 65 | 61 | 69 | 64 | 60 | 58 | | | | | | | | | | | | | | | | | | | |
| 5 | 81 | 69 | 61 | 55 | 79 | 68 | 61 | 55 | 66 | 60 | 55 | 64 | 59 | 54 | 63 | 58 | 53 | 51 | | | | | | | | | | | | | | | | | | | |
| 6 | 75 | 63 | 55 | 49 | 73 | 62 | 54 | 49 | 60 | 54 | 49 | 59 | 53 | 48 | 57 | 52 | 48 | 46 | | | | | | | | | | | | | | | | | | | |
| 7 | 70 | 58 | 50 | 44 | 68 | 57 | 49 | 44 | 55 | 49 | 44 | 54 | 48 | 43 | 53 | 47 | 43 | 41 | | | | | | | | | | | | | | | | | | | |
| 8 | 65 | 53 | 45 | 40 | 64 | 52 | 45 | 40 | 51 | 44 | 39 | 50 | 44 | 39 | 49 | 43 | 39 | 37 | | | | | | | | | | | | | | | | | | | |
| 9 | 61 | 49 | 41 | 36 | 60 | 48 | 41 | 36 | 47 | 40 | 36 | 46 | 40 | 36 | 45 | 40 | 35 | 34 | | | | | | | | | | | | | | | | | | | |
| 10 | 58 | 45 | 38 | 33 | 56 | 45 | 38 | 33 | 44 | 37 | 33 | 43 | 37 | 33 | 42 | 37 | 33 | 31 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P211835

CATALOG NUMBER: LSR4B30D010BZ EC4B30509024 4LBSH1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 101.5 | 4.9 |
| 10°-20° | 275.7 | 13.3 |
| 20°-30° | 383.0 | 18.5 |
| 30°-40° | 417.9 | 20.2 |
| 40°-50° | 389.8 | 18.8 |
| 50°-60° | 295.9 | 14.3 |
| 60°-70° | 162.0 | 7.8 |
| 70°-80° | 44.6 | 2.2 |
| 80°-90° | 0.6 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 760.2 | 36.7 |
| 0°-40° | 1178.1 | 56.9 |
| 0°-60° | 1863.8 | 90.0 |
| 0°-90° | 2071.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 2071.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1083 | |
| 5° | 1074 | 101 |
| 15° | 983 | 276 |
| 25° | 832 | 383 |
| 35° | 668 | 418 |
| 45° | 506 | 390 |
| 55° | 331 | 296 |
| 65° | 162 | 162 |
| 75° | 39 | 45 |
| 85° | 0 | 1 |
| 90° | 0 | |



TEST NUMBER: P211835

CATALOG NUMBER: LSR4B30D010BZ EC4B30509024 4LBSH1

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 1083.1 |
| 2.5° | 1083.1 |
| 5° | 1074.0 |
| 7.5° | 1060.3 |
| 10° | 1039.8 |
| 12.5° | 1012.4 |
| 15° | 982.8 |
| 17.5° | 946.3 |
| 20° | 912.1 |
| 22.5° | 871.1 |
| 25° | 832.3 |
| 27.5° | 793.5 |
| 30° | 750.2 |
| 32.5° | 709.2 |
| 35° | 668.1 |
| 37.5° | 627.1 |
| 40° | 588.3 |
| 42.5° | 547.3 |
| 45° | 506.2 |
| 47.5° | 465.2 |
| 50° | 419.6 |
| 52.5° | 376.2 |
| 55° | 330.6 |
| 57.5° | 287.3 |
| 60° | 244.0 |
| 62.5° | 200.7 |
| 65° | 161.9 |
| 67.5° | 125.4 |
| 70° | 93.5 |
| 72.5° | 63.8 |
| 75° | 38.8 |
| 77.5° | 18.2 |
| 80° | 4.6 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)