

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P212061

Luminaire Tested: **LSR4B30D010BZ EC4B30509035 4LBNI1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P212061  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR4B30D010BZ EC4B30509035 4LBNI1  
Description: PORTFOLIO 4 INCH CYLINDER  
NARROW DISTRIBUTION WITH SPECULAR CLEAR TRIM  
WATTAGE D010TR-27.4W DE010-27.95W D5LT-27.65W DMX-27.73W DL2-29.56W  
DL3-29.67W DLE-29.73W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1860.8 lumens  
Efficiency: N/A  
Efficacy: 66.5 lumens/watt  
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.54  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P212061

CATALOG NUMBER: LSR4B30D010BZ EC4B30509035 4LBNLI1

### Luminous Intensity Polar Plot

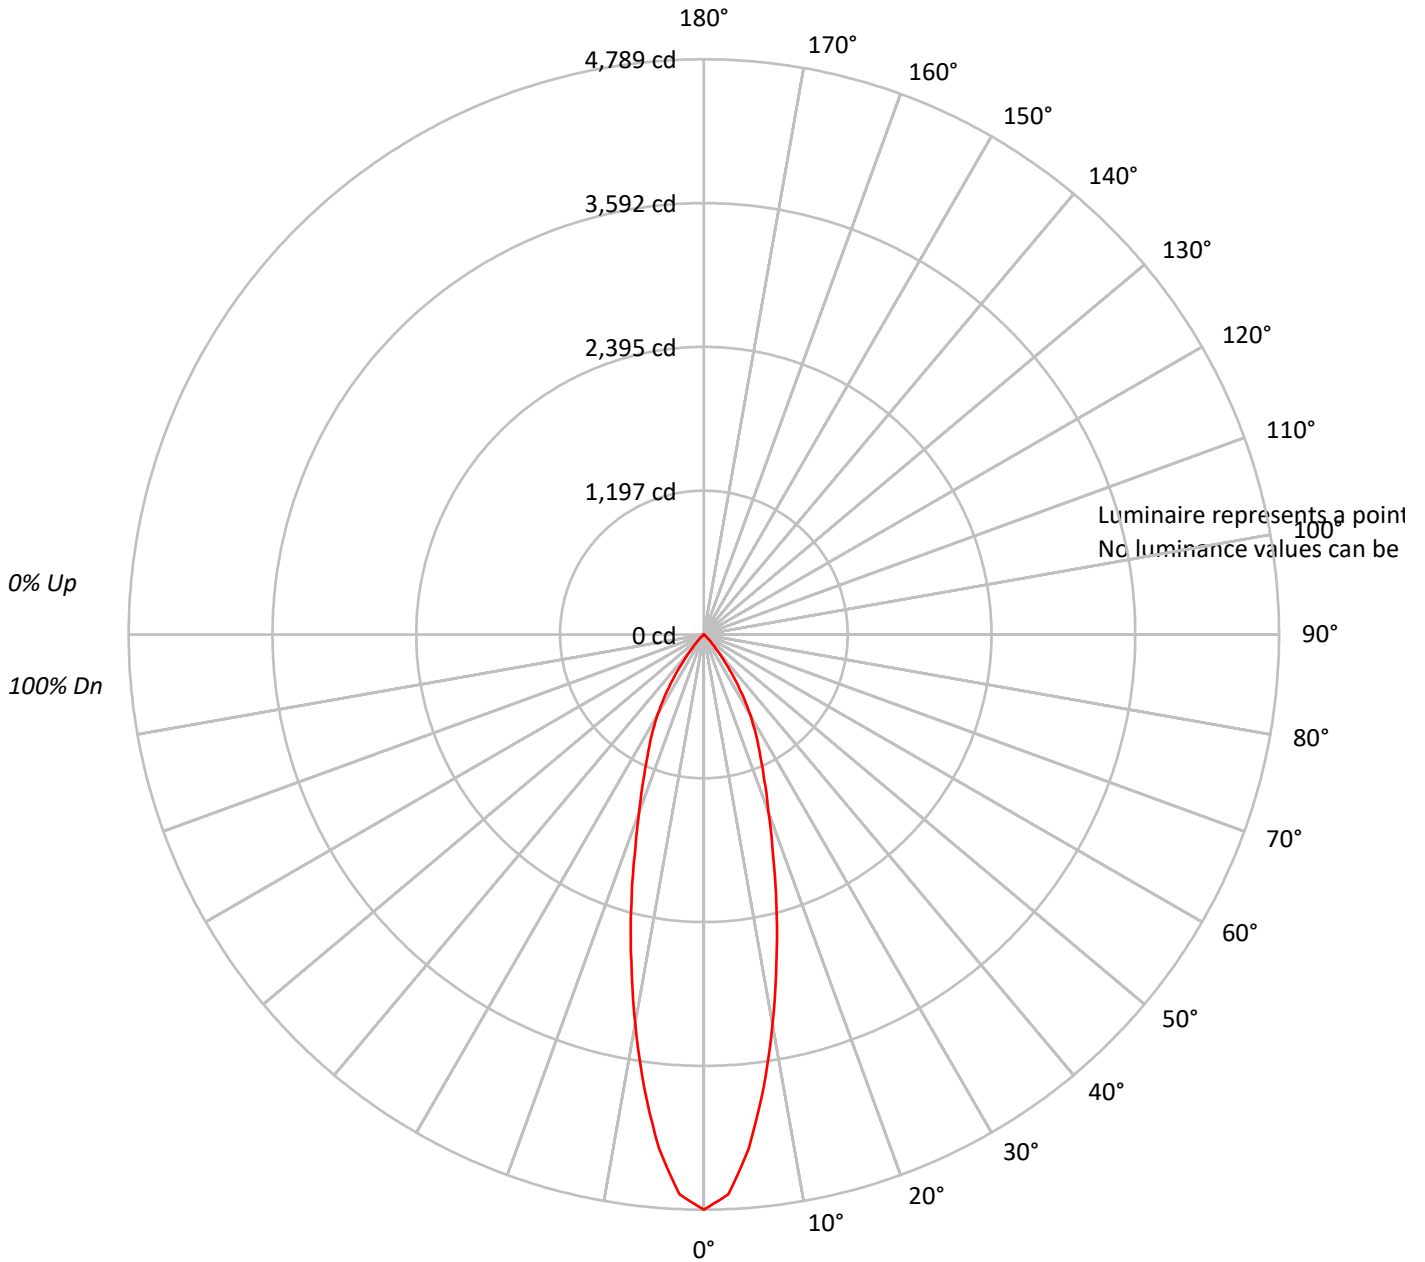



TEST NUMBER: P212061

CATALOG NUMBER: LSR4B30D010BZ EC4B30509035 4LBNLI1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95			95																
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	92	90			90																
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85																
4	101	94	89	86	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81																
5	96	89	84	80	95	88	84	80	87	82	79	85	81	79	83	80	78	77			77																
6	92	85	80	76	91	84	79	76	83	78	75	81	78	75	80	77	74	73			73																
7	89	81	76	72	88	80	75	72	79	75	71	78	74	71	77	73	71	69			69																
8	85	77	72	68	84	77	72	68	76	71	68	75	71	68	74	70	67	66			66																
9	82	74	69	65	81	73	68	65	72	68	65	72	68	65	71	67	64	63			63																
10	79	71	66	62	78	70	65	62	69	65	62	69	65	62	68	64	62	61			61																

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P212061

CATALOG NUMBER: LSR4B30D010BZ EC4B30509035 4LBNLI1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	377.4	20.3
10°-20°	646.1	34.7
20°-30°	513.5	27.6
30°-40°	271.8	14.6
40°-50°	46.8	2.5
50°-60°	3.5	0.2
60°-70°	1.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1536.9	82.6
0°-40°	1808.7	97.2
0°-60°	1859.1	99.9
0°-90°	1860.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1860.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4789	
5°	4293	377
15°	2336	646
25°	1106	513
35°	430	272
45°	49	47
55°	3	4
65°	3	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P212061

CATALOG NUMBER: LSR4B30D010BZ EC4B30509035 4LBNLI1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4788.8
2.5°	4665.6
5°	4293.0
7.5°	3805.8
10°	3290.0
12.5°	2791.3
15°	2335.6
17.5°	1911.5
20°	1573.3
22.5°	1315.4
25°	1106.2
27.5°	937.1
30°	768.0
32.5°	596.1
35°	429.9
37.5°	283.7
40°	169.1
42.5°	97.4
45°	48.7
47.5°	17.2
50°	5.7
52.5°	5.7
55°	2.9
57.5°	2.9
60°	2.9
62.5°	2.9
65°	2.9
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)