

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P212314

Luminaire Tested: **LSR4B40D010BZ EC4B30508030 4LBMGPH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P212314  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR4B40D010BZ EC4B30508030 4LBMGPH1  
Description: PORTFOLIO 4 INCH CYLINDER  
MEDIUM DISTRIBUTION WITH GRAPHITE HAZE TRIM  
WATTAGE D010TR-43.02W DE010-42.54W D5LT-42.539W DMX-41.87W DL2-41.57W  
DL3-44.71W DLE-39.33W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2206.8 lumens  
Efficiency: N/A  
Efficacy: 52.8 lumens/watt  
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.92  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P212314

CATALOG NUMBER: LSR4B40D010BZ EC4B30508030 4LBMGPH1

### Luminous Intensity Polar Plot

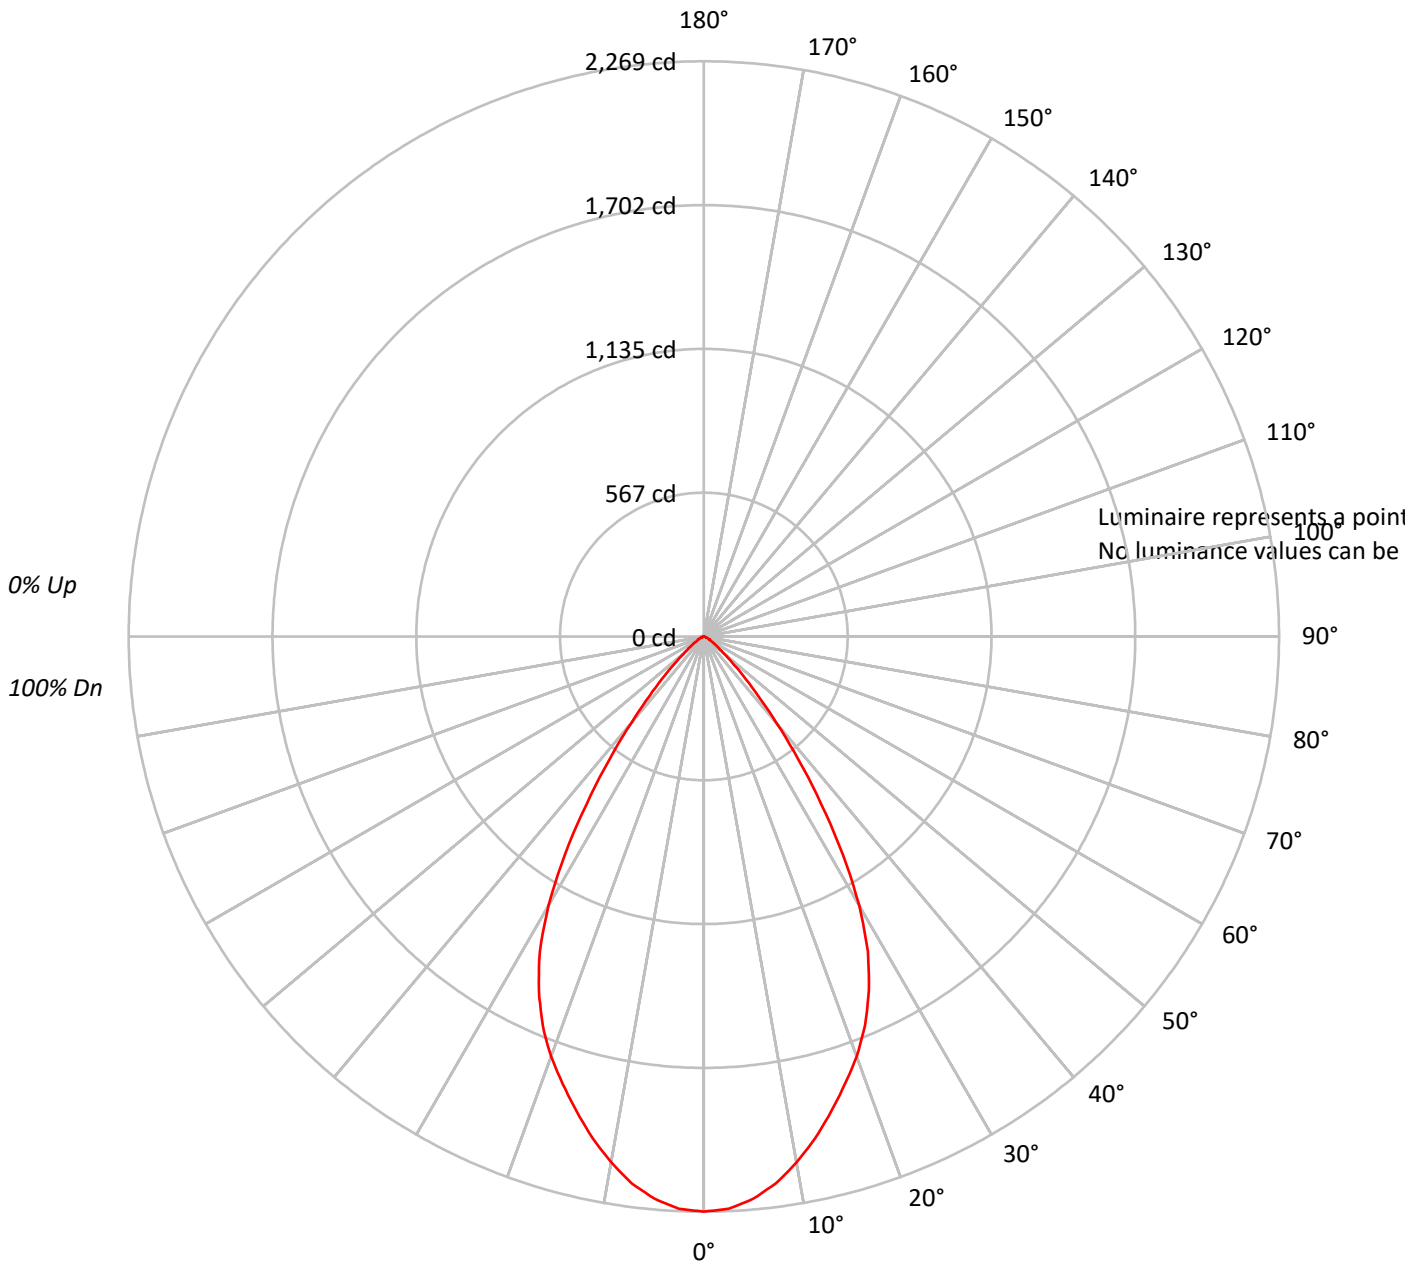



TEST NUMBER: P212314

CATALOG NUMBER: LSR4B40D010BZ EC4B30508030 4LBMGPH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	108	105	111	108	106	104	104	102	101	100	99	98	97	96	95	93																			
2	107	102	98	94	105	100	97	93	97	94	91	94	92	89	91	89	88	86																			
3	102	95	90	85	100	93	89	85	91	87	83	88	85	82	86	83	81	79																			
4	96	88	82	78	94	87	82	78	85	80	77	83	79	76	81	78	75	73																			
5	91	82	76	72	89	81	76	71	79	74	71	78	73	70	76	72	69	68																			
6	86	77	71	66	85	76	70	66	74	69	65	73	68	65	72	68	64	63																			
7	82	72	66	61	80	71	65	61	70	65	61	69	64	60	68	63	60	59																			
8	77	67	61	57	76	67	61	57	66	60	57	65	60	56	64	59	56	55																			
9	73	63	57	53	72	63	57	53	62	57	53	61	56	53	60	56	52	51																			
10	70	60	54	50	69	59	54	50	59	53	50	58	53	49	57	52	49	48																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P212314

CATALOG NUMBER: LSR4B40D010BZ EC4B30508030 4LBMGPH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	208.8	9.5
10°-20°	544.4	24.7
20°-30°	698.3	31.6
30°-40°	504.7	22.9
40°-50°	181.0	8.2
50°-60°	48.8	2.2
60°-70°	16.0	0.7
70°-80°	4.9	0.2
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1451.5	65.8
0°-40°	1956.2	88.6
0°-60°	2186.0	99.1
0°-90°	2206.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2206.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2269	
5°	2227	209
15°	1939	544
25°	1540	698
35°	807	505
45°	218	181
55°	51	49
65°	14	16
75°	5	5
85°	0	0
90°	0	



TEST NUMBER: P212314

CATALOG NUMBER: LSR4B40D010BZ EC4B30508030 4LBMGPH1

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	2268.8
2.5°	2259.5
5°	2227.0
7.5°	2176.0
10°	2106.4
12.5°	2027.5
15°	1939.4
17.5°	1851.2
20°	1763.1
22.5°	1661.0
25°	1540.4
27.5°	1401.2
30°	1224.9
32.5°	1020.7
35°	807.3
37.5°	612.4
40°	445.4
42.5°	315.5
45°	218.1
47.5°	148.5
50°	97.4
52.5°	69.6
55°	51.0
57.5°	37.1
60°	27.8
62.5°	23.2
65°	13.9
67.5°	9.3
70°	9.3
72.5°	4.6
75°	4.6
77.5°	4.6
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)