

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P212379

Luminaire Tested: **LSR4B40D010BZ EC4B30509730 4LBNH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P212379  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR4B40D010BZ EC4B30509730 4LBNH1  
Description: PORTFOLIO 4 INCH CYLINDER  
NARROW DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM  
WATTAGE D010TR-43.02W DE010-42.54W D5LT-42.539W DMX-41.87W DL2-41.57W  
DL3-44.71W DLE-39.33W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1907.0 lumens  
Efficiency: N/A  
Efficacy: 45.6 lumens/watt  
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.85  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P212379

CATALOG NUMBER: LSR4B40D010BZ EC4B30509730 4LBNH1

### Luminous Intensity Polar Plot

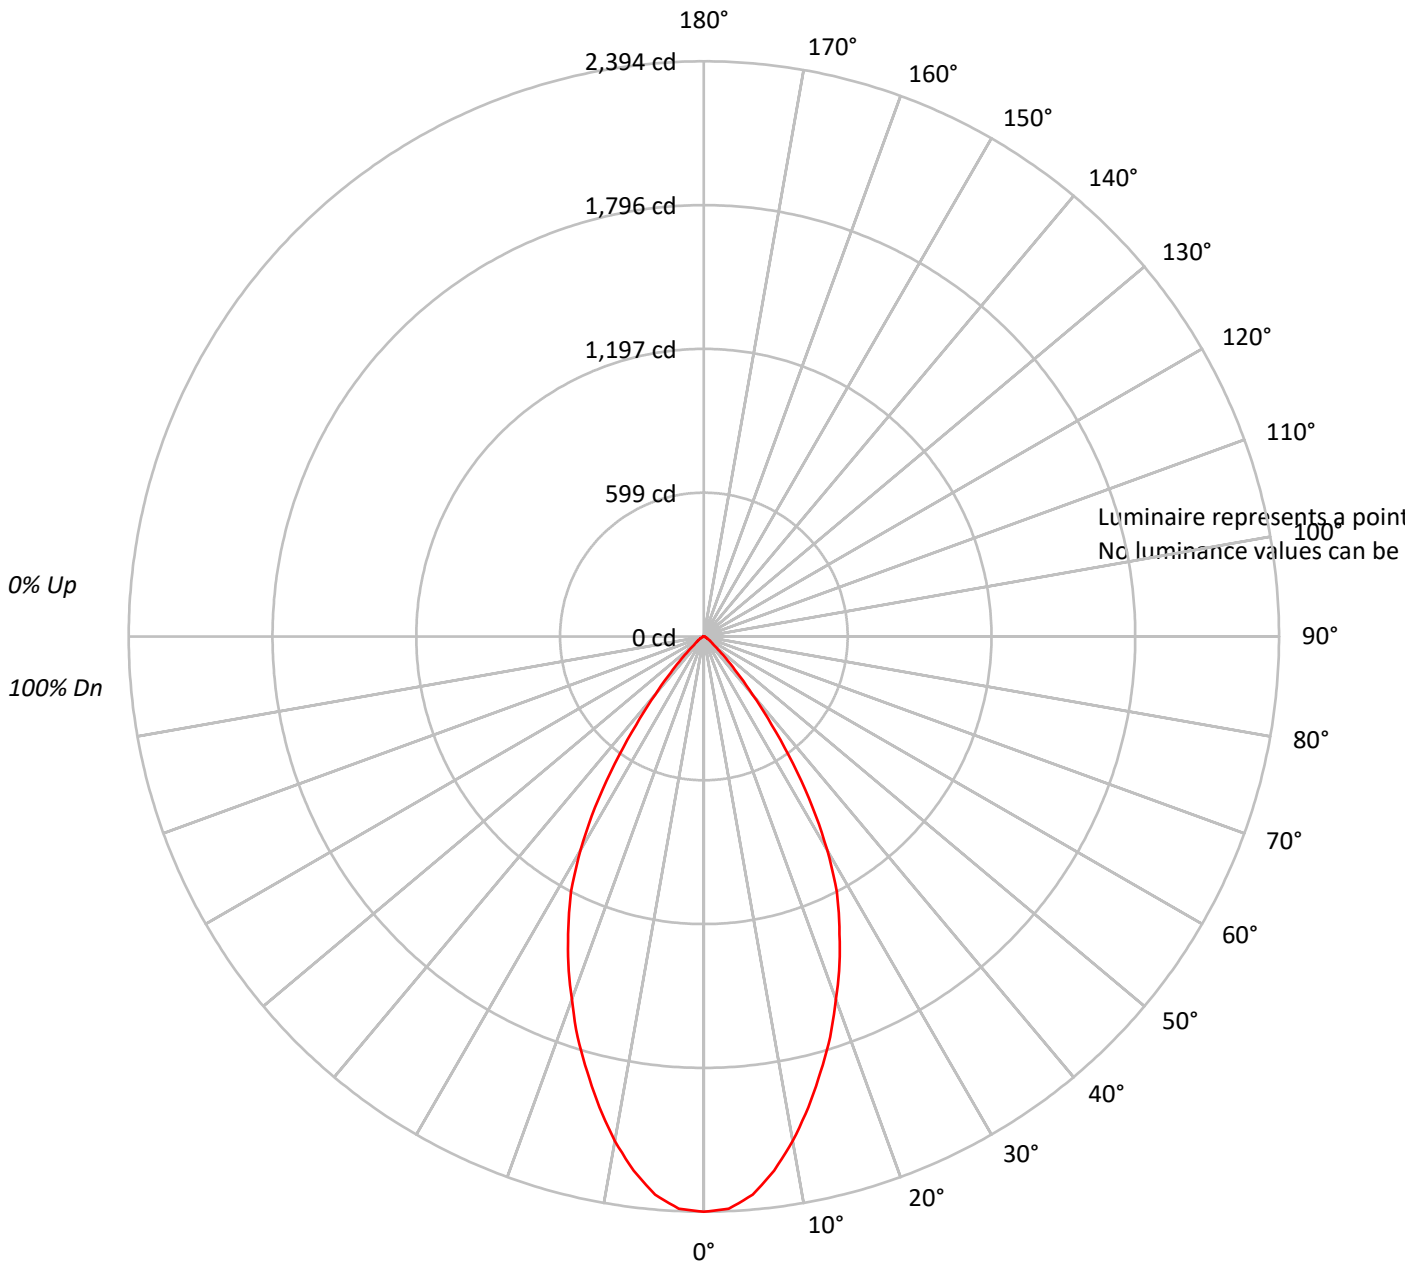



TEST NUMBER: P212379

CATALOG NUMBER: LSR4B40D010BZ EC4B30509730 4LBNH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	93																			
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75																			
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70																			
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65																			
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61																			
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58																			
9	76	66	60	56	74	65	60	56	65	59	56	64	59	56	63	59	55	54																			
10	72	62	57	53	71	62	56	53	61	56	53	60	56	52	60	55	52	51																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P212379

CATALOG NUMBER: LSR4B40D010BZ EC4B30509730 4LBNH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	216.0	11.3
10°-20°	524.0	27.5
20°-30°	608.4	31.9
30°-40°	402.9	21.1
40°-50°	113.0	5.9
50°-60°	28.4	1.5
60°-70°	10.6	0.6
70°-80°	3.7	0.2
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1348.4	70.7
0°-40°	1751.3	91.8
0°-60°	1892.7	99.2
0°-90°	1907.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1907.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2394	
5°	2332	216
15°	1876	524
25°	1334	608
35°	646	403
45°	131	113
55°	31	28
65°	10	11
75°	4	4
85°	0	0
90°	0	



TEST NUMBER: P212379

CATALOG NUMBER: LSR4B40D010BZ EC4B30509730 4LBNH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2394.3
2.5°	2383.9
5°	2332.1
7.5°	2242.3
10°	2131.7
12.5°	2007.3
15°	1876.0
17.5°	1748.2
20°	1606.6
22.5°	1475.3
25°	1333.6
27.5°	1198.9
30°	1026.1
32.5°	843.0
35°	646.1
37.5°	463.0
40°	314.4
42.5°	203.8
45°	131.3
47.5°	79.5
50°	51.8
52.5°	38.0
55°	31.1
57.5°	24.2
60°	17.3
62.5°	13.8
65°	10.4
67.5°	6.9
70°	6.9
72.5°	3.5
75°	3.5
77.5°	3.5
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)