

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P212402

Luminaire Tested: **LSR4B40D010BZ EC4B30508035 4LBMGPH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P212402
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LSR4B40D010BZ EC4B30508035 4LBMGPH1
Description: PORTFOLIO 4 INCH CYLINDER
MEDIUM DISTRIBUTION WITH GRAPHITE HAZE TRIM
WATTAGE D010TR-43.02W DE010-42.54W D5LT-42.539W DMX-41.87W DL2-41.57W
DL3-44.71W DLE-39.33W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2261.5 lumens
Efficiency: N/A
Efficacy: 54.1 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.92
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P212402

CATALOG NUMBER: LSR4B40D010BZ EC4B30508035 4LBMGPH1

Luminous Intensity Polar Plot

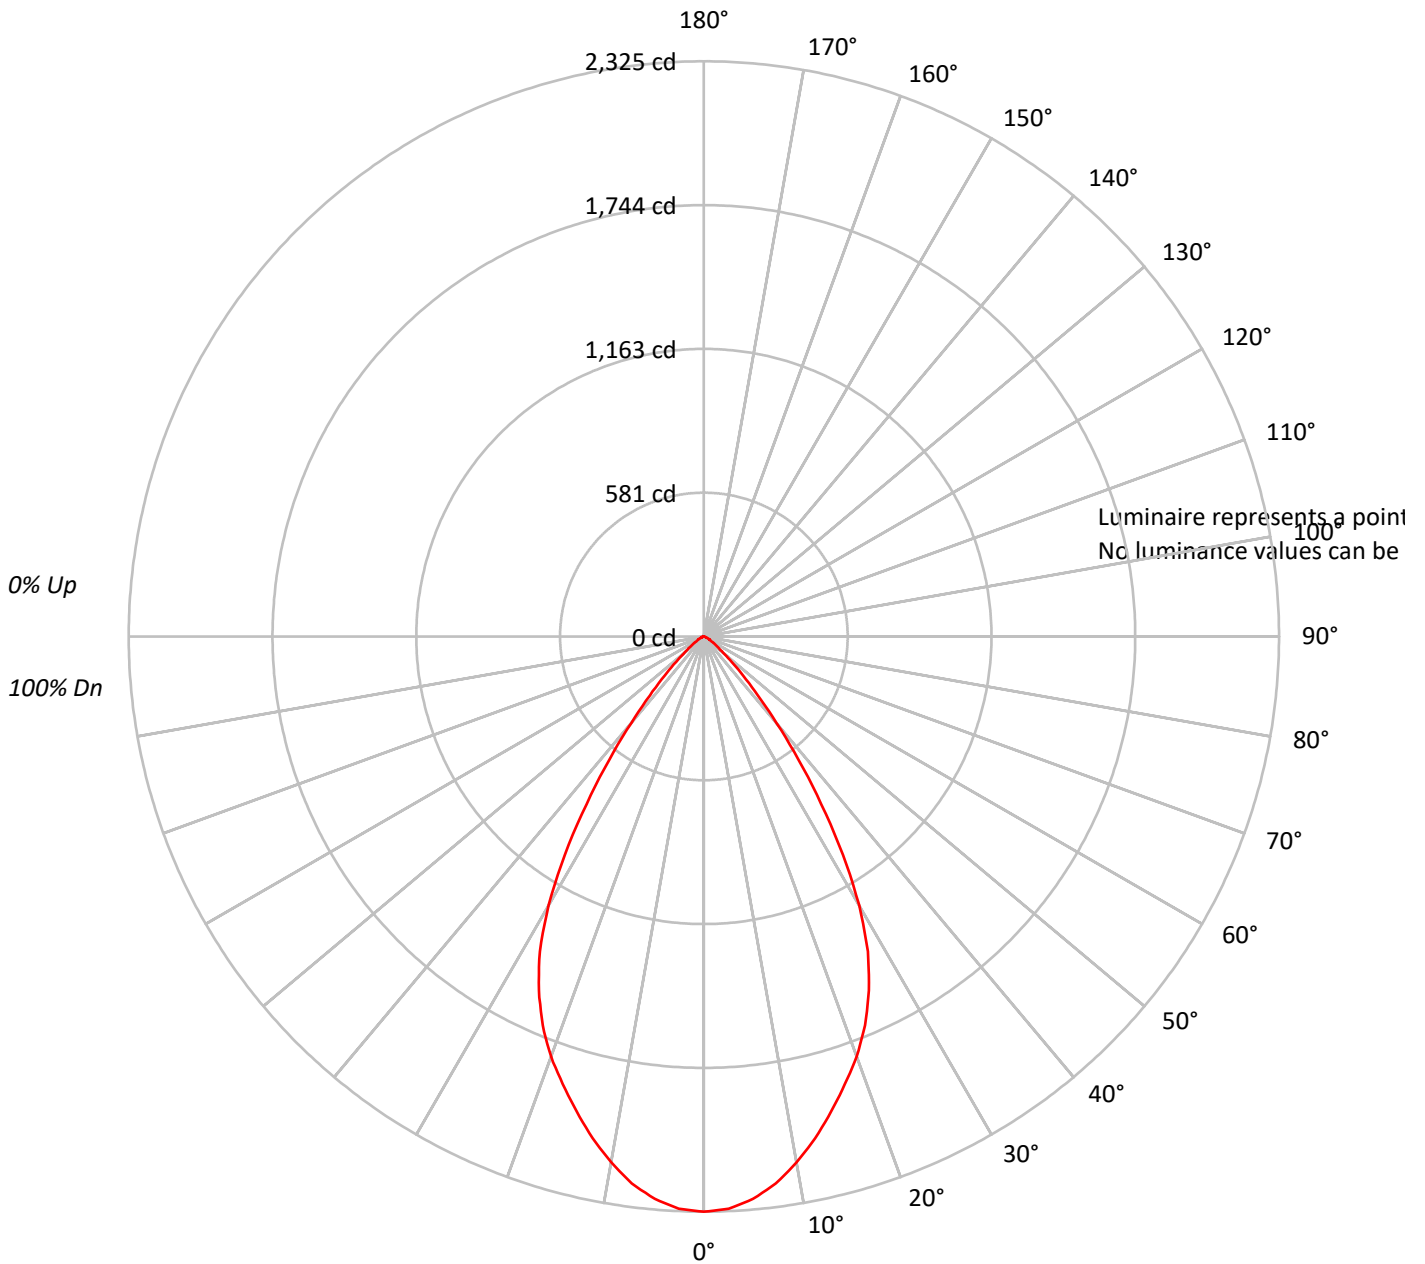



TEST NUMBER: P212402

CATALOG NUMBER: LSR4B40D010BZ EC4B30508035 4LBMGPH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |
| 1 | 113 | 110 | 108 | 105 | 111 | 108 | 106 | 104 | 104 | 102 | 101 | 100 | 99 | 98 | 97 | 96 | 95 | 93 |
| 2 | 107 | 102 | 98 | 94 | 105 | 100 | 97 | 93 | 97 | 94 | 91 | 94 | 92 | 89 | 91 | 89 | 88 | 86 |
| 3 | 102 | 95 | 90 | 85 | 100 | 93 | 89 | 85 | 91 | 87 | 83 | 88 | 85 | 82 | 86 | 83 | 81 | 79 |
| 4 | 96 | 88 | 82 | 78 | 94 | 87 | 82 | 78 | 85 | 80 | 77 | 83 | 79 | 76 | 81 | 78 | 75 | 73 |
| 5 | 91 | 82 | 76 | 72 | 89 | 81 | 76 | 71 | 79 | 74 | 71 | 78 | 73 | 70 | 76 | 72 | 69 | 68 |
| 6 | 86 | 77 | 71 | 66 | 85 | 76 | 70 | 66 | 74 | 69 | 65 | 73 | 68 | 65 | 72 | 68 | 64 | 63 |
| 7 | 82 | 72 | 66 | 61 | 80 | 71 | 65 | 61 | 70 | 65 | 61 | 69 | 64 | 60 | 68 | 63 | 60 | 59 |
| 8 | 77 | 67 | 61 | 57 | 76 | 67 | 61 | 57 | 66 | 60 | 57 | 65 | 60 | 56 | 64 | 59 | 56 | 55 |
| 9 | 73 | 63 | 57 | 53 | 72 | 63 | 57 | 53 | 62 | 57 | 53 | 61 | 56 | 53 | 60 | 56 | 52 | 51 |
| 10 | 70 | 60 | 54 | 50 | 69 | 59 | 54 | 50 | 59 | 53 | 50 | 58 | 53 | 49 | 57 | 52 | 49 | 48 |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P212402

CATALOG NUMBER: LSR4B40D010BZ EC4B30508035 4LBMGPH1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 213.9 | 9.5 |
| 10°-20° | 557.9 | 24.7 |
| 20°-30° | 715.6 | 31.6 |
| 30°-40° | 517.2 | 22.9 |
| 40°-50° | 185.4 | 8.2 |
| 50°-60° | 50.0 | 2.2 |
| 60°-70° | 16.4 | 0.7 |
| 70°-80° | 5.0 | 0.2 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1487.4 | 65.8 |
| 0°-40° | 2004.6 | 88.6 |
| 0°-60° | 2240.1 | 99.1 |
| 0°-90° | 2261.5 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 2261.5 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2325 | |
| 5° | 2282 | 214 |
| 15° | 1987 | 558 |
| 25° | 1578 | 716 |
| 35° | 827 | 517 |
| 45° | 224 | 185 |
| 55° | 52 | 50 |
| 65° | 14 | 16 |
| 75° | 5 | 5 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P212402

CATALOG NUMBER: LSR4B40D010BZ EC4B30508035 4LBMGPH1

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 2325.0 |
| 2.5° | 2315.5 |
| 5° | 2282.2 |
| 7.5° | 2229.9 |
| 10° | 2158.6 |
| 12.5° | 2077.7 |
| 15° | 1987.4 |
| 17.5° | 1897.1 |
| 20° | 1806.7 |
| 22.5° | 1702.1 |
| 25° | 1578.5 |
| 27.5° | 1435.9 |
| 30° | 1255.2 |
| 32.5° | 1046.0 |
| 35° | 827.3 |
| 37.5° | 627.6 |
| 40° | 456.4 |
| 42.5° | 323.3 |
| 45° | 223.5 |
| 47.5° | 152.1 |
| 50° | 99.8 |
| 52.5° | 71.3 |
| 55° | 52.3 |
| 57.5° | 38.0 |
| 60° | 28.5 |
| 62.5° | 23.8 |
| 65° | 14.3 |
| 67.5° | 9.5 |
| 70° | 9.5 |
| 72.5° | 4.8 |
| 75° | 4.8 |
| 77.5° | 4.8 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)