

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P430919

Luminaire Tested: **LAMR4B112R159024DE010x1MMS**

Issue Date: 11/23/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P430919  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-1911-585-6)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 11/23/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LAMR4B112R159024DE010x1MMS  
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 15 DEG TIR OPTIC  
Light Source: HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1040.0 lumens  
Efficiency: N/A  
Efficacy: 72.7 lumens/watt  
Spacing Criteria (0/90/45): 0.3 / 0.3 / 0.29  
Luminous Opening: Circular (Dia: 0.29' x H: 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P430919

CATALOG NUMBER: LAMR4B112R159024DE010x1MMS

### Luminous Intensity Polar Plot

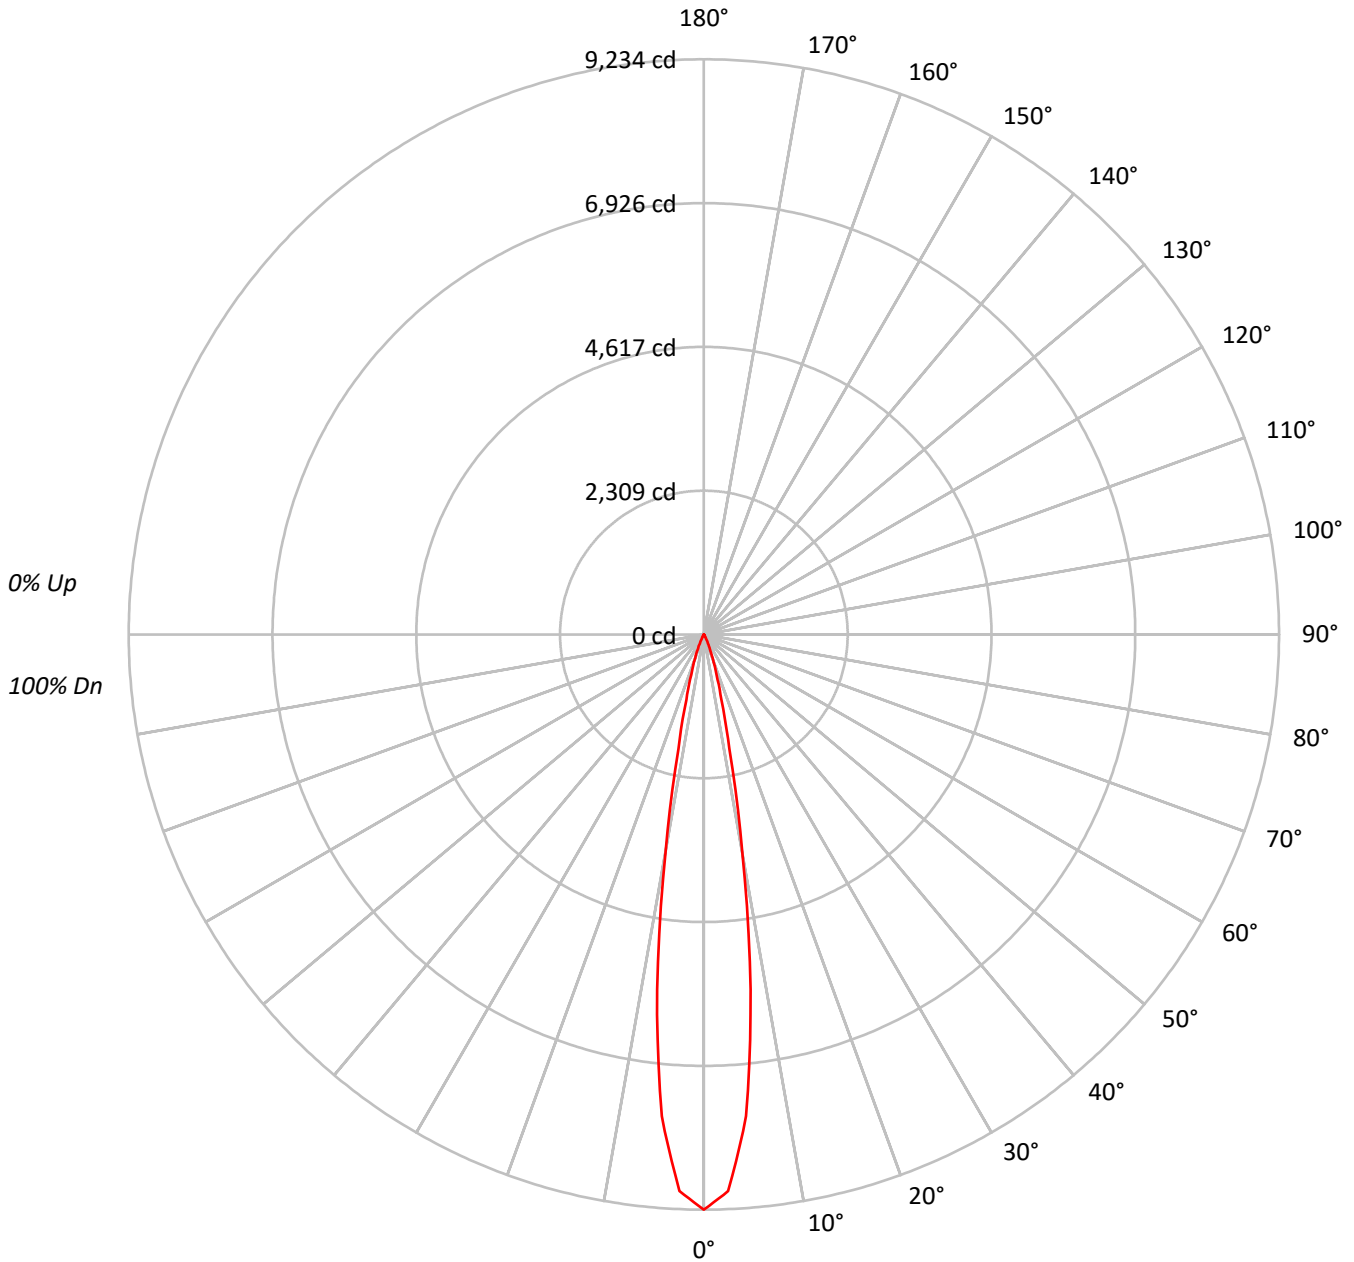



TEST NUMBER: P430919

CATALOG NUMBER: LAMR4B112R159024DE010x1MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98	98	98	98
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	99	98	96	96	96	96
3	110	106	103	101	108	105	102	100	103	100	98	100	99	97	98	97	96	94	94	94	94
4	108	103	100	97	106	102	99	97	100	98	96	98	96	95	97	95	94	93	93	93	93
5	105	101	97	95	104	100	97	94	98	96	94	97	95	93	95	94	92	91	91	91	91
6	103	98	95	92	102	98	94	92	96	94	92	95	93	91	94	92	91	90	90	90	90
7	101	96	93	90	100	96	92	90	95	92	90	94	91	89	93	91	89	88	88	88	88
8	99	94	91	89	99	94	91	89	93	90	88	92	90	88	91	89	88	87	87	87	87
9	98	92	89	87	97	92	89	87	91	89	87	91	88	87	90	88	86	86	86	86	86
10	96	91	88	86	95	91	88	86	90	87	85	89	87	85	89	87	85	84	84	84	84

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1487649
5°	1255523
10°	576815
15°	179863
20°	73292
25°	24051
30°	7460
35°	1573
40°	400
45°	0
50°	0
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P430919

CATALOG NUMBER: LAMR4B112R159024DE010x1MMS

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	599.1	57.6
10°-20°	357.0	34.3
20°-30°	75.7	7.3
30°-40°	8.0	0.8
40°-50°	0.3	0.0
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1031.8	99.2
0°-40°	1039.8	100.0
0°-60°	1040.0	100.0
0°-90°	1040.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1040.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9234	
5°	7764	599
15°	1078	357
25°	135	76
35°	8	8
45°	0	0
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P430919

CATALOG NUMBER: LAMR4B112R159024DE010x1MMS

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	9234.1
2.5°	8942.4
5°	7763.6
7.5°	5747.3
10°	3526.0
12.5°	1881.5
15°	1078.4
17.5°	677.3
20°	427.5
22.5°	252.2
25°	135.3
27.5°	76.4
30°	40.1
32.5°	20.3
35°	8.0
37.5°	4.2
40°	1.9
42.5°	0.5
45°	0.0
47.5°	0.0
50°	0.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)