

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P429842

Luminaire Tested: **LAM4B112R309027DE010x1MMS**

Issue Date: 11/23/2020

Test Information

Test Method: LM-41-14
Report Number: P429842
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2007-857-8)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 11/23/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LAM4B112R309027DE010x1MMS
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 30 DEG TIR OPTIC
Light Source: HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1143.5 lumens
Efficiency: N/A
Efficacy: 80.0 lumens/watt
Spacing Criteria (0/90/45): 0.51 / 0.51 / 0.46
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P429842

CATALOG NUMBER: LAM4B112R309027DE010x1MMS

Luminous Intensity Polar Plot

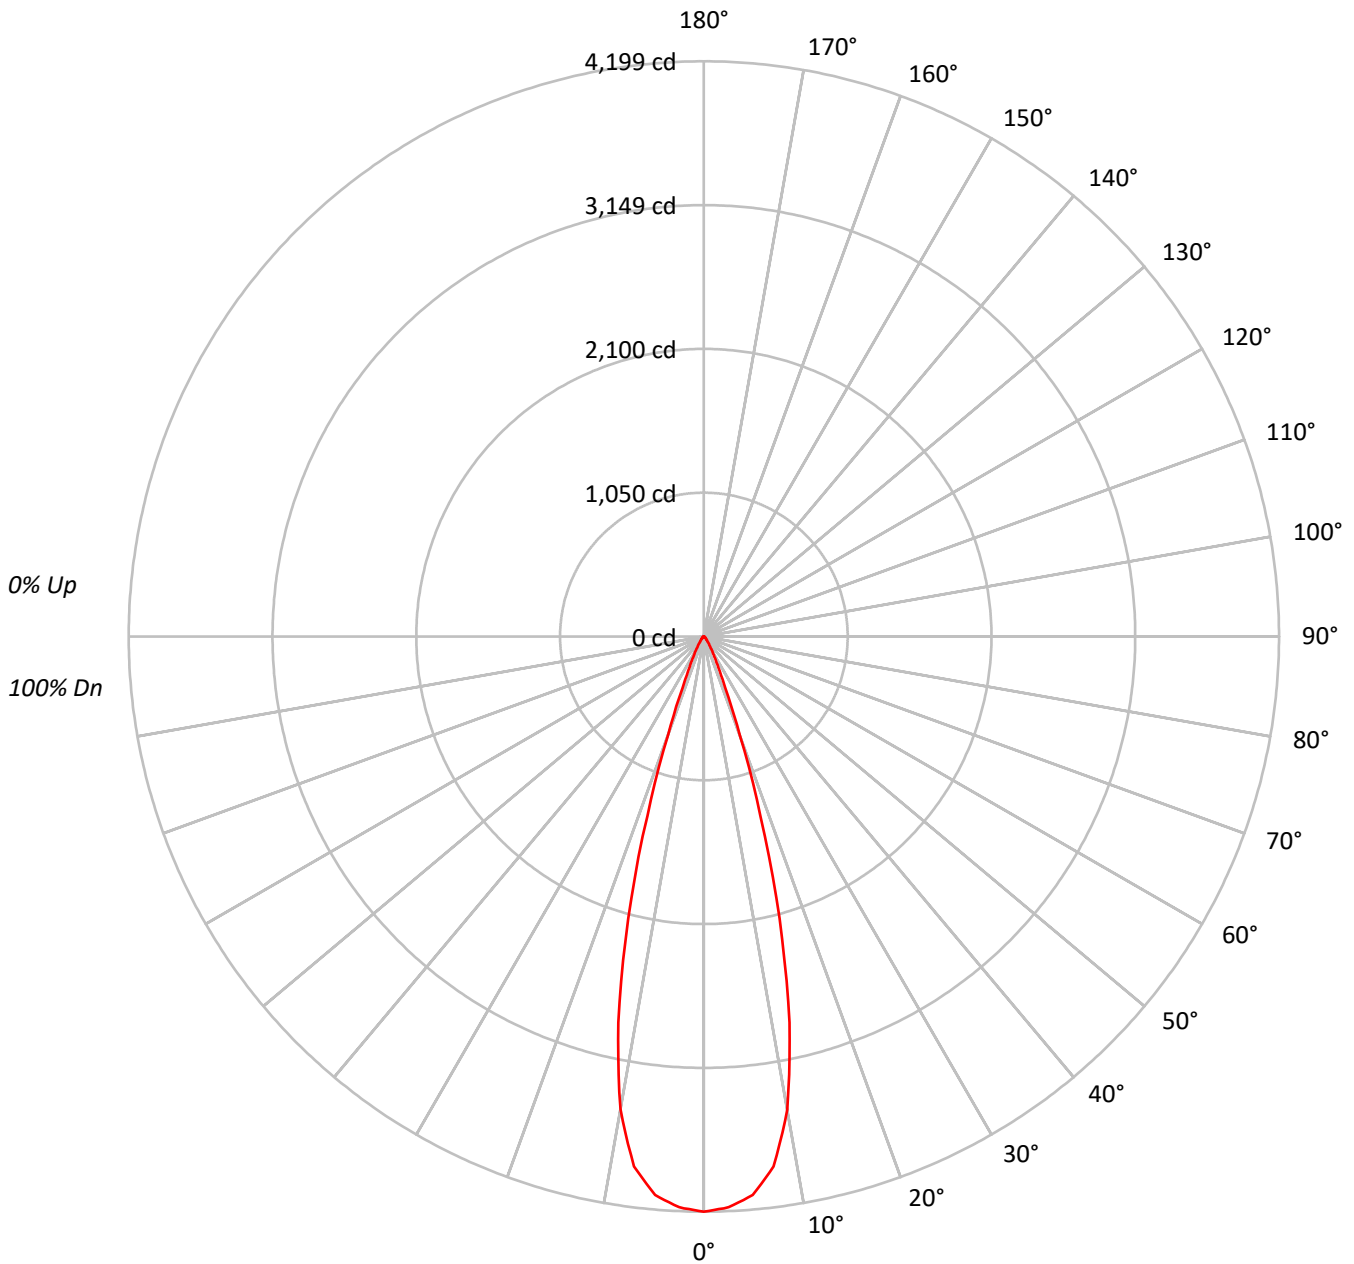



TEST NUMBER: P429842

CATALOG NUMBER: LAM4B112R309027DE010x1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	113	111	109	112	111	109	107	107	105	104	103	102	101	100	99	98	96	96	96	96																
2	111	107	104	102	109	106	103	100	102	100	98	96	96	96	97	95	94	93	93	93	93																
3	107	103	99	96	105	101	98	95	99	96	94	92	92	92	94	92	91	90	90	90	90																
4	104	98	94	91	102	97	94	91	95	92	90	89	89	89	92	90	88	87	87	87	87																
5	101	95	91	87	99	94	90	87	92	89	86	86	86	86	89	87	85	84	84	84	84																
6	98	91	87	84	97	91	87	84	89	86	83	83	83	83	87	84	82	81	81	81	81																
7	95	88	84	81	94	88	84	81	87	83	81	80	80	80	85	82	80	79	79	79	79																
8	92	86	81	79	91	85	81	78	84	81	78	78	78	78	83	80	78	77	77	77	77																
9	90	83	79	76	89	83	79	76	82	78	76	76	76	76	80	78	75	74	74	74	74																
10	88	81	77	74	87	80	77	74	80	76	74	74	74	74	78	76	73	72	72	72	72																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2071849
5°	2026621
10°	1757175
15°	1089094
20°	399191
25°	133429
30°	65516
35°	32645
40°	20288
45°	12838
50°	9134
55°	7484
60°	6414
65°	5020
70°	6203
75°	6291
80°	6251
85°	6227



TEST NUMBER: P429842

CATALOG NUMBER: LAM4B112R309027DE010x1MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	372.9	32.6
10°-20°	563.0	49.2
20°-30°	137.3	12.0
30°-40°	37.6	3.3
40°-50°	15.1	1.3
50°-60°	8.1	0.7
60°-70°	4.8	0.4
70°-80°	3.7	0.3
80°-90°	0.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1073.2	93.9
0°-40°	1110.8	97.1
0°-60°	1134.1	99.2
0°-90°	1143.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1143.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4199	
5°	4092	373
15°	2132	563
25°	245	137
35°	54	38
45°	18	15
55°	9	8
65°	4	5
75°	3	4
85°	1	1
90°	0	



TEST NUMBER: P429842

CATALOG NUMBER: LAM4B112R309027DE010x1MMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	4199.3
2.5°	4171.1
5°	4092.0
7.5°	3903.3
10°	3507.4
12.5°	2887.0
15°	2132.2
17.5°	1374.1
20°	760.3
22.5°	405.6
25°	245.1
27.5°	165.9
30°	115.0
32.5°	78.1
35°	54.2
37.5°	40.1
40°	31.5
42.5°	23.9
45°	18.4
47.5°	15.2
50°	11.9
52.5°	10.8
55°	8.7
57.5°	7.6
60°	6.5
62.5°	5.4
65°	4.3
67.5°	4.3
70°	4.3
72.5°	4.3
75°	3.3
77.5°	3.3
80°	2.2
82.5°	1.1
85°	1.1
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)