

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P429919

Luminaire Tested: **LAM4B112R459035DE010x1MB**

Issue Date: 11/23/2020

Test Information

Test Method: LM-41-14
Report Number: P429919
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2008-908-8)
Test Lab: INNOVATION CENTER (G2)
Issue Date: 11/23/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LAM4B112R459035DE010x1MB
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 45 DEG TIR OPTIC
Light Source: HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1281.8 lumens
Efficiency: N/A
Efficacy: 89.6 lumens/watt
Spacing Criteria (0/90/45): 0.73 / 0.73 / 0.66
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P429919

CATALOG NUMBER: LAM4B112R459035DE010x1MB

Luminous Intensity Polar Plot

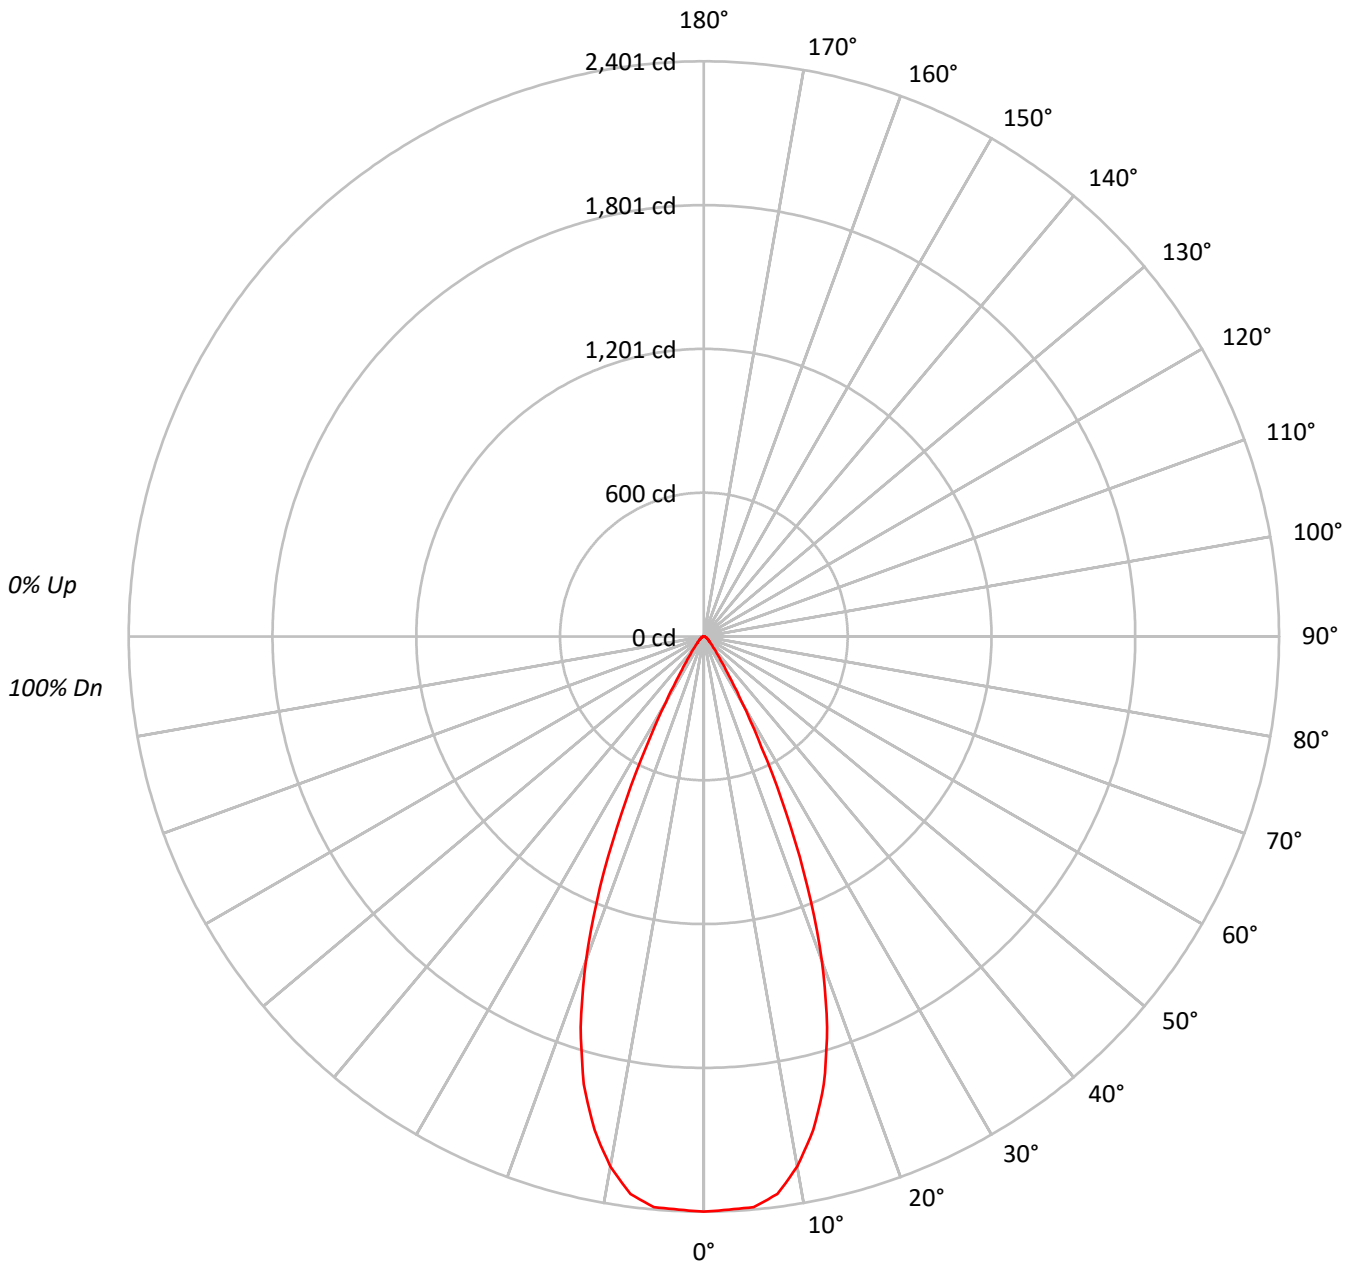



TEST NUMBER: P429919

CATALOG NUMBER: LAM4B112R459035DE010x1MB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	109	107	112	109	107	105	105	104	102	102	100	99	98	97	96	95		
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	89		
3	105	99	94	91	103	98	93	90	95	92	89	93	90	87	90	88	86	85		
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	78	83	80	78	76		
6	92	85	79	76	91	84	79	75	82	78	75	81	77	74	80	77	74	73		
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69		
8	85	77	72	68	84	77	72	68	76	71	68	75	71	68	74	70	67	66		
9	82	74	69	65	81	73	68	65	72	68	65	72	68	65	71	67	65	63		
10	79	71	66	62	78	70	66	62	70	65	62	69	65	62	68	65	62	61		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1184506
5°	1184078
10°	1125476
15°	988674
20°	756325
25°	441496
30°	180711
35°	76433
40°	41671
45°	26933
50°	21031
55°	18150
60°	14703
65°	11674
70°	10819
75°	9531
80°	10513
85°	6793



TEST NUMBER: P429919

CATALOG NUMBER: LAM4B112R459035DE010x1MB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	223.7	17.5
10°-20°	526.9	41.1
20°-30°	371.3	29.0
30°-40°	91.4	7.1
40°-50°	31.9	2.5
50°-60°	18.9	1.5
60°-70°	10.4	0.8
70°-80°	5.8	0.4
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1121.9	87.5
0°-40°	1213.3	94.7
0°-60°	1264.1	98.6
0°-90°	1281.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1281.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2401	
5°	2391	224
15°	1936	527
25°	811	371
35°	127	91
45°	39	32
55°	21	19
65°	10	10
75°	5	6
85°	1	2
90°	0	



TEST NUMBER: P429919

CATALOG NUMBER: LAM4B112R459035DE010x1MB

CANDELA DISTRIBUTION (FULL):

	0°
0°	2400.8
2.5°	2394.6
5°	2390.8
7.5°	2347.3
10°	2246.5
12.5°	2109.7
15°	1935.6
17.5°	1710.4
20°	1440.5
22.5°	1130.7
25°	811.0
27.5°	523.7
30°	317.2
32.5°	192.8
35°	126.9
37.5°	89.6
40°	64.7
42.5°	49.8
45°	38.6
47.5°	32.3
50°	27.4
52.5°	23.6
55°	21.1
57.5°	18.7
60°	14.9
62.5°	12.4
65°	10.0
67.5°	8.7
70°	7.5
72.5°	6.2
75°	5.0
77.5°	5.0
80°	3.7
82.5°	2.5
85°	1.2
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)