

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P429907

Luminaire Tested: **LAM4B112R409730DE010x1MB**

Issue Date: 11/23/2020

Test Information

Test Method: LM-41-14
Report Number: P429907
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-1911-585-7)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 11/23/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LAM4B112R409730DE010x1MB
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 40 DEG TIR OPTIC
Light Source: HIGH LUMEN LED 97CRI / 3000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1218.2 lumens
Efficiency: N/A
Efficacy: 85.2 lumens/watt
Spacing Criteria (0/90/45): 0.7 / 0.7 / 0.6
Luminous Opening: Circular (Dia: 0.29' x H: 0')
CIE Type: Direct

Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P429907
CATALOG NUMBER: LAM4B112R409730DE010x1MB

Luminous Intensity Polar Plot

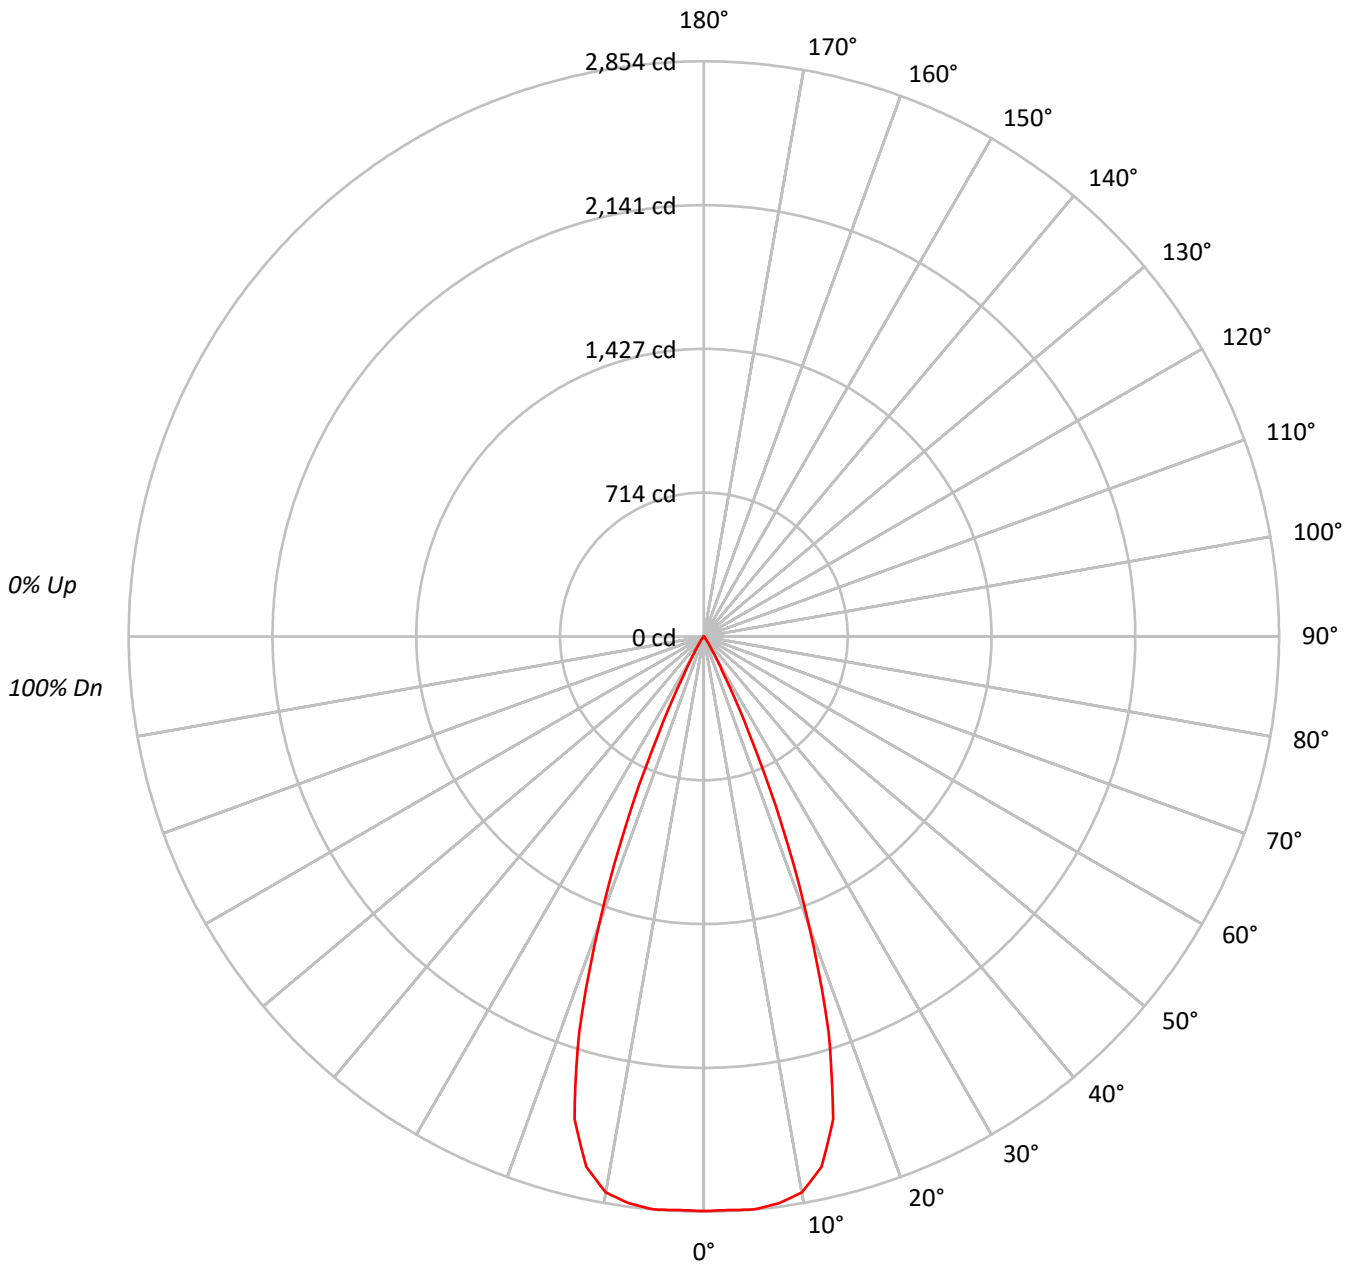



TEST NUMBER: P429907

CATALOG NUMBER: LAM4B112R409730DE010x1MB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																	
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																											
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																											
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																											
3	107	102	98	95	105	101	97	94	98	95	93	96	94	92	94	92	90	89																											
4	103	98	93	90	102	97	93	90	95	91	89	93	90	88	91	89	87	86																											
5	100	94	89	86	98	93	89	86	91	88	85	90	87	84	88	86	84	82																											
6	97	90	85	82	95	89	85	82	88	84	82	87	83	81	85	83	80	79																											
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77																											
8	91	83	79	76	90	83	79	76	82	78	75	81	78	75	80	77	75	74																											
9	88	81	76	73	87	80	76	73	79	75	73	79	75	73	78	75	72	71																											
10	85	78	73	71	84	77	73	70	77	73	70	76	73	70	75	72	70	69																											

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	459242
5°	461579
10°	458295
15°	413465
20°	260851
25°	93945
30°	19682
35°	5998
40°	1199
45°	0
50°	0
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P429907

CATALOG NUMBER: LAM4B112R409730DE010x1MB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	270.7	22.2
10°-20°	647.2	53.1
20°-30°	276.0	22.7
30°-40°	23.7	1.9
40°-50°	0.7	0.1
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1193.8	98.0
0°-40°	1217.5	99.9
0°-60°	1218.2	100.0
0°-90°	1218.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1218.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2851	
5°	2854	271
15°	2479	647
25°	528	276
35°	30	24
45°	0	1
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P429907

CATALOG NUMBER: LAM4B112R409730DE010x1MB

CANDELA DISTRIBUTION (FULL):

	0°
0°	2850.6
2.5°	2848.0
5°	2854.2
7.5°	2837.1
10°	2801.5
12.5°	2695.2
15°	2479.0
17.5°	2056.8
20°	1521.5
22.5°	1001.8
25°	528.5
27.5°	214.2
30°	105.8
32.5°	56.3
35°	30.5
37.5°	15.5
40°	5.7
42.5°	1.0
45°	0.0
47.5°	0.0
50°	0.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)