

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P431254

Luminaire Tested: **LAMR4B212R259024DE010x1MB**

Issue Date: 11/23/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P431254  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-1911-585-5)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 11/23/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LAMR4B212R259024DE010x1MB  
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 25 DEG TIR OPTIC  
Light Source: HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2060.3 lumens  
Efficiency: N/A  
Efficacy: 72.5 lumens/watt  
Spacing Criteria (0/90/45): 0.45 / 0.45 / 0.41  
Luminous Opening: Circular (Dia: 0.29' x H: 0')  
CIE Type: Direct


Input Watts (W): 28.4  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P431254

CATALOG NUMBER: LAMR4B212R259024DE010x1MB

### Luminous Intensity Polar Plot

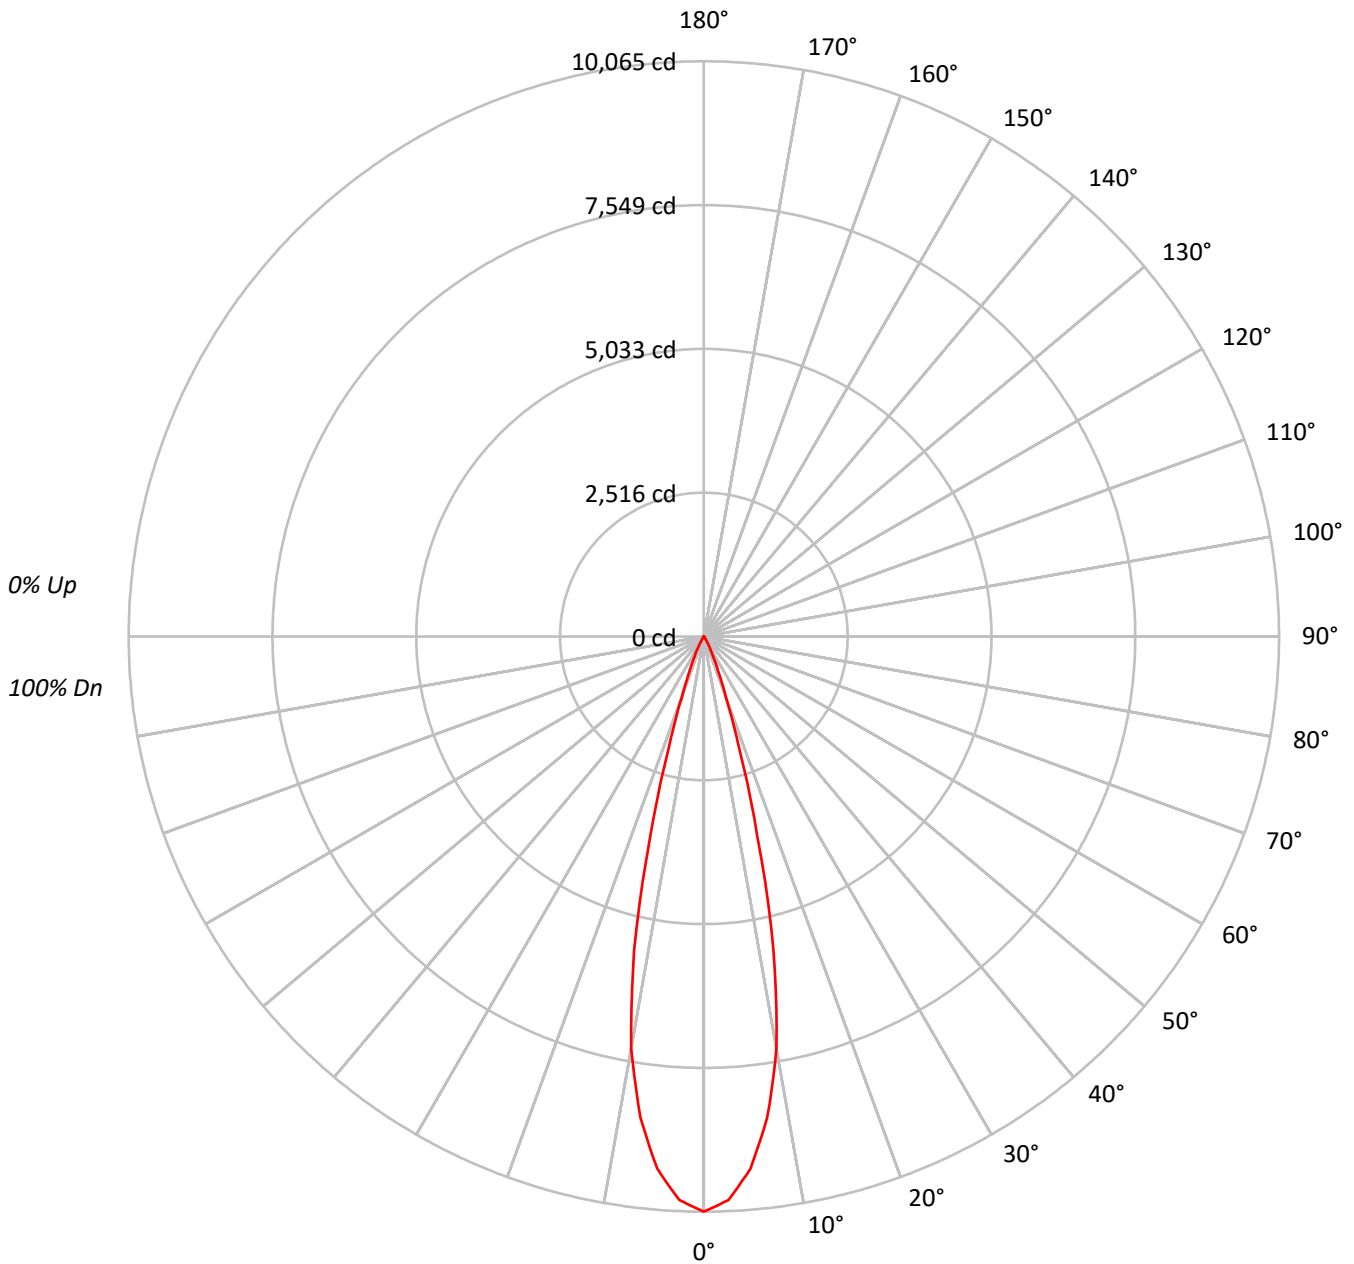



TEST NUMBER: P431254

CATALOG NUMBER: LAMR4B212R259024DE010x1MB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |     | 0   |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1   | 115 | 113 | 112 | 110 | 113 | 111 | 110 | 108 | 107 | 106 | 105 | 104 | 103 | 102 | 100 | 100 | 99  | 97  | 97  | 97  | 97  |
| 2   | 112 | 109 | 106 | 103 | 110 | 107 | 104 | 102 | 104 | 102 | 100 | 101 | 99  | 98  | 98  | 97  | 96  | 95  | 95  | 95  | 95  |
| 3   | 109 | 104 | 101 | 99  | 107 | 103 | 100 | 98  | 101 | 98  | 96  | 99  | 96  | 95  | 96  | 95  | 93  | 92  | 92  | 92  | 92  |
| 4   | 106 | 101 | 97  | 95  | 104 | 100 | 97  | 94  | 98  | 95  | 93  | 96  | 94  | 92  | 94  | 93  | 91  | 90  | 90  | 90  | 90  |
| 5   | 103 | 98  | 94  | 91  | 102 | 97  | 93  | 91  | 95  | 92  | 90  | 94  | 91  | 89  | 92  | 90  | 89  | 88  | 88  | 88  | 88  |
| 6   | 100 | 95  | 91  | 88  | 99  | 94  | 91  | 88  | 93  | 90  | 87  | 92  | 89  | 87  | 91  | 88  | 86  | 85  | 85  | 85  | 85  |
| 7   | 98  | 92  | 88  | 86  | 97  | 92  | 88  | 86  | 91  | 87  | 85  | 90  | 87  | 85  | 89  | 86  | 84  | 83  | 83  | 83  | 83  |
| 8   | 96  | 90  | 86  | 83  | 95  | 89  | 86  | 83  | 88  | 85  | 83  | 88  | 85  | 83  | 87  | 84  | 82  | 81  | 81  | 81  | 81  |
| 9   | 94  | 88  | 84  | 81  | 93  | 87  | 84  | 81  | 86  | 83  | 81  | 86  | 83  | 81  | 85  | 82  | 81  | 80  | 80  | 80  | 80  |
| 10  | 91  | 85  | 82  | 79  | 91  | 85  | 82  | 79  | 84  | 81  | 79  | 84  | 81  | 79  | 83  | 81  | 79  | 78  | 78  | 78  | 78  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 1621478 |
| 5°  | 1511977 |
| 10° | 1197243 |
| 15° | 602551  |
| 20° | 193354  |
| 25° | 67619   |
| 30° | 22658   |
| 35° | 4543    |
| 40° | 1493    |
| 45° | 0       |
| 50° | 0       |
| 55° | 0       |
| 60° | 0       |
| 65° | 0       |
| 70° | 0       |
| 75° | 0       |
| 80° | 0       |
| 85° | 0       |



TEST NUMBER: P431254

CATALOG NUMBER: LAMR4B212R259024DE010x1MB

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 827.7  | 40.2      |
| 10°-20°   | 1004.0 | 48.7      |
| 20°-30°   | 204.3  | 9.9       |
| 30°-40°   | 23.1   | 1.1       |
| 40°-50°   | 1.1    | 0.1       |
| 50°-60°   | 0.0    | 0.0       |
| 60°-70°   | 0.0    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 2036.0 | 98.8      |
| 0°-40°    | 2059.1 | 99.9      |
| 0°-60°    | 2060.3 | 100.0     |
| 0°-90°    | 2060.3 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 2060.3 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°    | Flux |
|-----|-------|------|
| 0°  | 10065 |      |
| 5°  | 9349  | 828  |
| 15° | 3613  | 1004 |
| 25° | 380   | 204  |
| 35° | 23    | 23   |
| 45° | 0     | 1    |
| 55° | 0     | 0    |
| 65° | 0     | 0    |
| 75° | 0     | 0    |
| 85° | 0     | 0    |
| 90° | 0     |      |



TEST NUMBER: P431254

CATALOG NUMBER: LAMR4B212R259024DE010x1MB

**CANDELA DISTRIBUTION (FULL):**

| 0°    |         |
|-------|---------|
| 0°    | 10064.8 |
| 2.5°  | 9870.1  |
| 5°    | 9349.4  |
| 7.5°  | 8490.0  |
| 10°   | 7318.6  |
| 12.5° | 5640.7  |
| 15°   | 3612.7  |
| 17.5° | 2035.2  |
| 20°   | 1127.8  |
| 22.5° | 642.5   |
| 25°   | 380.4   |
| 27.5° | 227.5   |
| 30°   | 121.8   |
| 32.5° | 53.3    |
| 35°   | 23.1    |
| 37.5° | 14.2    |
| 40°   | 7.1     |
| 42.5° | 2.7     |
| 45°   | 0.0     |
| 47.5° | 0.0     |
| 50°   | 0.0     |
| 52.5° | 0.0     |
| 55°   | 0.0     |
| 57.5° | 0.0     |
| 60°   | 0.0     |
| 62.5° | 0.0     |
| 65°   | 0.0     |
| 67.5° | 0.0     |
| 70°   | 0.0     |
| 72.5° | 0.0     |
| 75°   | 0.0     |
| 77.5° | 0.0     |
| 80°   | 0.0     |
| 82.5° | 0.0     |
| 85°   | 0.0     |
| 87.5° | 0.0     |
| 90°   | 0.0     |



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)