

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P430101

Luminaire Tested: **LAM4B212R209730DE010x1MW**

Issue Date: 11/23/2020

Test Information

Test Method: LM-41-14
Report Number: P430101
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2007-857-3)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 11/23/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LAM4B212R209730DE010x1MW
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 20 DEG TIR OPTIC
Light Source: HIGH LUMEN LED 97CRI / 3000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2205.9 lumens
Efficiency: N/A
Efficacy: 77.7 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.33
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 28.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P430101
CATALOG NUMBER: LAM4B212R209730DE010x1MW

Luminous Intensity Polar Plot

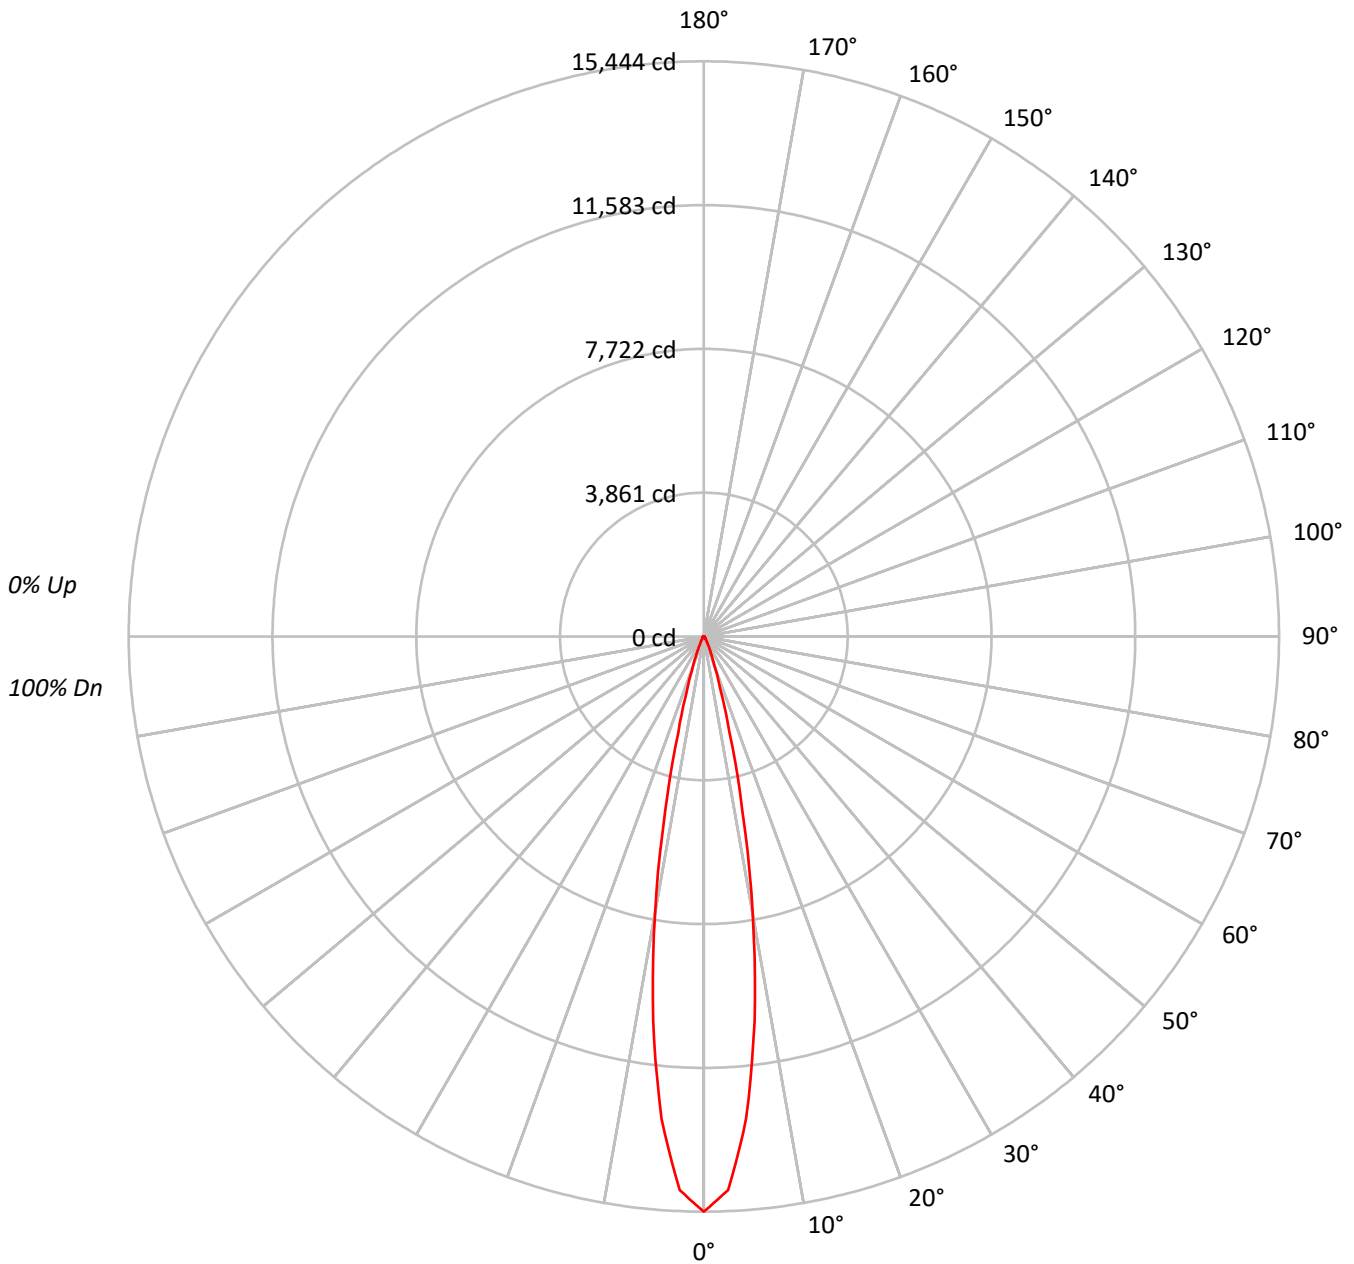



TEST NUMBER: P430101

CATALOG NUMBER: LAM4B212R209730DE010x1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	110	113	111	109	108	107	106	105	103	102	102	100	99	99	97				97															
2	112	108	105	103	110	106	104	102	103	101	100	101	99	97	98	97	95	94				94															
3	108	104	100	98	107	103	100	97	100	98	96	98	96	94	96	94	93	91				91															
4	105	100	97	94	104	99	96	93	97	94	92	96	93	91	94	92	90	89				89															
5	103	97	93	90	101	96	93	90	95	92	89	93	91	89	92	90	88	87				87															
6	100	94	90	88	99	94	90	87	92	89	87	91	88	86	90	88	86	85				85															
7	98	92	88	85	97	91	88	85	90	87	85	89	86	84	88	86	84	83				83															
8	96	90	86	83	95	89	86	83	88	85	83	87	85	82	87	84	82	81				81															
9	94	88	84	81	93	87	84	81	86	83	81	86	83	81	85	82	81	80				80															
10	92	86	82	80	91	85	82	80	85	82	79	84	81	79	83	81	79	78				78															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	7619655
5°	6440564
10°	3782981
15°	1354497
20°	448177
25°	178395
30°	85285
35°	48726
40°	35166
45°	29654
50°	34157
55°	27870
60°	14012
65°	11791
70°	14570
75°	15441
80°	11365
85°	11322



TEST NUMBER: P430101

CATALOG NUMBER: LAM4B212R209730DE010x1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1064.8	48.3
10°-20°	830.4	37.6
20°-30°	172.4	7.8
30°-40°	54.3	2.5
40°-50°	35.0	1.6
50°-60°	28.1	1.3
60°-70°	11.0	0.5
70°-80°	8.3	0.4
80°-90°	1.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2067.6	93.7
0°-40°	2121.9	96.2
0°-60°	2185.0	99.1
0°-90°	2205.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2205.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	15444	
5°	13004	###
15°	2652	830
25°	328	172
35°	81	54
45°	42	35
55°	32	28
65°	10	11
75°	8	8
85°	2	2
90°	0	



TEST NUMBER: P430101

CATALOG NUMBER: LAM4B212R209730DE010x1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	15443.8
2.5°	14877.4
5°	13004.3
7.5°	10419.2
10°	7551.0
12.5°	4763.6
15°	2651.8
17.5°	1458.4
20°	853.6
22.5°	521.9
25°	327.7
27.5°	216.4
30°	149.7
32.5°	105.2
35°	80.9
37.5°	64.7
40°	54.6
42.5°	46.5
45°	42.5
47.5°	42.5
50°	44.5
52.5°	42.5
55°	32.4
57.5°	22.3
60°	14.2
62.5°	12.1
65°	10.1
67.5°	10.1
70°	10.1
72.5°	10.1
75°	8.1
77.5°	6.1
80°	4.0
82.5°	2.0
85°	2.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)