

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P430369

Luminaire Tested: **LAM4B312R209027DE01021MB**

Issue Date: 11/23/2020

Test Information

Test Method: LM-41-14
Report Number: P430369
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2007-857-3)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 11/23/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LAM4B312R209027DE01021MB
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 20 DEG TIR OPTIC
Light Source: HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3388.5 lumens
Efficiency: N/A
Efficacy: 82.8 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.33
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 40.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P430369

CATALOG NUMBER: LAM4B312R209027DE01021MB

Luminous Intensity Polar Plot

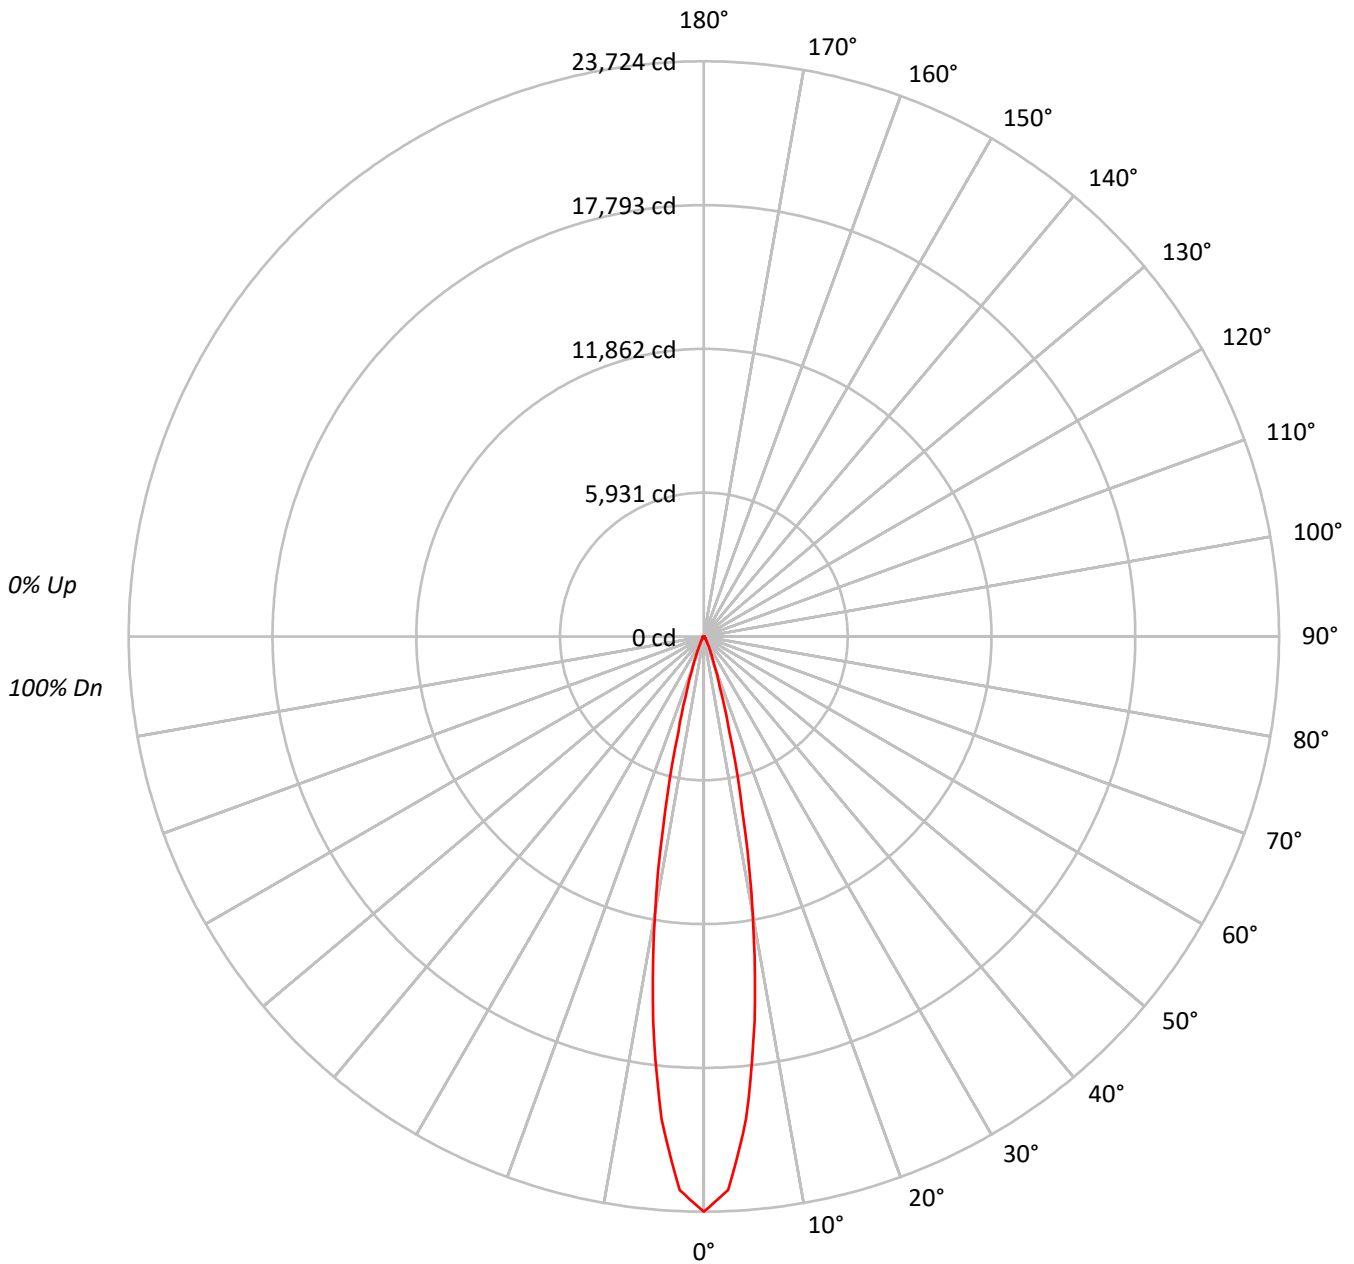



TEST NUMBER: P430369

CATALOG NUMBER: LAM4B312R209027DE01021MB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|-----|----|----|---|--|--|--|--|--|--|---|--|--|--|--|--|--|--|--|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 | | | | | | | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | 100 | | | | | | | | | | | | | | | | | | |
| 1 | 115 | 113 | 111 | 110 | 113 | 111 | 109 | 108 | 107 | 106 | 105 | 103 | 102 | 102 | 100 | 99 | 99 | 97 | | | | | | | | | 97 | | | | | | | | | | | | | | | | | | |
| 2 | 112 | 108 | 105 | 103 | 110 | 106 | 104 | 102 | 103 | 101 | 100 | 101 | 99 | 97 | 98 | 97 | 95 | | | | | | | | | 94 | | | | | | | | | | | | | | | | | | | |
| 3 | 108 | 104 | 100 | 98 | 107 | 103 | 100 | 97 | 100 | 98 | 96 | 98 | 96 | 94 | 96 | 94 | 93 | | | | | | | | | 91 | | | | | | | | | | | | | | | | | | | |
| 4 | 105 | 100 | 97 | 94 | 104 | 99 | 96 | 93 | 97 | 94 | 92 | 96 | 93 | 91 | 94 | 92 | 90 | | | | | | | | | 89 | | | | | | | | | | | | | | | | | | | |
| 5 | 103 | 97 | 93 | 90 | 101 | 96 | 93 | 90 | 95 | 92 | 89 | 93 | 91 | 89 | 92 | 90 | 88 | | | | | | | | | 87 | | | | | | | | | | | | | | | | | | | |
| 6 | 100 | 94 | 90 | 88 | 99 | 94 | 90 | 87 | 92 | 89 | 87 | 91 | 88 | 86 | 90 | 88 | 86 | | | | | | | | | 85 | | | | | | | | | | | | | | | | | | | |
| 7 | 98 | 92 | 88 | 85 | 97 | 91 | 88 | 85 | 90 | 87 | 85 | 89 | 86 | 84 | 88 | 86 | 84 | | | | | | | | | 83 | | | | | | | | | | | | | | | | | | | |
| 8 | 96 | 90 | 86 | 83 | 95 | 89 | 86 | 83 | 88 | 85 | 83 | 87 | 85 | 82 | 87 | 84 | 82 | | | | | | | | | 81 | | | | | | | | | | | | | | | | | | | |
| 9 | 94 | 88 | 84 | 81 | 93 | 87 | 84 | 81 | 86 | 83 | 81 | 86 | 83 | 81 | 85 | 82 | 81 | | | | | | | | | 80 | | | | | | | | | | | | | | | | | | | |
| 10 | 92 | 86 | 82 | 80 | 91 | 85 | 82 | 80 | 85 | 82 | 79 | 84 | 81 | 79 | 83 | 81 | 79 | | | | | | | | | 78 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|----------|
| | 0° |
| 0° | 11704838 |
| 5° | 9893645 |
| 10° | 5811142 |
| 15° | 2080730 |
| 20° | 688490 |
| 25° | 274043 |
| 30° | 130975 |
| 35° | 74867 |
| 40° | 54037 |
| 45° | 45563 |
| 50° | 52501 |
| 55° | 42751 |
| 60° | 21511 |
| 65° | 18095 |
| 70° | 22359 |
| 75° | 23638 |
| 80° | 17616 |
| 85° | 17549 |



TEST NUMBER: P430369

CATALOG NUMBER: LAM4B312R209027DE01021MB

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 1635.7 | 48.3 |
| 10°-20° | 1275.6 | 37.6 |
| 20°-30° | 264.8 | 7.8 |
| 30°-40° | 83.5 | 2.5 |
| 40°-50° | 53.7 | 1.6 |
| 50°-60° | 43.1 | 1.3 |
| 60°-70° | 16.9 | 0.5 |
| 70°-80° | 12.7 | 0.4 |
| 80°-90° | 2.5 | 0.1 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 3176.1 | 93.7 |
| 0°-40° | 3259.6 | 96.2 |
| 0°-60° | 3356.4 | 99.1 |
| 0°-90° | 3388.5 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 3388.5 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-------|------|
| 0° | 23724 | |
| 5° | 19976 | ### |
| 15° | 4074 | 1276 |
| 25° | 503 | 265 |
| 35° | 124 | 83 |
| 45° | 65 | 54 |
| 55° | 50 | 43 |
| 65° | 16 | 17 |
| 75° | 12 | 13 |
| 85° | 3 | 3 |
| 90° | 0 | |



TEST NUMBER: P430369

CATALOG NUMBER: LAM4B312R209027DE01021MB

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|---------|
| 0° | 23723.8 |
| 2.5° | 22853.8 |
| 5° | 19976.5 |
| 7.5° | 16005.4 |
| 10° | 11599.3 |
| 12.5° | 7317.6 |
| 15° | 4073.6 |
| 17.5° | 2240.3 |
| 20° | 1311.3 |
| 22.5° | 801.7 |
| 25° | 503.4 |
| 27.5° | 332.5 |
| 30° | 229.9 |
| 32.5° | 161.6 |
| 35° | 124.3 |
| 37.5° | 99.4 |
| 40° | 83.9 |
| 42.5° | 71.5 |
| 45° | 65.3 |
| 47.5° | 65.3 |
| 50° | 68.4 |
| 52.5° | 65.3 |
| 55° | 49.7 |
| 57.5° | 34.2 |
| 60° | 21.8 |
| 62.5° | 18.6 |
| 65° | 15.5 |
| 67.5° | 15.5 |
| 70° | 15.5 |
| 72.5° | 15.5 |
| 75° | 12.4 |
| 77.5° | 9.3 |
| 80° | 6.2 |
| 82.5° | 3.1 |
| 85° | 3.1 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)