

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P430523

Luminaire Tested: **LAM4B312R509040DE01021MMS**

Issue Date: 11/23/2020


**Test Information**

Test Method: LM-41-14  
Report Number: P430523  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-1911-585-8)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 11/23/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LAM4B312R509040DE01021MMS  
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 50 DEG TIR OPTIC  
Light Source: HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 4160.0 lumens  
Efficiency: N/A  
Efficacy: 101.7 lumens/watt  
Spacing Criteria (0/90/45): 0.82 / 0.82 / 0.74  
Luminous Opening: Circular (Dia: 0.29' x H: 0')  
CIE Type: Direct

Input Watts (W): 40.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

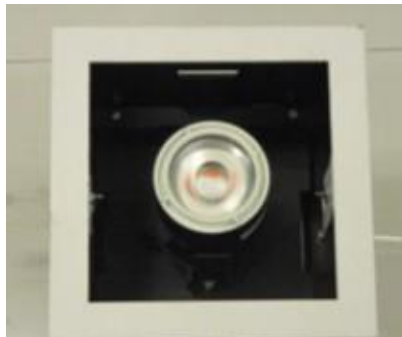

TEST NUMBER: P430523  
CATALOG NUMBER: LAM4B312R509040DE01021MMS

### Luminous Intensity Polar Plot

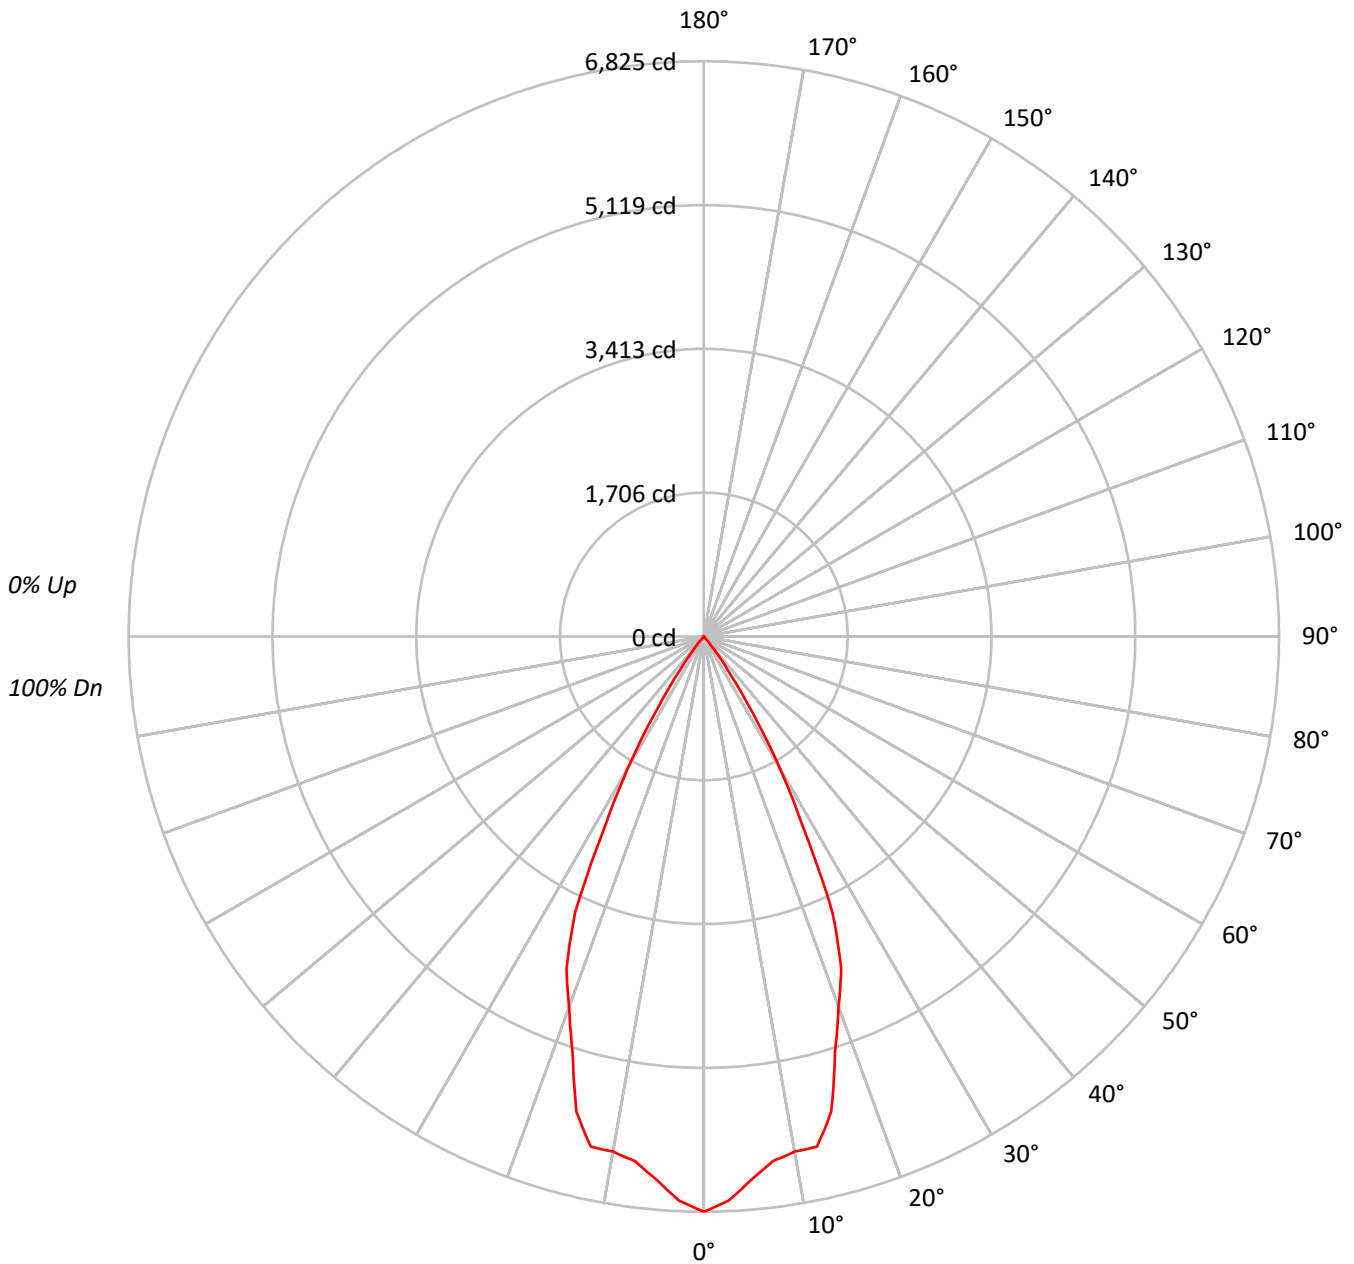



TEST NUMBER: P430523

CATALOG NUMBER: LAM4B312R509040DE01021MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	95	95	95
2	110	105	102	99	107	104	100	98	100	98	96	97	95	93	95	93	92	90	90	90	90
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	101	94	89	86	99	93	89	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	84	80	87	83	79	85	81	79	84	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69	69	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66	66	66
9	82	73	68	65	81	73	68	65	72	68	64	71	67	64	70	67	64	63	63	63	63
10	79	70	65	62	78	70	65	62	69	64	61	68	64	61	68	64	61	60	60	60	60

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1099469
5°	1046000
10°	1015250
15°	974119
20°	801428
25°	642134
30°	334978
35°	108032
40°	18360
45°	0
50°	0
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P430523

CATALOG NUMBER: LAM4B312R509040DE01021MMS

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	609.1	14.6
10°-20°	1580.6	38.0
20°-30°	1537.7	37.0
30°-40°	423.3	10.2
40°-50°	9.2	0.2
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3727.4	89.6
0°-40°	4150.7	99.8
0°-60°	4160.0	100.0
0°-90°	4160.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4160.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	6825	
5°	6468	609
15°	5840	1581
25°	3612	1538
35°	549	423
45°	0	9
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P430523

CATALOG NUMBER: LAM4B312R509040DE01021MMS

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	6824.6
2.5°	6702.7
5°	6468.0
7.5°	6278.9
10°	6206.1
12.5°	6200.7
15°	5840.5
17.5°	5176.6
20°	4674.6
22.5°	4258.1
25°	3612.4
27.5°	2542.8
30°	1800.7
32.5°	1089.5
35°	549.3
37.5°	245.6
40°	87.3
42.5°	7.3
45°	0.0
47.5°	0.0
50°	0.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)