

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P430435

Luminaire Tested: **LAM4B312R309730DE01021MB**

Issue Date: 11/23/2020


Test Information

Test Method: LM-41-14
Report Number: P430435
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2007-857-8)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 11/23/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LAM4B312R309730DE01021MB
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 30 DEG TIR OPTIC
Light Source: HIGH LUMEN LED 97CRI / 3000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3425.8 lumens
Efficiency: N/A
Efficacy: 83.8 lumens/watt
Spacing Criteria (0/90/45): 0.51 / 0.51 / 0.46
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 40.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

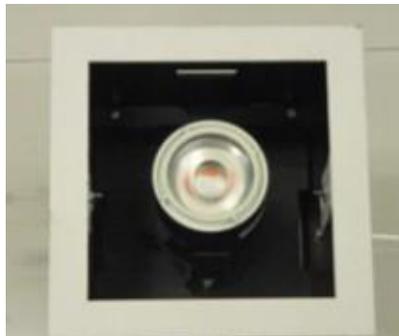

TEST NUMBER: P430435
CATALOG NUMBER: LAM4B312R309730DE01021MB

Luminous Intensity Polar Plot

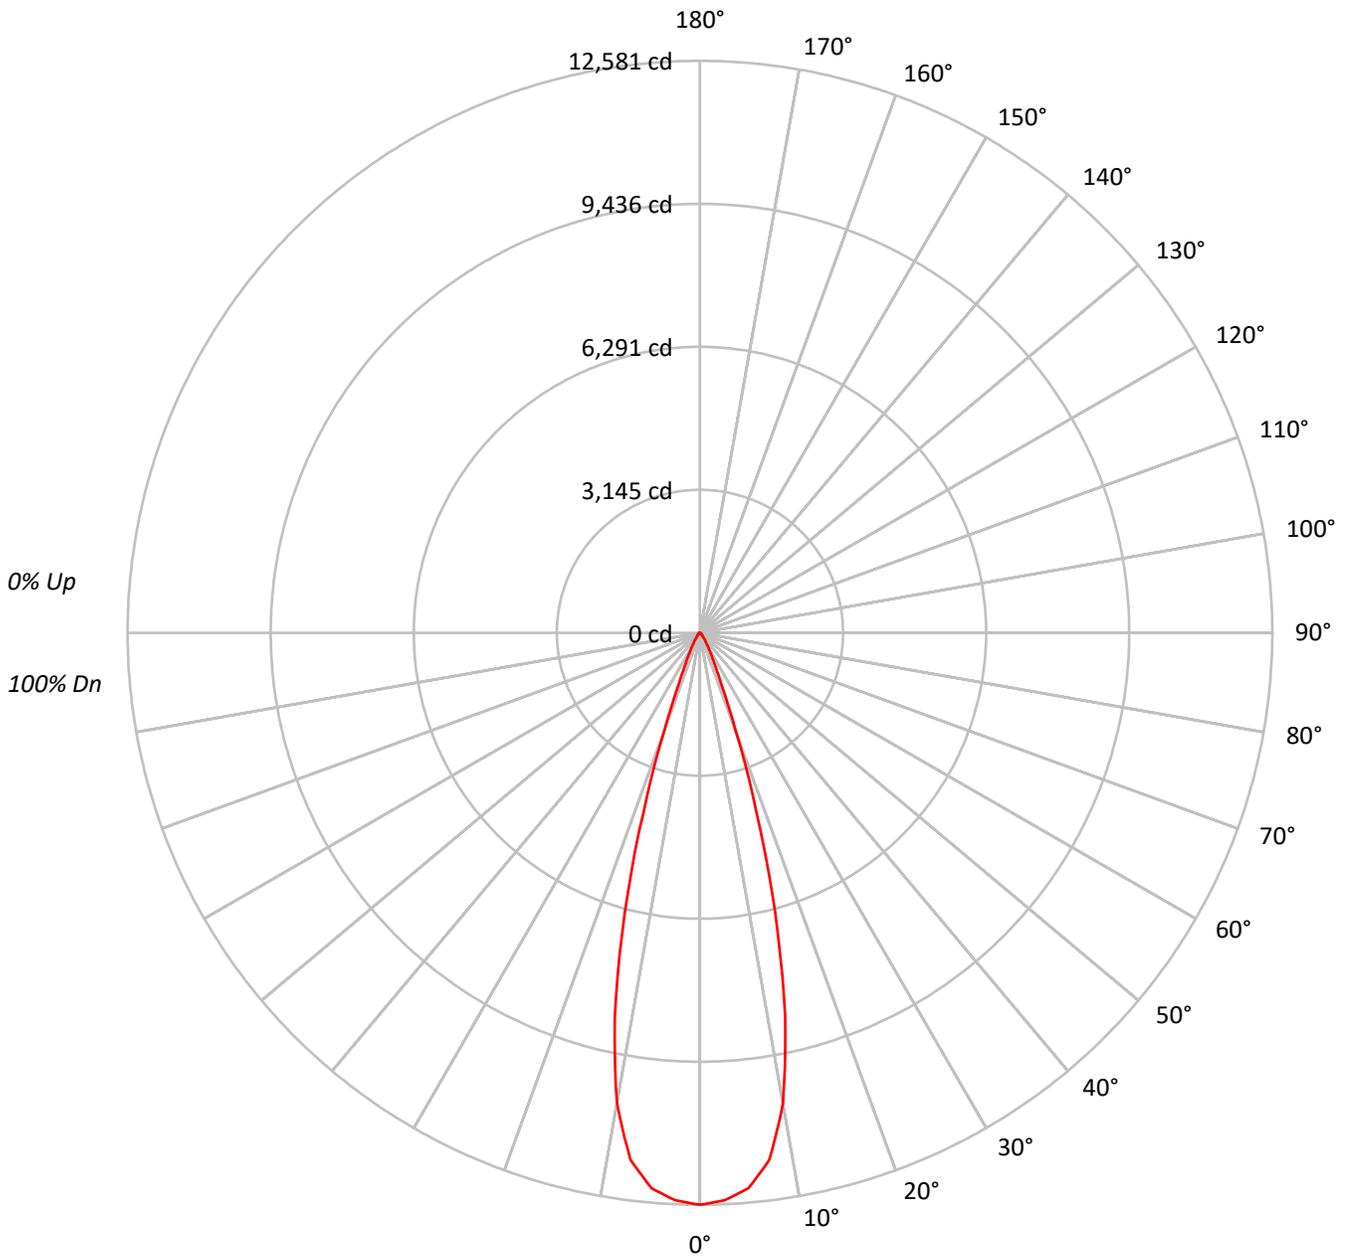



TEST NUMBER: P430435

CATALOG NUMBER: LAM4B312R309730DE01021MB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |
| 1 | 115 | 113 | 111 | 109 | 112 | 111 | 109 | 107 | 107 | 105 | 104 | 103 | 102 | 101 | 100 | 99 | 98 | 96 |
| 2 | 111 | 107 | 104 | 102 | 109 | 106 | 103 | 100 | 102 | 100 | 98 | 100 | 98 | 96 | 97 | 95 | 94 | 93 |
| 3 | 107 | 103 | 99 | 96 | 105 | 101 | 98 | 95 | 99 | 96 | 94 | 96 | 94 | 92 | 94 | 92 | 91 | 90 |
| 4 | 104 | 98 | 94 | 91 | 102 | 97 | 94 | 91 | 95 | 92 | 90 | 93 | 91 | 89 | 92 | 90 | 88 | 87 |
| 5 | 101 | 95 | 91 | 87 | 99 | 94 | 90 | 87 | 92 | 89 | 86 | 91 | 88 | 86 | 89 | 87 | 85 | 84 |
| 6 | 98 | 91 | 87 | 84 | 97 | 91 | 87 | 84 | 89 | 86 | 83 | 88 | 85 | 83 | 87 | 84 | 82 | 81 |
| 7 | 95 | 88 | 84 | 81 | 94 | 88 | 84 | 81 | 87 | 83 | 81 | 86 | 83 | 80 | 85 | 82 | 80 | 79 |
| 8 | 92 | 86 | 81 | 79 | 91 | 85 | 81 | 78 | 84 | 81 | 78 | 83 | 80 | 78 | 83 | 80 | 78 | 77 |
| 9 | 90 | 83 | 79 | 76 | 89 | 83 | 79 | 76 | 82 | 78 | 76 | 81 | 78 | 76 | 80 | 78 | 75 | 74 |
| 10 | 88 | 81 | 77 | 74 | 87 | 80 | 77 | 74 | 80 | 76 | 74 | 79 | 76 | 74 | 78 | 76 | 73 | 72 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|---------|
| | 0° |
| 0° | 6207257 |
| 5° | 6071642 |
| 10° | 5264411 |
| 15° | 3262889 |
| 20° | 1195892 |
| 25° | 399741 |
| 30° | 196207 |
| 35° | 97875 |
| 40° | 60671 |
| 45° | 38515 |
| 50° | 27402 |
| 55° | 22365 |
| 60° | 19242 |
| 65° | 15177 |
| 70° | 18753 |
| 75° | 18491 |
| 80° | 18468 |
| 85° | 18115 |



TEST NUMBER: P430435

CATALOG NUMBER: LAM4B312R309730DE01021MB

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 1117.3 | 32.6 |
| 10°-20° | 1686.8 | 49.2 |
| 20°-30° | 411.3 | 12.0 |
| 30°-40° | 112.6 | 3.3 |
| 40°-50° | 45.3 | 1.3 |
| 50°-60° | 24.3 | 0.7 |
| 60°-70° | 14.5 | 0.4 |
| 70°-80° | 11.1 | 0.3 |
| 80°-90° | 2.6 | 0.1 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 3215.4 | 93.9 |
| 0°-40° | 3328.0 | 97.1 |
| 0°-60° | 3397.6 | 99.2 |
| 0°-90° | 3425.8 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 3425.8 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-------|------|
| 0° | 12581 | |
| 5° | 12259 | ### |
| 15° | 6388 | 1687 |
| 25° | 734 | 411 |
| 35° | 162 | 113 |
| 45° | 55 | 45 |
| 55° | 26 | 24 |
| 65° | 13 | 14 |
| 75° | 10 | 11 |
| 85° | 3 | 3 |
| 90° | 0 | |



TEST NUMBER: P430435
CATALOG NUMBER: LAM4B312R309730DE01021MB

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|---------|
| 0° | 12581.1 |
| 2.5° | 12496.6 |
| 5° | 12259.4 |
| 7.5° | 11694.0 |
| 10° | 10508.0 |
| 12.5° | 8649.5 |
| 15° | 6388.0 |
| 17.5° | 4116.8 |
| 20° | 2277.7 |
| 22.5° | 1215.2 |
| 25° | 734.3 |
| 27.5° | 497.1 |
| 30° | 344.4 |
| 32.5° | 233.9 |
| 35° | 162.5 |
| 37.5° | 120.2 |
| 40° | 94.2 |
| 42.5° | 71.5 |
| 45° | 55.2 |
| 47.5° | 45.5 |
| 50° | 35.7 |
| 52.5° | 32.5 |
| 55° | 26.0 |
| 57.5° | 22.7 |
| 60° | 19.5 |
| 62.5° | 16.2 |
| 65° | 13.0 |
| 67.5° | 13.0 |
| 70° | 13.0 |
| 72.5° | 13.0 |
| 75° | 9.7 |
| 77.5° | 9.7 |
| 80° | 6.5 |
| 82.5° | 3.2 |
| 85° | 3.2 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)