

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P430799

Luminaire Tested: **LAM4B412R509024DE01021MMS**

Issue Date: 11/23/2020

Test Information

Test Method: LM-41-14
Report Number: P430799
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-1911-585-8)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 11/23/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LAM4B412R509024DE01021MMS
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 50 DEG TIR OPTIC
Light Source: HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5233.4 lumens
Efficiency: N/A
Efficacy: 96.7 lumens/watt
Spacing Criteria (0/90/45): 0.82 / 0.82 / 0.74
Luminous Opening: Circular (Dia: 0.29' x H: 0')
CIE Type: Direct


Input Watts (W): 54.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P430799

CATALOG NUMBER: LAM4B412R509024DE01021MMS

Luminous Intensity Polar Plot

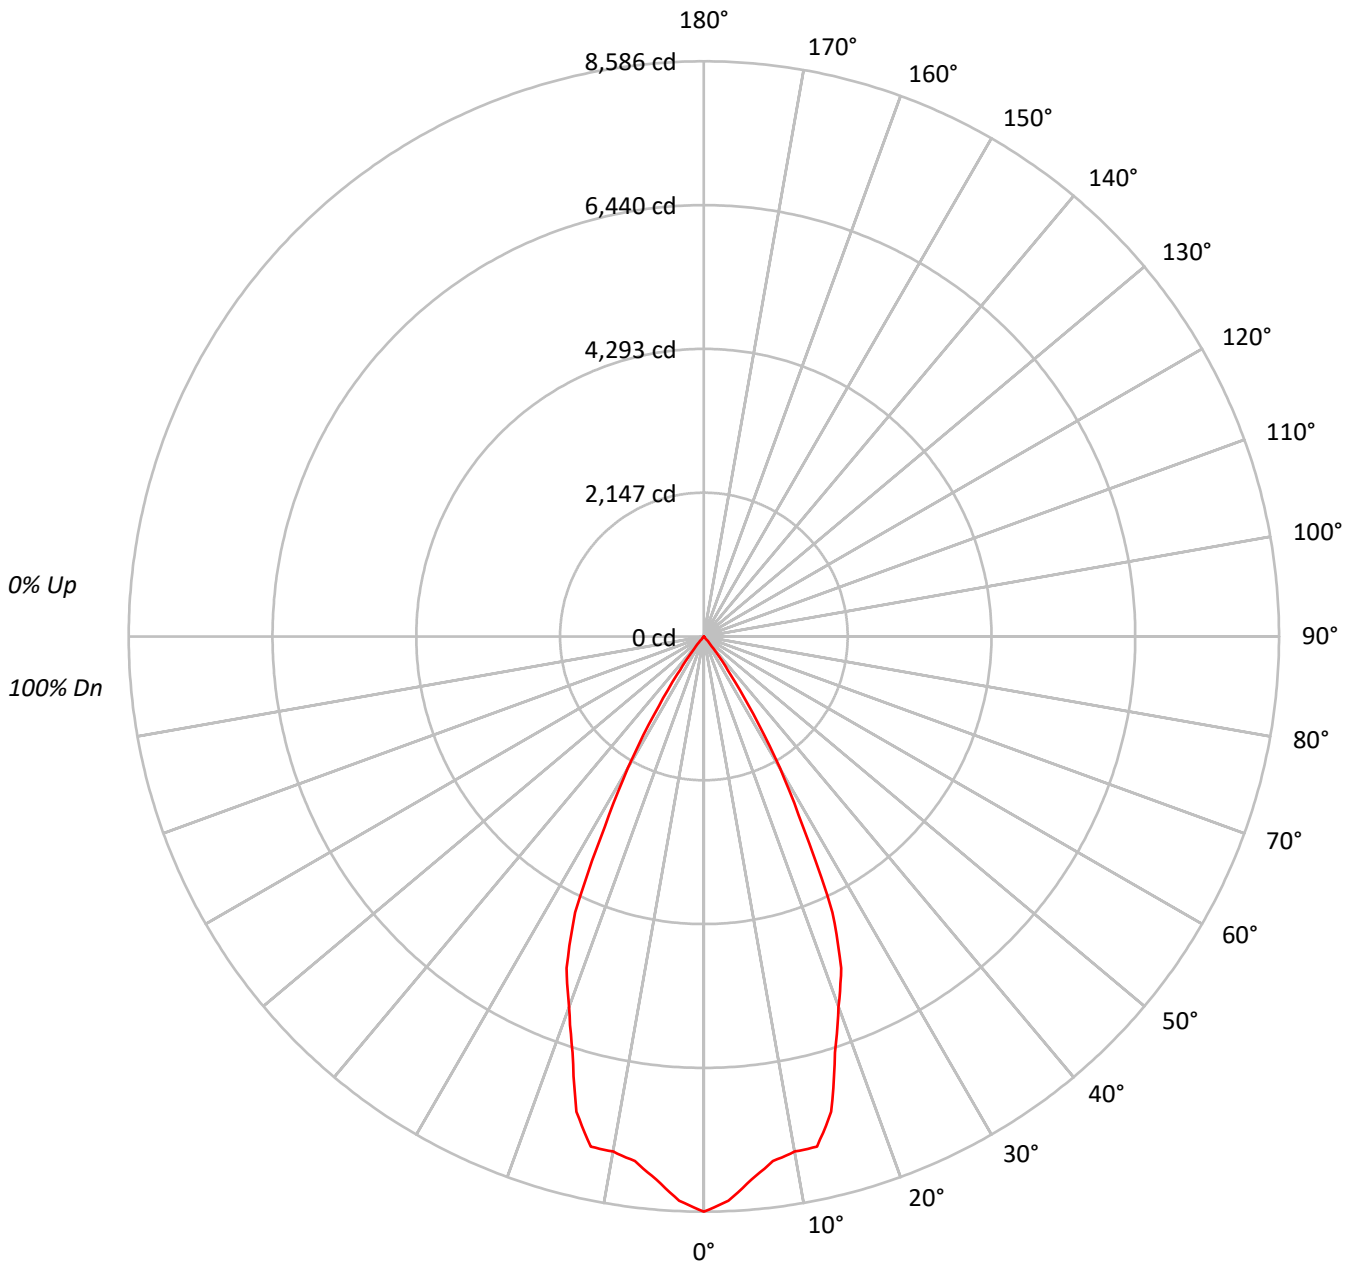



TEST NUMBER: P430799

CATALOG NUMBER: LAM4B412R509024DE01021MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1 | 114 | 112 | 110 | 108 | 112 | 110 | 108 | 106 | 106 | 104 | 103 | 102 | 101 | 100 | 99 | 98 | 97 | 95 | 95 | 95 | 95 |
| 2 | 110 | 105 | 102 | 99 | 107 | 104 | 100 | 98 | 100 | 98 | 96 | 97 | 95 | 93 | 95 | 93 | 92 | 90 | 90 | 90 | 90 |
| 3 | 105 | 99 | 95 | 92 | 103 | 98 | 94 | 91 | 95 | 92 | 89 | 93 | 90 | 88 | 91 | 89 | 87 | 85 | 85 | 85 | 85 |
| 4 | 101 | 94 | 89 | 86 | 99 | 93 | 89 | 85 | 91 | 87 | 84 | 89 | 86 | 83 | 87 | 84 | 82 | 81 | 81 | 81 | 81 |
| 5 | 96 | 89 | 84 | 80 | 95 | 88 | 84 | 80 | 87 | 83 | 79 | 85 | 81 | 79 | 84 | 80 | 78 | 77 | 77 | 77 | 77 |
| 6 | 92 | 85 | 80 | 76 | 91 | 84 | 79 | 76 | 83 | 78 | 75 | 81 | 77 | 75 | 80 | 77 | 74 | 73 | 73 | 73 | 73 |
| 7 | 89 | 81 | 75 | 72 | 87 | 80 | 75 | 72 | 79 | 74 | 71 | 78 | 74 | 71 | 77 | 73 | 71 | 69 | 69 | 69 | 69 |
| 8 | 85 | 77 | 72 | 68 | 84 | 76 | 71 | 68 | 75 | 71 | 68 | 74 | 70 | 67 | 73 | 70 | 67 | 66 | 66 | 66 | 66 |
| 9 | 82 | 73 | 68 | 65 | 81 | 73 | 68 | 65 | 72 | 68 | 64 | 71 | 67 | 64 | 70 | 67 | 64 | 63 | 63 | 63 | 63 |
| 10 | 79 | 70 | 65 | 62 | 78 | 70 | 65 | 62 | 69 | 64 | 61 | 68 | 64 | 61 | 68 | 64 | 61 | 60 | 60 | 60 | 60 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|---------|
| | 0° |
| 0° | 1383173 |
| 5° | 1315925 |
| 10° | 1277238 |
| 15° | 1225484 |
| 20° | 1008222 |
| 25° | 807823 |
| 30° | 421425 |
| 35° | 135920 |
| 40° | 23092 |
| 45° | 0 |
| 50° | 0 |
| 55° | 0 |
| 60° | 0 |
| 65° | 0 |
| 70° | 0 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |



TEST NUMBER: P430799

CATALOG NUMBER: LAM4B412R509024DE01021MMS

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 766.2 | 14.6 |
| 10°-20° | 1988.5 | 38.0 |
| 20°-30° | 1934.5 | 37.0 |
| 30°-40° | 532.5 | 10.2 |
| 40°-50° | 11.6 | 0.2 |
| 50°-60° | 0.0 | 0.0 |
| 60°-70° | 0.0 | 0.0 |
| 70°-80° | 0.0 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 4689.3 | 89.6 |
| 0°-40° | 5221.8 | 99.8 |
| 0°-60° | 5233.4 | 100.0 |
| 0°-90° | 5233.4 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 5233.4 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 8586 | |
| 5° | 8137 | 766 |
| 15° | 7348 | 1989 |
| 25° | 4544 | 1935 |
| 35° | 691 | 533 |
| 45° | 0 | 12 |
| 55° | 0 | 0 |
| 65° | 0 | 0 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P430799

CATALOG NUMBER: LAM4B412R509024DE01021MMS

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 8585.6 |
| 2.5° | 8432.3 |
| 5° | 8137.1 |
| 7.5° | 7899.1 |
| 10° | 7807.6 |
| 12.5° | 7800.7 |
| 15° | 7347.6 |
| 17.5° | 6512.4 |
| 20° | 5880.8 |
| 22.5° | 5356.8 |
| 25° | 4544.5 |
| 27.5° | 3199.0 |
| 30° | 2265.4 |
| 32.5° | 1370.7 |
| 35° | 691.1 |
| 37.5° | 308.9 |
| 40° | 109.8 |
| 42.5° | 9.2 |
| 45° | 0.0 |
| 47.5° | 0.0 |
| 50° | 0.0 |
| 52.5° | 0.0 |
| 55° | 0.0 |
| 57.5° | 0.0 |
| 60° | 0.0 |
| 62.5° | 0.0 |
| 65° | 0.0 |
| 67.5° | 0.0 |
| 70° | 0.0 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)