

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P431994

Luminaire Tested: **LAMR4B412R559727DE01021MW**

Issue Date: 11/23/2020

Test Information

Test Method: LM-41-14
Report Number: P431994
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2007-898-142)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 11/23/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LAMR4B412R559727DE01021MW
Description: PORTFOLIO 4INCH ADJUSTABLE MULTIPLE, 55 DEG TIR OPTIC
Light Source: HIGH LUMEN LED 97CRI / 2700K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5023.5 lumens
Efficiency: N/A
Efficacy: 92.9 lumens/watt
Spacing Criteria (0/90/45): 0.92 / 0.92 / 0.81
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 54.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P431994

CATALOG NUMBER: LAMR4B412R559727DE01021MW

Luminous Intensity Polar Plot

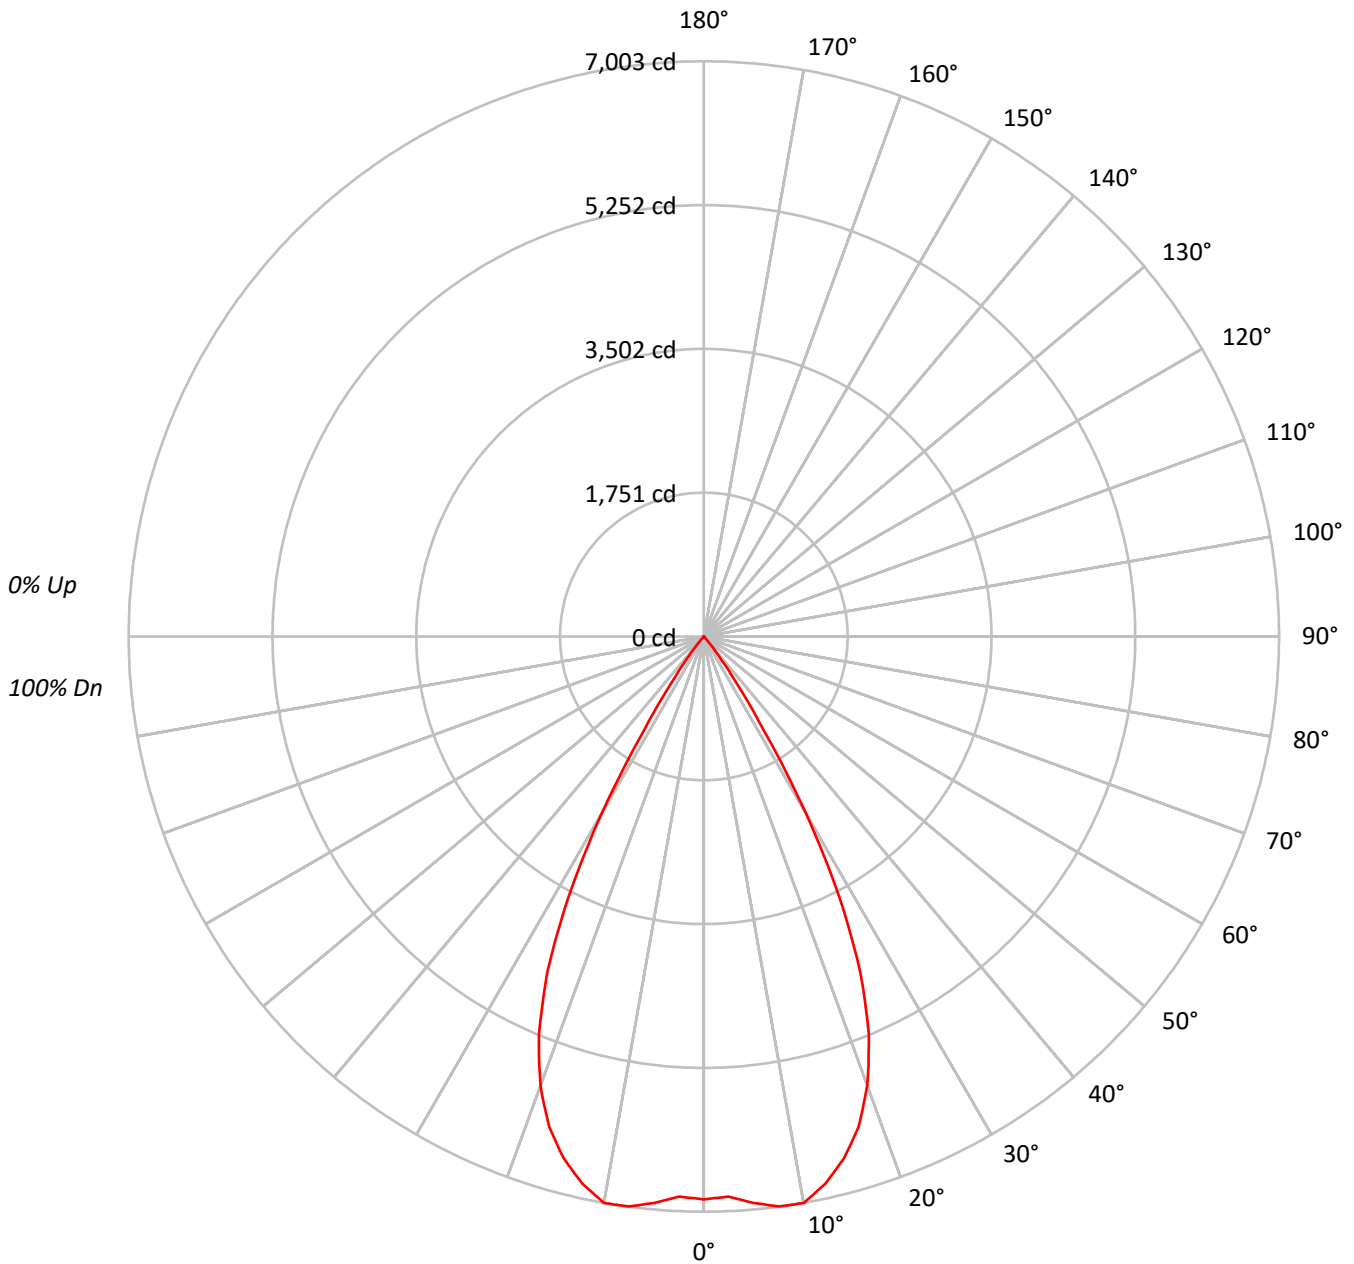



TEST NUMBER: P431994

CATALOG NUMBER: LAMR4B412R559727DE01021MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|--|--|--|---|--|--|--|--|--|--|--|--|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 | | | | | | | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 | 114 | 112 | 109 | 107 | 112 | 110 | 108 | 106 | 105 | 104 | 102 | 102 | 101 | 99 | 98 | 97 | 97 | 95 | 95 | 94 | 93 | 91 | 90 | 90 | 89 | 88 | 87 | 84 | 82 | 80 | 76 | 72 | 68 | | | | | | | | | | | | |
| 2 | 109 | 105 | 101 | 98 | 107 | 103 | 100 | 97 | 100 | 97 | 95 | 97 | 95 | 93 | 94 | 93 | 91 | 90 | 89 | 88 | 86 | 85 | 85 | 84 | 83 | 82 | 81 | 78 | 76 | 74 | 72 | 70 | 68 | | | | | | | | | | | | |
| 3 | 105 | 99 | 95 | 91 | 103 | 98 | 94 | 90 | 95 | 92 | 89 | 93 | 90 | 88 | 91 | 88 | 86 | 85 | 85 | 84 | 82 | 80 | 79 | 79 | 78 | 77 | 74 | 71 | 67 | 65 | 63 | 62 | 61 | | | | | | | | | | | | |
| 4 | 100 | 94 | 89 | 85 | 99 | 92 | 88 | 85 | 90 | 87 | 84 | 88 | 85 | 83 | 87 | 84 | 82 | 80 | 79 | 78 | 76 | 74 | 73 | 72 | 71 | 70 | 69 | 67 | 66 | 65 | 64 | 63 | 62 | | | | | | | | | | | | |
| 5 | 96 | 89 | 83 | 80 | 94 | 88 | 83 | 79 | 86 | 82 | 79 | 84 | 81 | 78 | 83 | 80 | 77 | 76 | 75 | 74 | 73 | 72 | 71 | 70 | 69 | 68 | 67 | 66 | 65 | 64 | 63 | 62 | 61 | | | | | | | | | | | | |
| 6 | 92 | 84 | 79 | 75 | 91 | 83 | 78 | 75 | 82 | 78 | 74 | 81 | 77 | 74 | 79 | 76 | 73 | 72 | 71 | 70 | 69 | 68 | 67 | 66 | 65 | 64 | 63 | 62 | 61 | 60 | 59 | 58 | 57 | | | | | | | | | | | | |
| 7 | 88 | 80 | 75 | 71 | 87 | 79 | 74 | 71 | 78 | 74 | 70 | 77 | 73 | 70 | 76 | 72 | 70 | 69 | 68 | 67 | 66 | 65 | 64 | 63 | 62 | 61 | 60 | 59 | 58 | 57 | 56 | 55 | 54 | | | | | | | | | | | | |
| 8 | 84 | 76 | 71 | 67 | 83 | 75 | 70 | 67 | 74 | 70 | 67 | 73 | 69 | 66 | 72 | 69 | 66 | 65 | 64 | 63 | 62 | 61 | 60 | 59 | 58 | 57 | 56 | 55 | 54 | 53 | 52 | 51 | 50 | | | | | | | | | | | | |
| 9 | 81 | 72 | 67 | 64 | 80 | 72 | 67 | 63 | 71 | 66 | 63 | 70 | 66 | 63 | 69 | 66 | 63 | 62 | 61 | 60 | 59 | 58 | 57 | 56 | 55 | 54 | 53 | 52 | 51 | 50 | 49 | 48 | 47 | | | | | | | | | | | | |
| 10 | 78 | 69 | 64 | 60 | 77 | 69 | 64 | 60 | 68 | 63 | 60 | 67 | 63 | 60 | 66 | 63 | 60 | 59 | 58 | 57 | 56 | 55 | 54 | 53 | 52 | 51 | 50 | 49 | 48 | 47 | 46 | 45 | 44 | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|---------|
| | 0° |
| 0° | 3380982 |
| 5° | 3428318 |
| 10° | 3508538 |
| 15° | 3361828 |
| 20° | 3054441 |
| 25° | 2454628 |
| 30° | 1413041 |
| 35° | 410110 |
| 40° | 62667 |
| 45° | 0 |
| 50° | 0 |
| 55° | 0 |
| 60° | 0 |
| 65° | 0 |
| 70° | 0 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |



TEST NUMBER: P431994

CATALOG NUMBER: LAMR4B412R559727DE01021MW

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 663.8 | 13.2 |
| 10°-20° | 1831.2 | 36.5 |
| 20°-30° | 1976.5 | 39.3 |
| 30°-40° | 540.6 | 10.8 |
| 40°-50° | 11.4 | 0.2 |
| 50°-60° | 0.0 | 0.0 |
| 60°-70° | 0.0 | 0.0 |
| 70°-80° | 0.0 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 4471.5 | 89.0 |
| 0°-40° | 5012.1 | 99.8 |
| 0°-60° | 5023.5 | 100.0 |
| 0°-90° | 5023.5 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 5023.5 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 6853 | |
| 5° | 6922 | 664 |
| 15° | 6582 | 1831 |
| 25° | 4509 | 1977 |
| 35° | 681 | 541 |
| 45° | 0 | 11 |
| 55° | 0 | 0 |
| 65° | 0 | 0 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P431994

CATALOG NUMBER: LAMR4B412R559727DE01021MW

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 6852.7 |
| 2.5° | 6824.9 |
| 5° | 6922.2 |
| 7.5° | 6998.6 |
| 10° | 7003.2 |
| 12.5° | 6824.9 |
| 15° | 6581.7 |
| 17.5° | 6259.8 |
| 20° | 5817.5 |
| 22.5° | 5247.8 |
| 25° | 4509.0 |
| 27.5° | 3566.5 |
| 30° | 2480.3 |
| 32.5° | 1359.4 |
| 35° | 680.9 |
| 37.5° | 291.8 |
| 40° | 97.3 |
| 42.5° | 13.9 |
| 45° | 0.0 |
| 47.5° | 0.0 |
| 50° | 0.0 |
| 52.5° | 0.0 |
| 55° | 0.0 |
| 57.5° | 0.0 |
| 60° | 0.0 |
| 62.5° | 0.0 |
| 65° | 0.0 |
| 67.5° | 0.0 |
| 70° | 0.0 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)