

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P778014

Luminaire Tested: LERS4D10D010-EC4DR350210IC9024-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P778014
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS4D10D010-EC4DR350210IC9024-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 920.3 lumens
Efficiency: N/A
Efficacy: 78.7 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P778014

CATALOG NUMBER: LERS4D10D010-EC4DR350210IC9024-4LBS1LI

Luminous Intensity Polar Plot

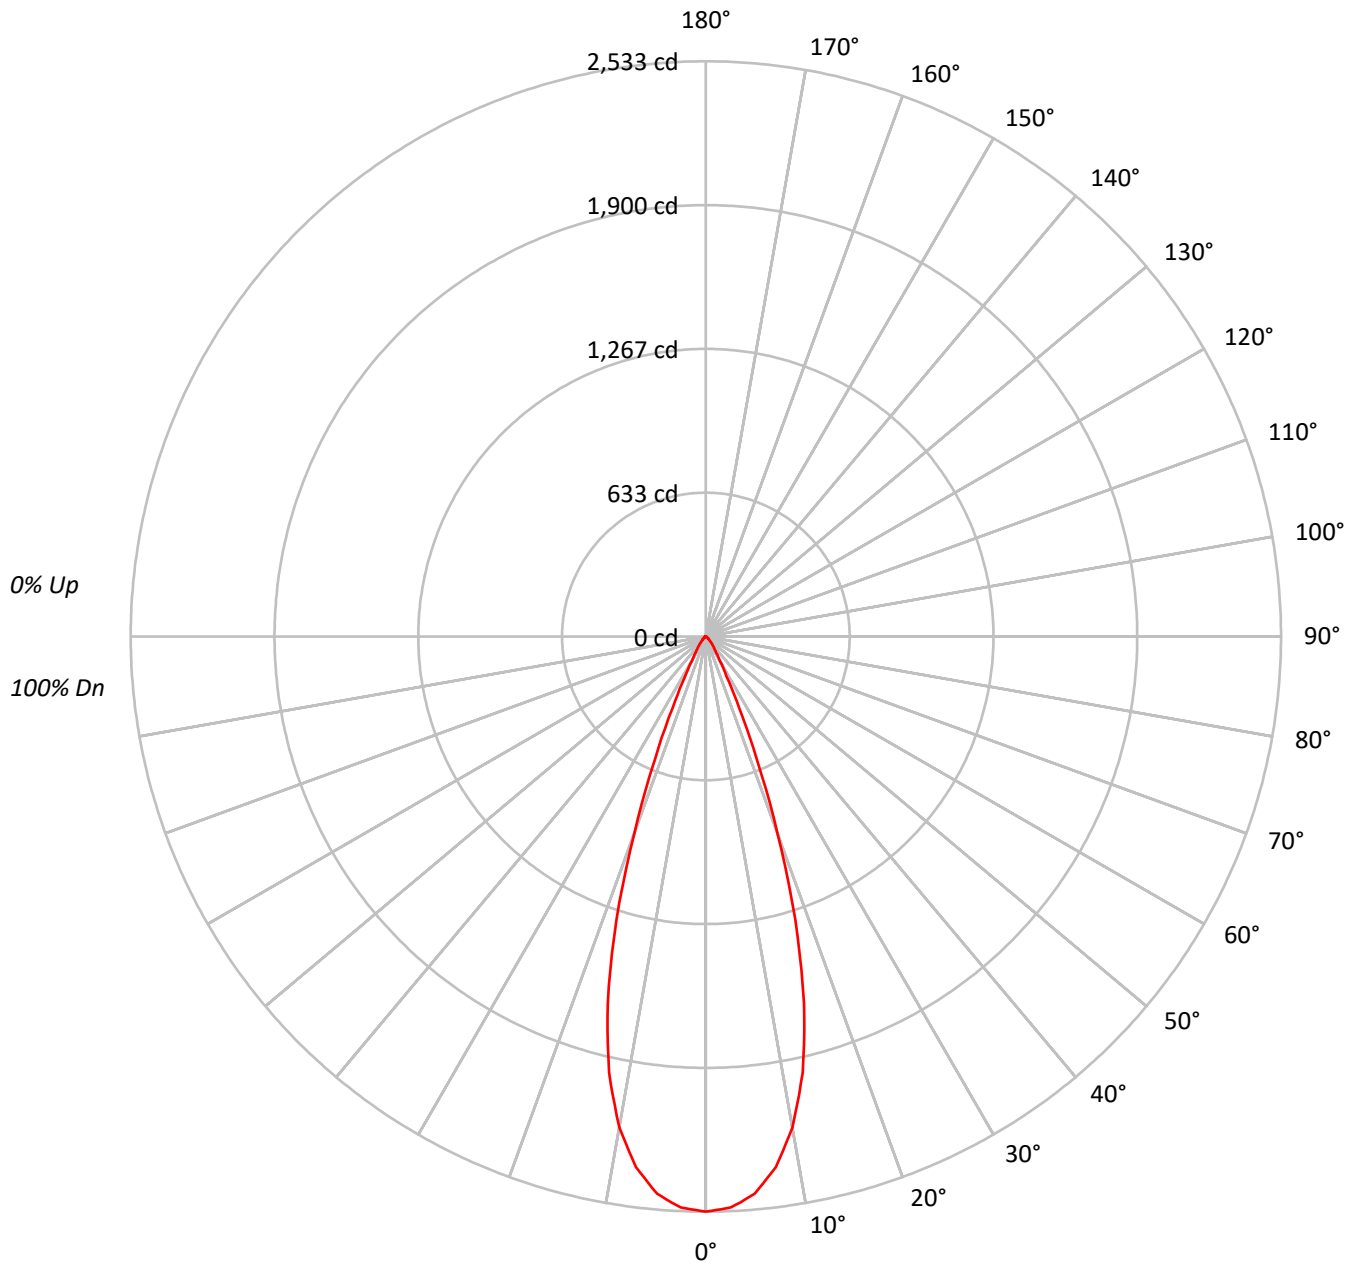



TEST NUMBER: P778014

CATALOG NUMBER: LERS4D10D010-EC4DR350210IC9024-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																				
0	119	119	119	119	116	116	116	116		111	111	111		106	106	106		102	102	102
1	115	112	110	108	112	110	108	107		106	105	103		103	101	100		99	98	98
2	110	106	103	101	108	105	102	99		102	99	97		99	97	95		96	95	93
3	106	101	97	94	105	100	96	94		97	95	92		95	93	91		93	91	89
4	103	97	92	89	101	96	92	89		94	90	88		92	89	87		90	88	86
5	99	93	88	85	98	92	87	84		90	86	84		89	85	83		87	84	82
6	96	89	84	81	94	88	84	81		87	83	80		85	82	80		84	81	79
7	93	85	81	78	91	85	80	77		84	80	77		83	79	77		82	79	76
8	90	82	78	74	88	82	77	74		81	77	74		80	76	74		79	76	73
9	87	79	75	72	86	79	75	72		78	74	71		77	74	71		77	73	71
10	84	77	72	69	83	76	72	69		76	72	69		75	71	69		74	71	69

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	276714
5°	270214
10°	243527
15°	189015
20°	107204
25°	41700
30°	15569
35°	8523
40°	5577
45°	3384
50°	2159
55°	1524
60°	1114
65°	595
70°	32
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3384 cd/sqm



TEST NUMBER: P778014

CATALOG NUMBER: LERS4D10D010-EC4DR350210IC9024-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	226.6	24.6
10°-20°	442.4	48.1
20°-30°	180.4	19.6
30°-40°	43.2	4.7
40°-50°	18.0	2.0
50°-60°	7.4	0.8
60°-70°	2.3	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	849.4	92.3
0°-40°	892.6	97.0
0°-60°	918.0	99.7
0°-90°	920.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	920.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2533	
5°	2464	227
15°	1671	442
25°	346	180
35°	64	43
45°	22	18
55°	8	7
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P778014

CATALOG NUMBER: LERS4D10D010-EC4DR350210IC9024-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	2532.6
2.5°	2517.4
5°	2463.7
7.5°	2356.5
10°	2195.0
12.5°	1967.7
15°	1671.0
17.5°	1308.2
20°	922.0
22.5°	588.0
25°	345.9
27.5°	195.5
30°	123.4
32.5°	86.6
35°	63.9
37.5°	49.4
40°	39.1
42.5°	30.1
45°	21.9
47.5°	16.4
50°	12.7
52.5°	10.1
55°	8.0
57.5°	6.5
60°	5.1
62.5°	3.7
65°	2.3
67.5°	0.8
70°	0.1
72.5°	0.1
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.1
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)