

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760645

Luminaire Tested: LD6D10D010-EU6DR600210IC9027-6LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P760645
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR600210IC9027-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 794.9 lumens
Efficiency: N/A
Efficacy: 67.9 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760645

CATALOG NUMBER: LD6D10D010-EU6DR600210IC9027-6LBDP1B

Luminous Intensity Polar Plot

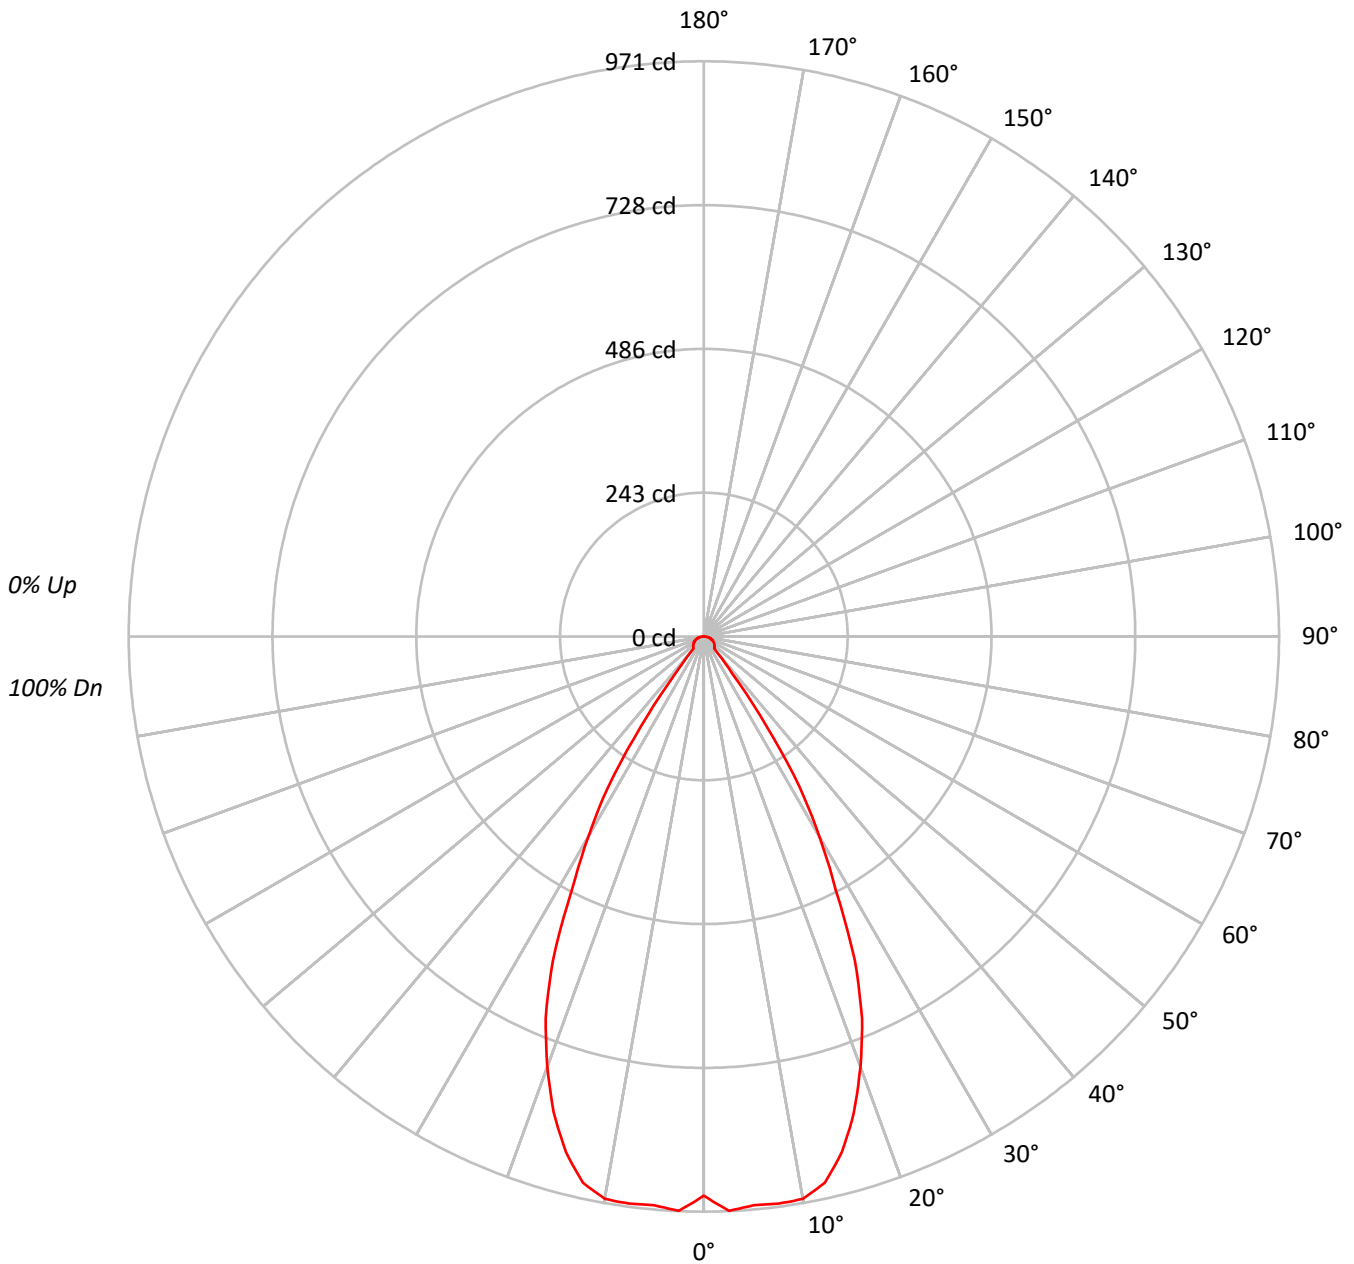



TEST NUMBER: P760645

CATALOG NUMBER: LD6D10D010-EU6DR600210IC9027-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86	86	86	86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80	80	80	80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75	75	75	75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70	70	70	70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66	66	66	66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62	62	62	62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53	53	53	53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	103153
5°	105686
10°	106952
15°	101894
20°	89832
25°	72659
30°	49153
35°	24636
40°	3994
45°	3909
50°	3995
55°	4057
60°	4152
65°	4240
70°	4345
75°	4390
80°	4279
85°	3510

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 4390 cd/sqm



TEST NUMBER: P760645

CATALOG NUMBER: LD6D10D010-EU6DR600210IC9027-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	92.1	11.6
10°-20°	249.2	31.3
20°-30°	268.1	33.7
30°-40°	116.5	14.7
40°-50°	19.6	2.5
50°-60°	19.0	2.4
60°-70°	16.2	2.0
70°-80°	10.9	1.4
80°-90°	3.3	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	609.3	76.7
0°-40°	725.9	91.3
0°-60°	764.5	96.2
0°-90°	794.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	794.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	944	
5°	964	92
15°	901	249
25°	603	268
35°	185	117
45°	25	20
55°	21	19
65°	16	16
75°	10	11
85°	3	3
90°	0	



TEST NUMBER: P760645

CATALOG NUMBER: LD6D10D010-EU6DR600210IC9027-6LBDP1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	944.1
2.5°	970.6
5°	963.6
7.5°	965.8
10°	964.0
12.5°	944.2
15°	900.8
17.5°	842.6
20°	772.6
22.5°	697.9
25°	602.7
27.5°	482.1
30°	389.6
32.5°	300.3
35°	184.7
37.5°	79.0
40°	28.0
42.5°	25.8
45°	25.3
47.5°	24.5
50°	23.5
52.5°	22.3
55°	21.3
57.5°	20.2
60°	19.0
62.5°	17.8
65°	16.4
67.5°	15.1
70°	13.6
72.5°	12.0
75°	10.4
77.5°	8.6
80°	6.8
82.5°	4.8
85°	2.8
87.5°	1.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)