

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760664

Luminaire Tested: LD6D10D010-EU6DR600210IC9030-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P760664
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR600210IC9030-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1152.0 lumens
Efficiency: N/A
Efficacy: 98.5 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760664
CATALOG NUMBER: LD6D10D010-EU6DR600210IC9030-6LBS1LI

Luminous Intensity Polar Plot

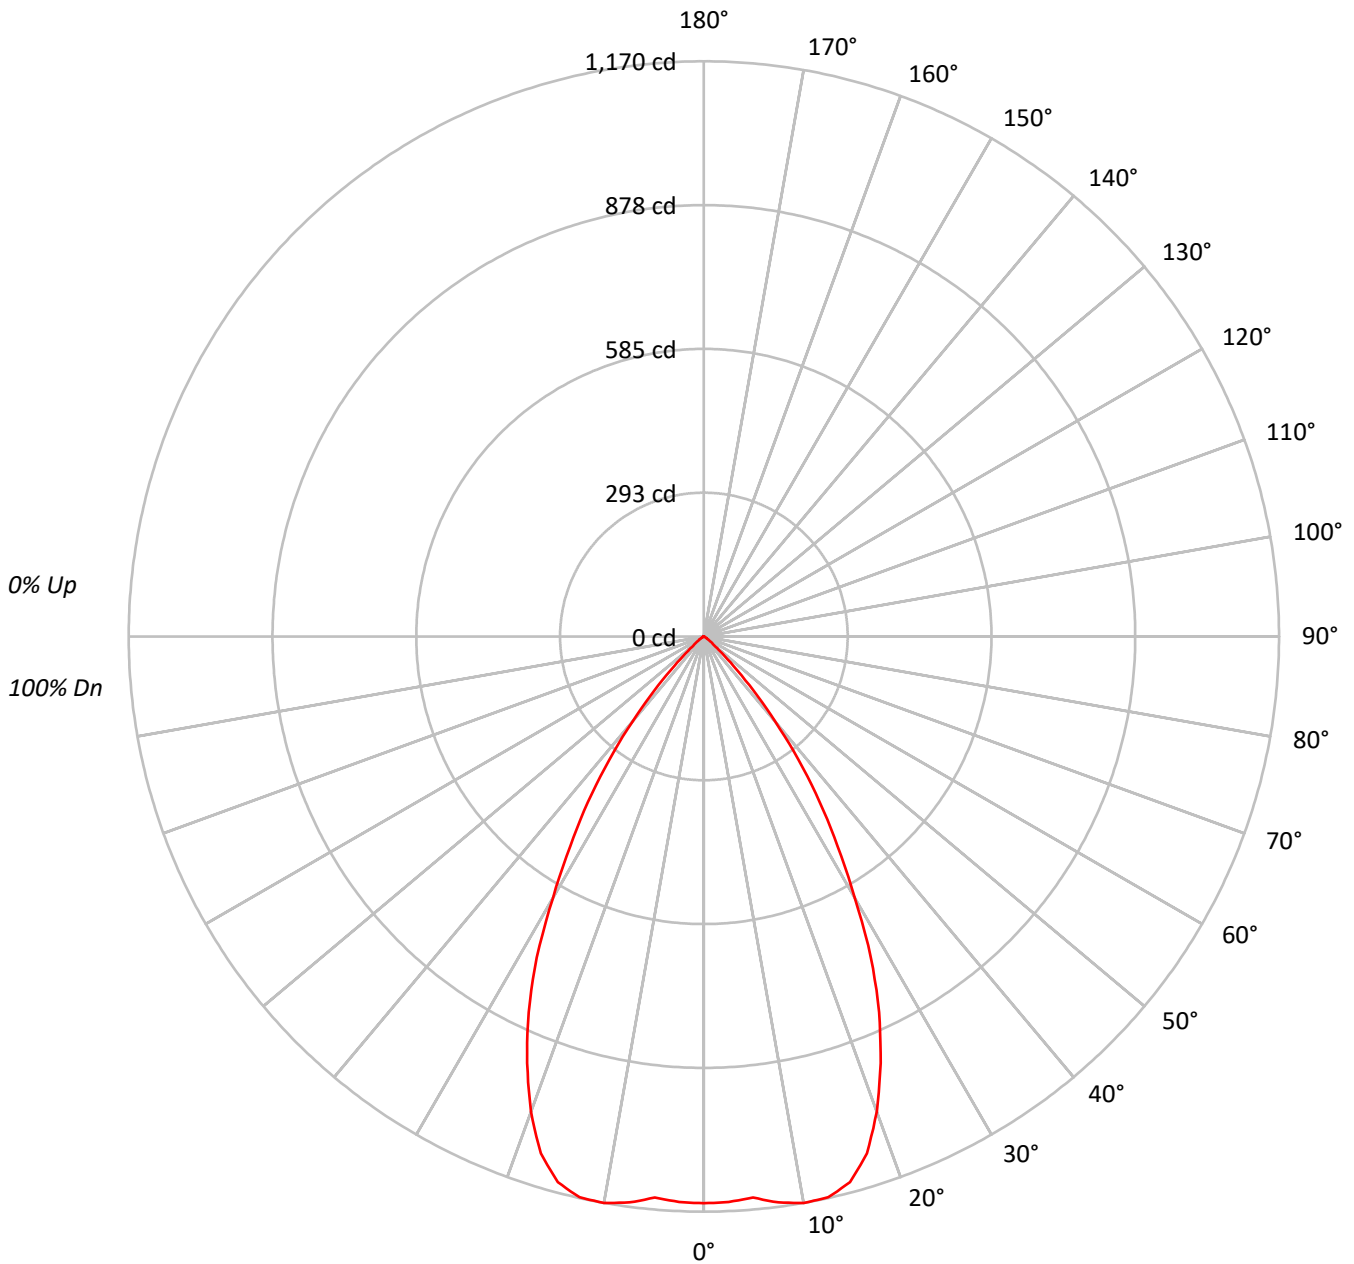



TEST NUMBER: P760664

CATALOG NUMBER: LD6D10D010-EU6DR600210IC9030-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	125956
5°	125658
10°	129829
15°	129958
20°	119575
25°	101713
30°	77502
35°	54807
40°	32177
45°	12995
50°	4334
55°	2076
60°	852
65°	129
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12995 cd/sqm



TEST NUMBER: P760664

CATALOG NUMBER: LD6D10D010-EU6DR600210IC9030-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	110.5	9.6
10°-20°	318.3	27.6
20°-30°	381.0	33.1
30°-40°	254.8	22.1
40°-50°	75.6	6.6
50°-60°	10.8	0.9
60°-70°	1.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	809.8	70.3
0°-40°	1064.6	92.4
0°-60°	1150.9	99.9
0°-90°	1152.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1152.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1153	
5°	1146	111
15°	1149	318
25°	844	381
35°	411	255
45°	84	76
55°	11	11
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P760664

CATALOG NUMBER: LD6D10D010-EU6DR600210IC9030-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1152.8
2.5°	1151.4
5°	1145.7
7.5°	1161.2
10°	1170.2
12.5°	1168.5
15°	1148.9
17.5°	1102.6
20°	1028.4
22.5°	939.3
25°	843.7
27.5°	735.9
30°	614.3
32.5°	505.7
35°	410.9
37.5°	315.9
40°	225.6
42.5°	148.8
45°	84.1
47.5°	43.0
50°	25.5
52.5°	16.5
55°	10.9
57.5°	7.0
60°	3.9
62.5°	1.7
65°	0.5
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)