

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760739

Luminaire Tested: LD6D10D010-EU6DR650210IC9030-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P760739
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR650210IC9030-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 785.8 lumens
Efficiency: N/A
Efficacy: 67.2 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760739

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9030-6LBDP1MW

Luminous Intensity Polar Plot

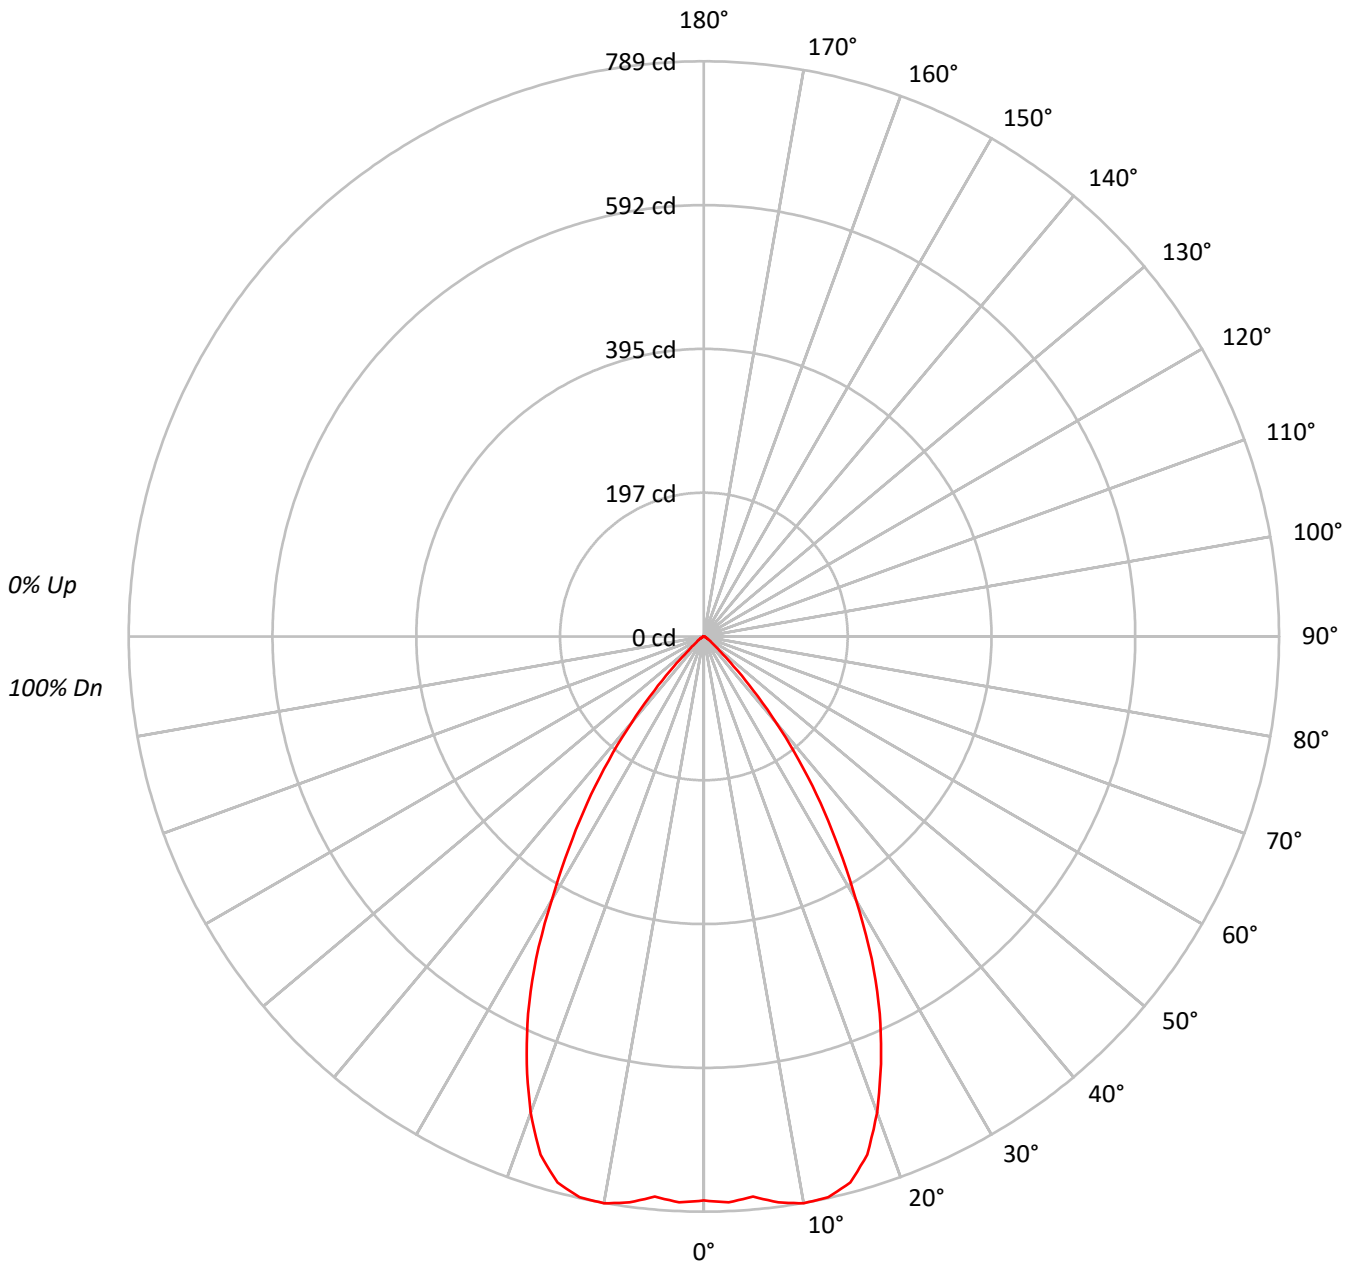



TEST NUMBER: P760739

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9030-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87		
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80		
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69		
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65		
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60		
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57		
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53		
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	84535
5°	84595
10°	87581
15°	87721
20°	80763
25°	68813
30°	52686
35°	37214
40°	21965
45°	8916
50°	3230
55°	1810
60°	1049
65°	569
70°	607
75°	464
80°	440
85°	376

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8916 cd/sqm



TEST NUMBER: P760739

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9030-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	74.5	9.5
10°-20°	214.9	27.3
20°-30°	257.8	32.8
30°-40°	173.3	22.0
40°-50°	51.8	6.6
50°-60°	9.2	1.2
60°-70°	2.6	0.3
70°-80°	1.3	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	547.2	69.6
0°-40°	720.5	91.7
0°-60°	781.5	99.5
0°-90°	785.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	785.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	774	
5°	771	74
15°	776	215
25°	571	258
35°	279	173
45°	58	52
55°	10	9
65°	2	3
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P760739

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9030-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	773.7
2.5°	776.9
5°	771.3
7.5°	783.0
10°	789.4
12.5°	787.8
15°	775.5
17.5°	745.4
20°	694.6
22.5°	634.8
25°	570.8
27.5°	498.6
30°	417.6
32.5°	344.1
35°	279.0
37.5°	214.7
40°	154.0
42.5°	100.6
45°	57.7
47.5°	30.5
50°	19.0
52.5°	13.2
55°	9.5
57.5°	6.8
60°	4.8
62.5°	3.1
65°	2.2
67.5°	2.0
70°	1.9
72.5°	1.4
75°	1.1
77.5°	1.0
80°	0.7
82.5°	0.6
85°	0.3
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)